



Minimum of 36" Guards Required On Raised Platforms (Landings) When Elevated More Than 30". Ladder Type Designs Are Not Acceptable.

Handrails are required on any flight of stairs having two or more risers.


Tread Width, Riser Height, and Nosing Projections May Not Vary More Than 3/8" In The Entire Run Of The Stair.

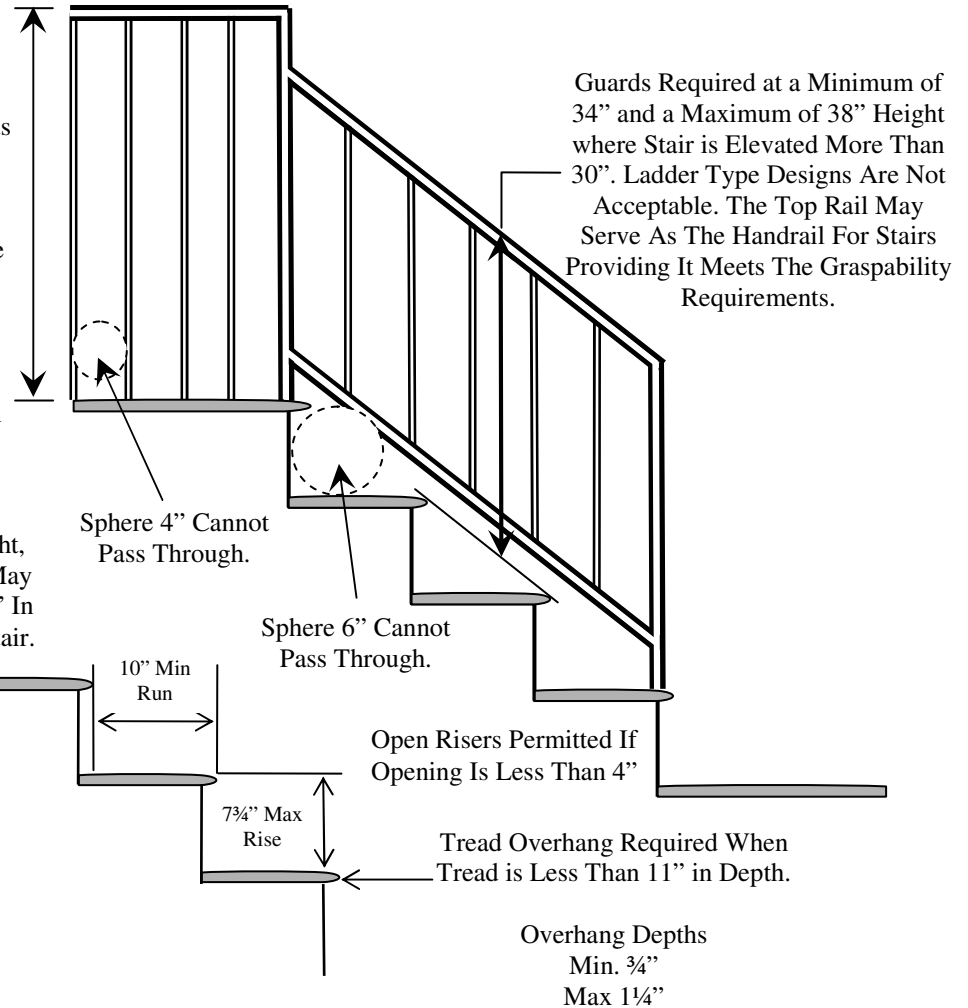


1½" Minimum



**Type I**  
Circular Handrail  
Width 1¼" Min. 2" Max.  
Diameter or Provide  
Equivalent Graspability.



**Type I**  
Noncircular Handrail  
Must Have A Perimeter Of 4" Min.  
6¼" Max With A Max Cross  
Section Dimension of 2¼".

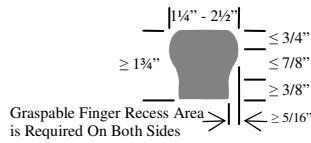

**Type II**  
Handrails With  
Perimeter > 6¼"  
Edges Shall Have A  
Min. Radius of .01"

## ROCHESTER, NEW HAMPSHIRE

CODE ENFORCEMENT DEPARTMENT  
DIVISION OF BUILDING INSPECTION

TELEPHONE: 603-332-3508

FAX: 603-332-8601



# Stairs Handout

Based On 2006 ICC IRC  
For Residential Use Only