

INVITATION TO BID

The City of Rochester, New Hampshire is accepting sealed bids for an HVAC Upgrade at the Central Fire Station. The project is to replace the boiler. Bids must be submitted in a sealed envelope plainly marked:

Rochester Fire Station 1 - Boiler Replacement
Bid # 17-08
City of Rochester
31 Wakefield Street
Rochester, NH 03867
Attn: Purchasing Agent

All bids must be received no later than **“August 11, 2016”** at **2:15 PM**. Actual bid opening will be at Rochester City Hall, 31 Wakefield Street in Rochester NH, at **2:30 PM**. No late bids, faxed, e-mailed or telephone bids will be accepted. Bid proposals and specifications may be obtained by visiting www.rochesternh.net, or emailing purchasing@rochesternh.net, or by contacting the Purchasing Agent at City Hall, 31 Wakefield Street, Rochester, NH 03867, (603) 335-7602. All bid questions must be submitted in writing (email preferred) to the Purchasing Agent. Bidders are to monitor website for addendums, and postings of all bid questions and answers. All bid proposals must be made on the bid proposal forms supplied, and the bid proposal forms must be fully completed when submitted.

A mandatory site visit to review the requirements for the proposed boiler will be held on July 21, 2016 at 9:45 a.m. Bidders will meet at Rochester Central Fire Station 37 Wakefield Street, Rochester, NH 03867. All prospective Bidders must attend in order to submit a Bid.

HVAC Upgrades at Fire Station – Boiler Replacement
Bid # 17-08
Bid Form

All work shall confirm to City of Rochester Code requirements, as can be found at the weblink below:

<http://www.rochesternh.net/building-zoning-and-licensing-services/pages/codes-currently-enforced>

Please note references to New Hampshire State Building Code (2009 IBC w/ NH amendments), National Electric code 2014, and Life Safety Code NFPA 101, 2009 Edition.

A mandatory site visit to review the requirements for the proposed boiler replacement project will be held on July 27, 2016 at 9:00 a.m. Bidders will meet at Rochester Central Fire Station located at 37 Wakefield Street, Rochester, NH 03867. All prospective Bidders must attend in order to submit a Bid.

The boiler replacement project, complete, with all materials, labor, calculations, drawings, certifications, and training, including parts and labor, shall be provided for the Total Lump Sum below.

\$ _____
(Cost in numbers)

(Cost in written words)

COMPANY NAME: _____

CONTACT PERSON: _____

ADDRESS: _____

TELEPHONE# _____ FAX# _____ E-MAIL _____

SIGNATURE: _____

Bid results will be posted after 48 hours on the City of Rochester's web site:

www.rochesternh.net or will be available by request via e-mail at the following address:
purchasing@rochesternh.net

Scope of Work

City of Rochester, NH HVAC Upgrades at Fire Station Boiler Replacement Project No. 13247B

Existing Conditions:

The existing hot water boiler and associated circulating pumps, located in the basement boiler room, are beyond their operating life. The existing expansion tanks are suspended in the boiler room, the combustion air duct enters through an areaway in the adjacent electrical room, and the vent duct joins with the water heater vent and enters the chimney.


Scope of Work:

Demolish existing Bryant hot water boiler. Demolish associated combustion air duct, vent duct, expansion tanks, circulating pumps, and piping in boiler room. Provide two new 399 MBH Lochinvar model KBN400 (B-1 & B-2), natural gas fired, hot water boilers. Provide two new Grundfos model Magna3 40-80F boiler pumps (BP-1 & BP-2), three new Grundfos model Magna3 40-80F circulating pumps (P-1, P-2 & P-3), and two new Grundfos model UPS 15-58 FRC circulating pumps (P-4 & P-5). Provide Spirotherm Spirovent VSR250 air separator and Wessels NTA-120 diaphragm expansion tank. Provide two 4-inch PVC or CPVC air intakes routed through existing areaway opening, infill wall opening around new intake pipes, terminate in strict accordance with the boiler manufacturer's recommendations. Route two new 4-inch PVC or CPVC (for boilers) and one 4-inch galvanized (for existing water heater) vent up inside the existing chimney cavity, terminate each above the roof level in strict accordance with the manufacturer's recommendations. New hot water supply and return piping to be Schedule 40 steel pipe. Connect circulating pumps to existing building piping loops, pipe sizes to match existing. Connect new Schedule 40 steel natural gas piping to existing 1 1/4-inch gas pipe in boiler room.

Plans:


See figure M1, M2, M3, & M4 for additional information.

CIRCULATING PUMP SCHEDULE												
UNIT NO.	LOCATION	SYSTEM	CIRCULATING FLUID					TYPE	MOTOR			REMARKS
			FLUID	GPM	PUMP HEAD FT. FLUID	TEMP. °F	SG		NOM. HP.	VOLT	PHASE	
P-1	BOILER ROOM	-	PROP. GLYCOL	30	15	160	1.038	CANNED ROTOR	3/4	115	1	GRUNDFOS MAGNA3 40-80F OR EQUIVALENT
P-2	BOILER ROOM	2ND FLOOR (AC-1)	PROP. GLYCOL	16	15	160	1.038	CANNED ROTOR	1/12	115	1	GRUNDFOS UPS 26-99F/VS OR EQUIVALENT
P-3	BOILER ROOM	2ND FLOOR (AC-3)	PROP. GLYCOL	16	15	160	1.038	CANNED ROTOR	1/12	115	1	GRUNDFOS UPS 26-99F/VS OR EQUIVALENT
P-4	BOILER ROOM	2ND FLOOR (AC-2)	PROP. GLYCOL	7	10	160	1.038	CANNED ROTOR	1/25	115	1	GRUNDFOS UPS 15-58 FRC OR EQUIVALENT
P-5	BOILER ROOM	1ST FLOOR	PROP. GLYCOL	7	10	160	1.038	CANNED ROTOR	1/25	115	1	GRUNDFOS UPS 15-58 FRC OR EQUIVALENT
P-6	BOILER ROOM	MAIN CIRCULATOR	PROP. GLYCOL	76	10	160	1.038	CANNED ROTOR	3/4	115	1	GRUNDFOS MAGNA3 40-120F OR EQUIVALENT
BP-1	BOILER ROOM	BOILER B-1	PROP. GLYCOL	30	1	160	1.038	CANNED ROTOR	1/6	115	1	GRUNDFOS UPS 26-99F OR EQUIVALENT
BP-2	BOILER ROOM	BOILER B-2	PROP. GLYCOL	30	1	160	1.038	CANNED ROTOR	1/6	115	1	GRUNDFOS UPS 26-99F OR EQUIVALENT

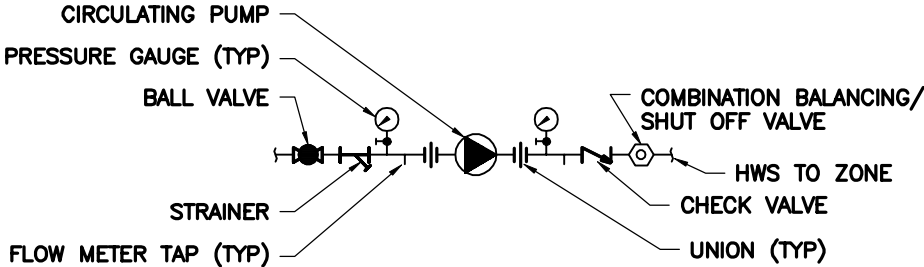

CIRCULATING PUMP INSTALLATION DETAIL
NTS

BOILER SCHEDULE							
UNIT NO.	LOCATION	SERVICE	GROSS OUTPUT MBH	NET AHRI RATING MBH	GAS CU FT	ELECTRIC	REMARKS
B-1	BOILER ROOM	HEATING	373	324	399	120/1/60	LOCHINVAR KBN400 OR EQUIVALENT
B-2	BOILER ROOM	HEATING	373	324	399	120/1/60	LOCHINVAR KBN400 OR EQUIVALENT

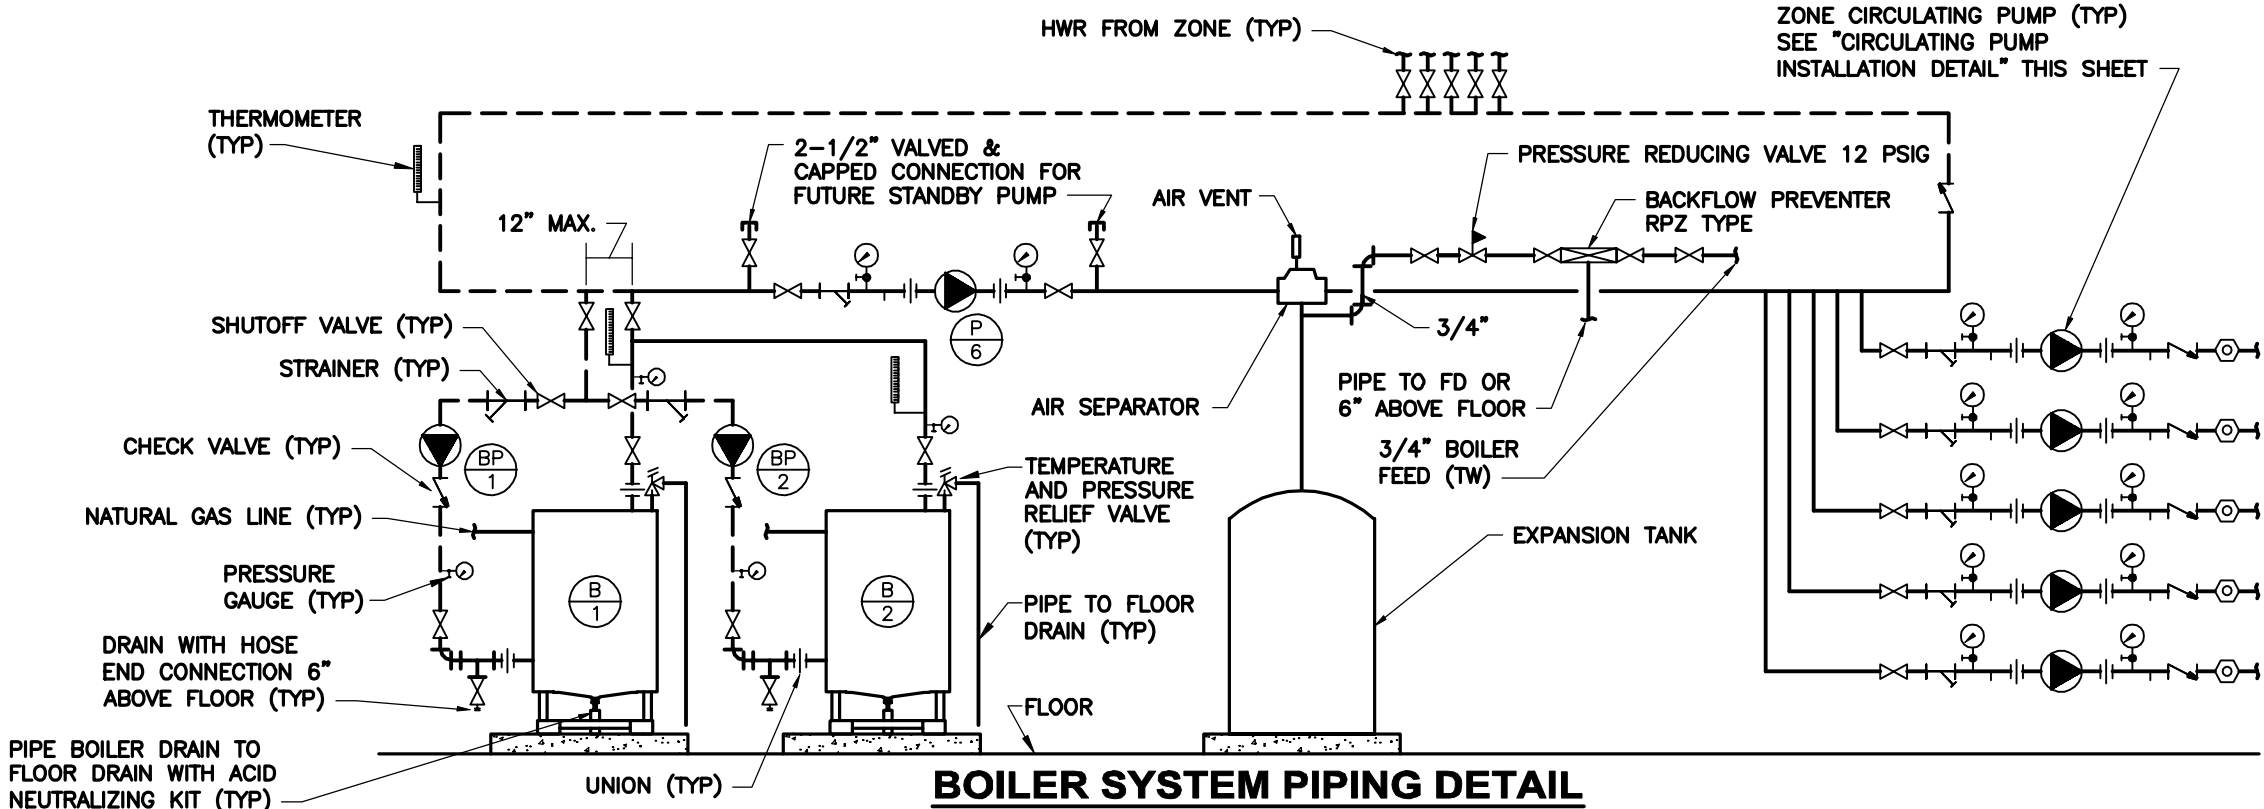

BOILER SYSTEM PIPING DETAIL
NTS
4

APP'D

REVISIONS

NO.

1

2

3

CITY OF ROCHESTER, NEW HAMPSHIRE
HVAC UPGRADES
FIRE STATION
BOILER REPLACEMENT
PROJ NO: 13247B
DATE: JUNE 2016

FIGURE:
M2


SCHEDULES & DETAILS

WRIGHT-PIERCE
Engineering a Better Environment

- FOR GENERAL MECHANICAL NOTES, LEGEND, AND ABBREVIATIONS REFER TO FIGURE M1.

DEMOLITION NOTES:


- REMOVE/DEMOLISH EXISTING BOILER IN ITS ENTIRETY INCLUDING, BUT NOT LIMITED TO; BOILER, PIPING, VALVES, WIRING, CONTROLS, BREECHING, AND ALL ASSOCIATED APPURTENANCES TO LIMITS SHOWN ON DRAWING.
- REMOVE/DEMOLISH EXISTING EXPANSION TANK IN ITS ENTIRETY INCLUDING, BUT NOT LIMITED TO; TANK, SUPPORTS, PIPING, VALVES, AND ALL ASSOCIATED APPURTENANCES.
- REMOVE/DEMOLISH EXISTING CIRCULATING PUMP IN ITS ENTIRETY INCLUDING, BUT NOT LIMITED TO; PUMP, SUPPORTS, PIPING, VALVES, AND ALL ASSOCIATED APPURTENANCES.
- REMOVE/DEMOLISH EXISTING 6" AIR INTAKE DUCTWORK IN ITS ENTIRETY INCLUDING, BUT NOT LIMITED TO; DUCTWORK, SUPPORTS, DAMPERS, AND ALL ASSOCIATED APPURTENANCES. INFILL EXISTING OPENING.
- REMOVE/DEMOLISH EXISTING WATER HEATER EXHAUST DUCTING IN ITS ENTIRETY INCLUDING, BUT NOT LIMITED TO; BREECHING, SUPPORTS, FITTINGS, AND ALL ASSOCIATED APPURTENANCES TO LIMITS SHOWN ON DRAWING.

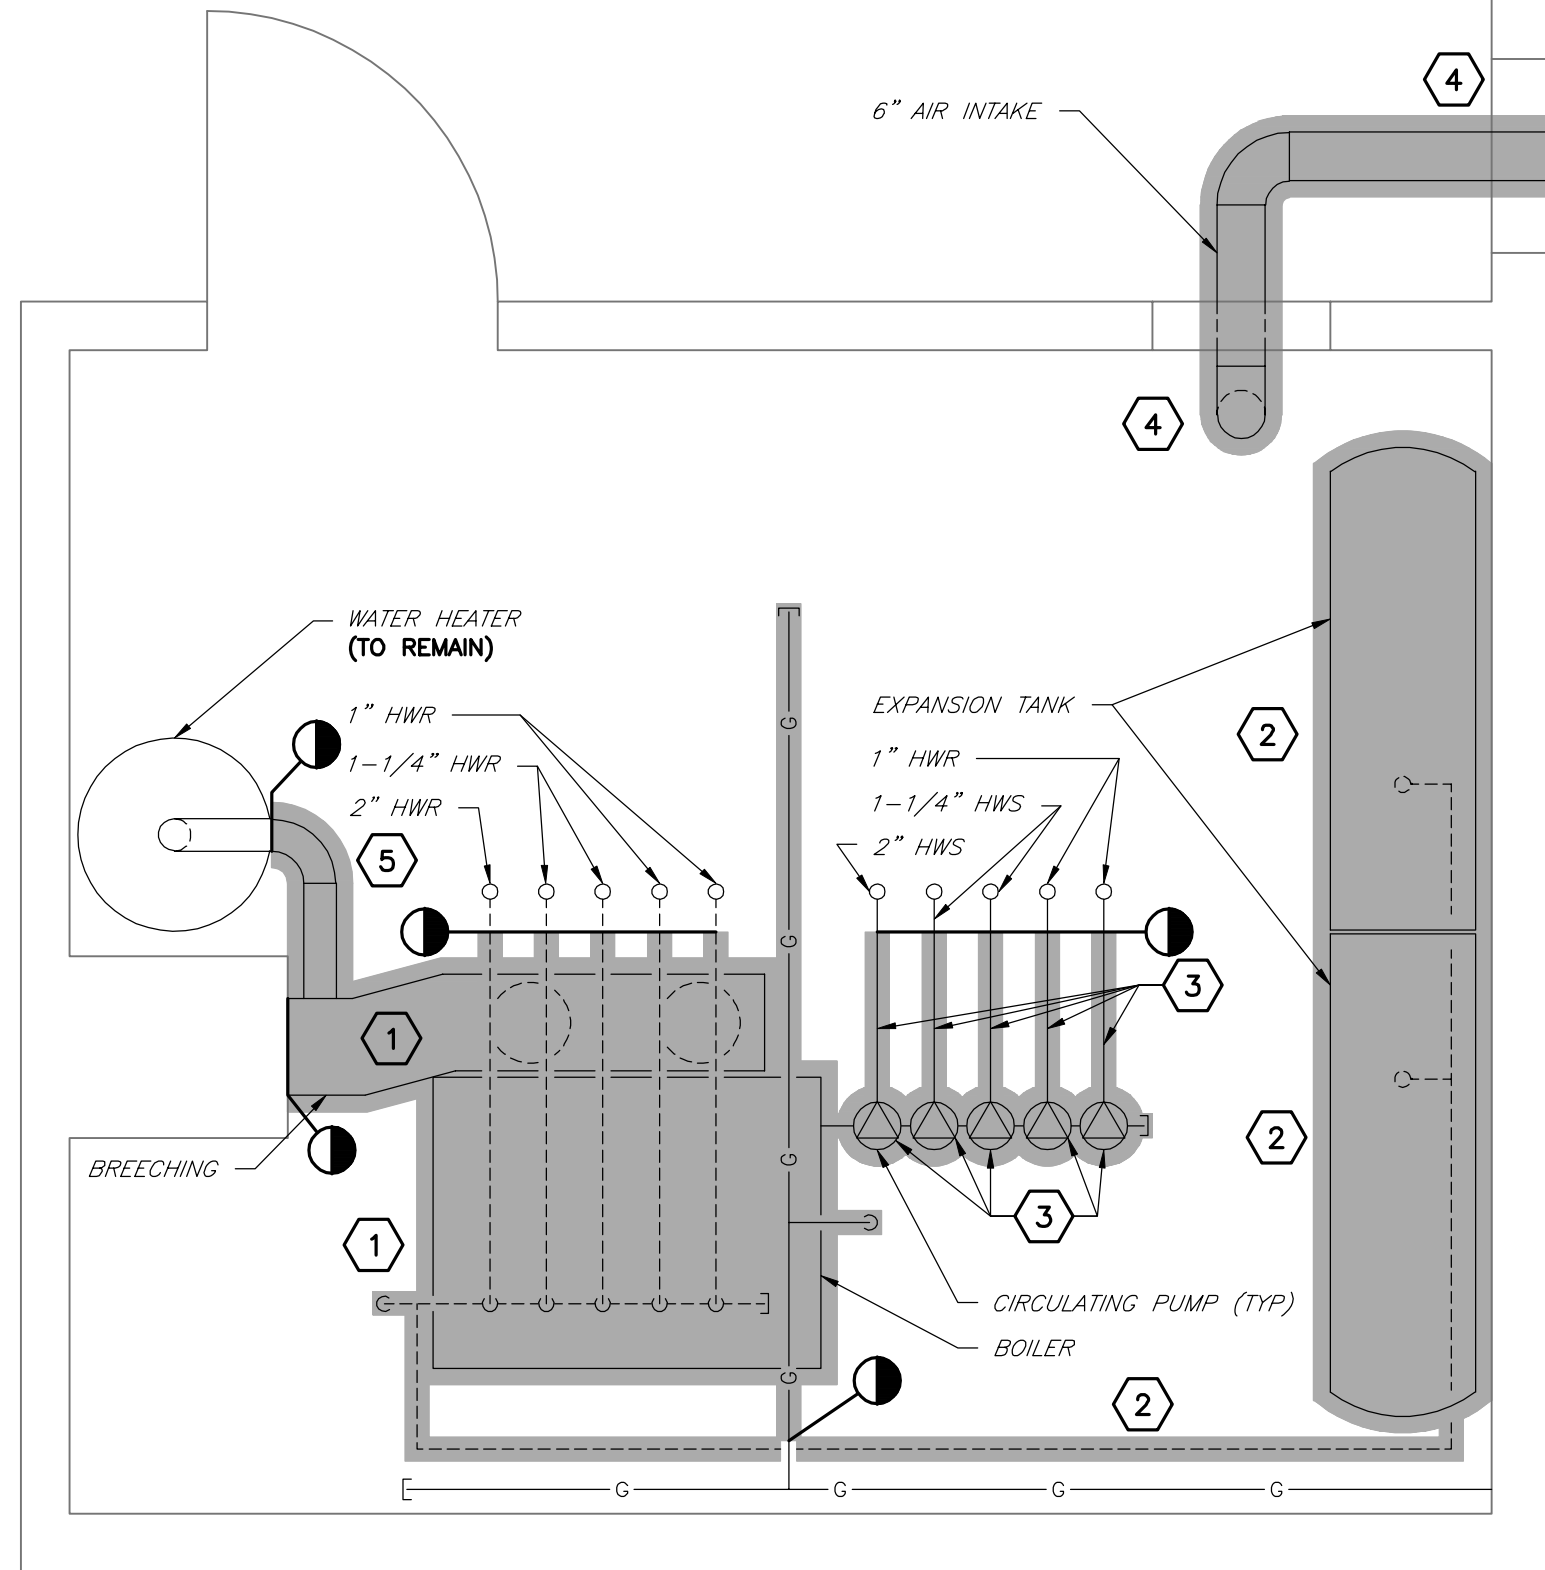

FIRE STATION BOILER ROOM DEMOLITION PLAN


SCALE: 1/2"=1'-0"

5' 2"

CITY OF ROCHESTER, NEW HAMPSHIRE		PROJ NO: 13247B	DATE: JUNE 2016	NO.		REVISIONS	APP'D	
HVAC UPGRADES				1				
FIRE STATION				2				
BOILER REPLACEMENT				3				
<div>WRIGHT-PIERCE</div> <div>Engineering a Better Environment</div>				BOILER ROOM DEMOLITION PLAN				FIGURE: M3

NOTES:

1. FOR GENERAL MECHANICAL NOTES, LEGEND, AND ABBREVIATIONS REFER TO FIGURE M1.
2. 4" VENT UP IN EXISTING CHIMNEY CAVITY – TERMINATE ABOVE ROOF IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
3. 4" AIR INTAKE – TERMINATE IN STRICT ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS.
4. SCHEDULE 40 STEEL PIPE (TYP.). PUMP INLET/OUTLET PIPING SIZES TO MATCH EXISTING PIPE SIZE.
5. SCHEDULE 40 STEEL PIPE, SIZE TO MATCH EXISTING.
6. PROVIDE CONTROL RELAYS COMPATIBLE WITH EXISTING CONTROLS & NEW EQUIPMENT. RELAYS AND DISCONNECT SWITCHES TO BE INSTALLED IN ACCORDANCE WITH NFPA 70.

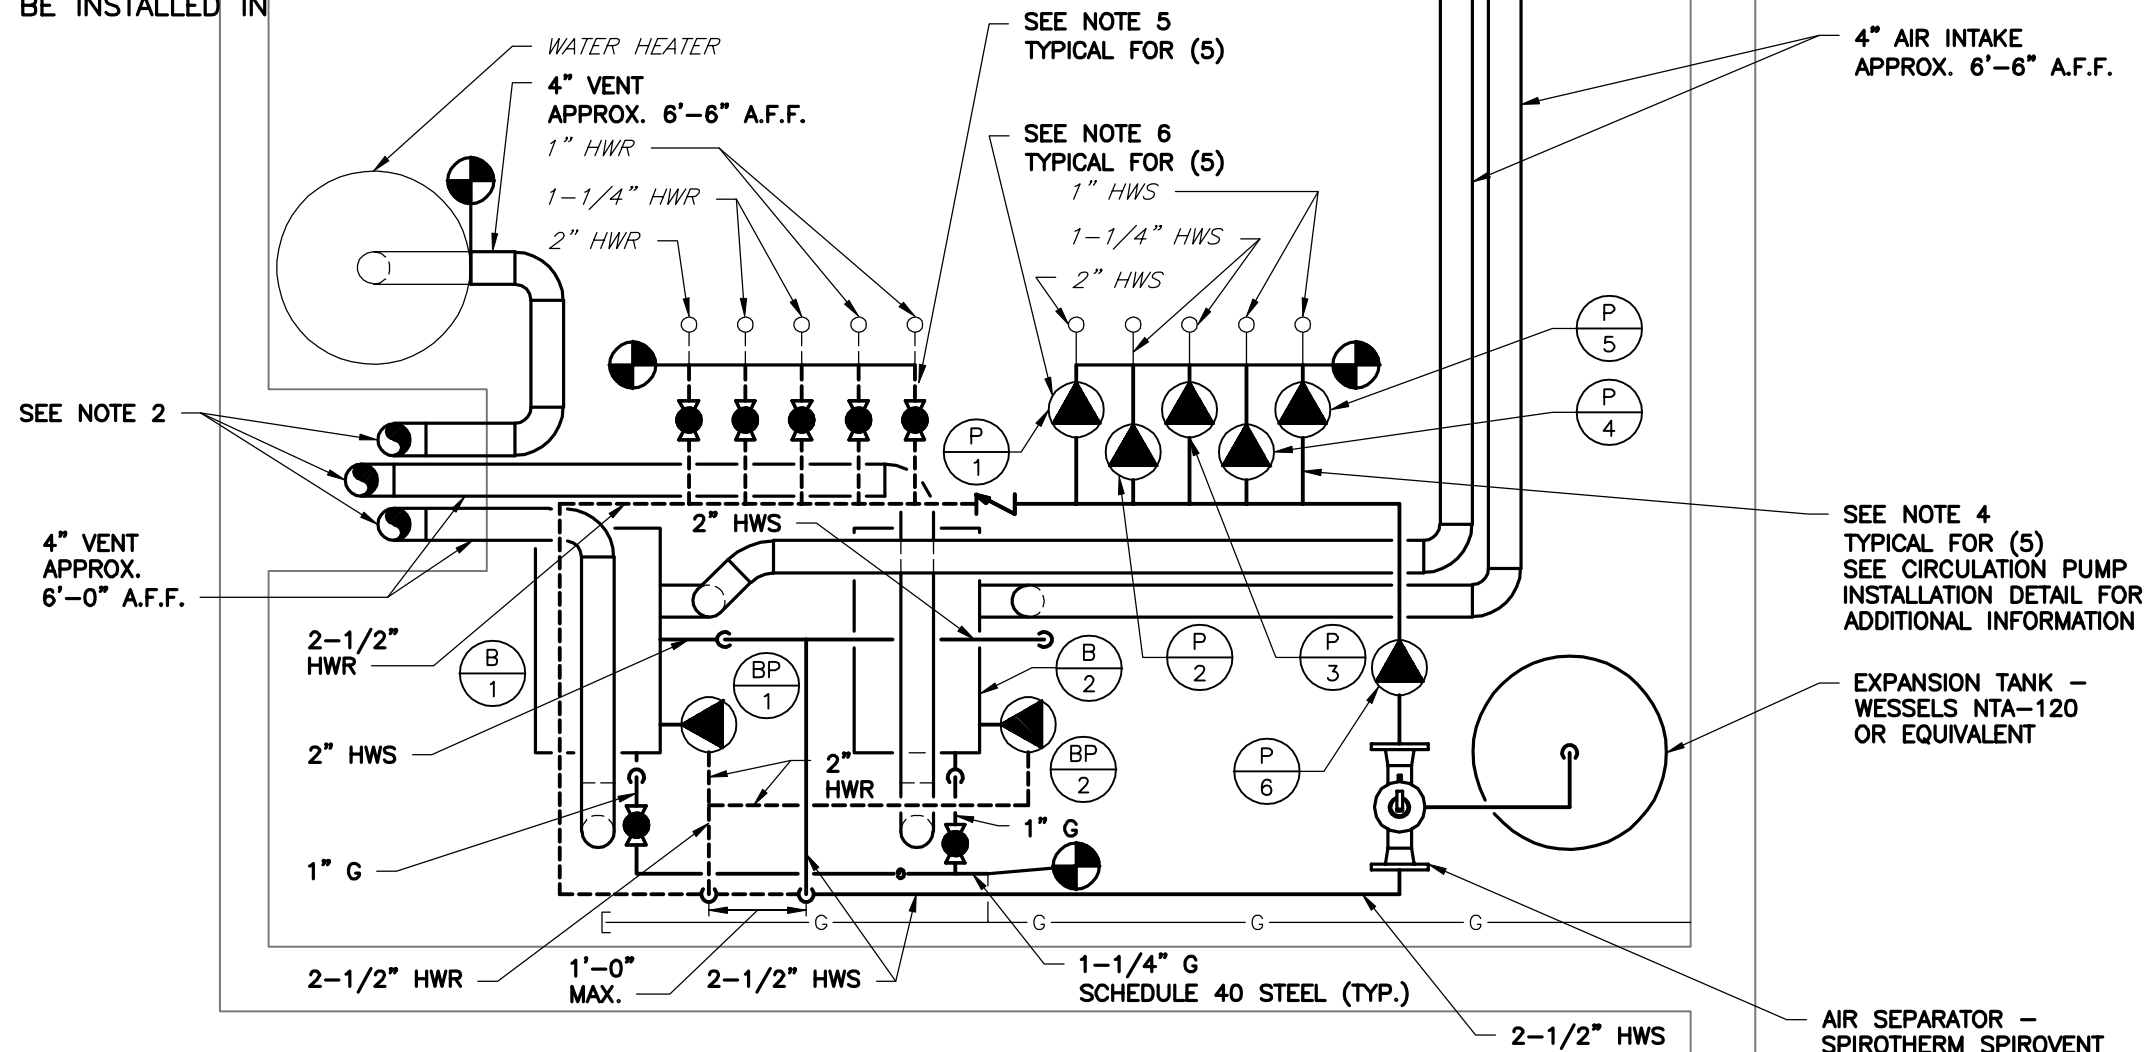

FIRE STATION BOILER ROOM MODIFICATIONS PLAN

SCALE: 1/2"=1'-0"

6' 2'

CITY OF ROCHESTER, NEW HAMPSHIRE		NO.	REVISIONS	APP'D
HVAC UPGRADES		1		
FIRE STATION		2		
BOILER REPLACEMENT		3		
PROJ NO: 13247B				
DATE: JUNE 2016				
<div>WRIGHT-PIERCE</div> <div>Engineering a Better Environment</div>		<div>BOILER ROOM</div> <div>MODIFICATIONS PLAN</div> <div>FIGURE: M4</div>		

INSTRUCTION TO BIDDERS

PREPARATION OF BID PROPOSAL

1. The Bidder shall submit her/his proposal upon the form(s) furnished by the City (attached). The bidder shall specify a unit price for each pay item. All figures shall be in ink or typed.
2. If a unit price or lump sum bid already entered by the bidder on the proposal form is to be altered it should be crossed out with ink, the new unit price or lump sum bid entered above or below it, and initialed by the bidder, also with ink. In case of discrepancy between the prices written in words and those written in figures, the prices written in words shall govern.
3. The bidder's proposal must be signed with ink by the individual, by one or more members of the partnership, by one or more members or officers of each firm representing a joint venture, by one or more officers of a corporation, or by an agent of the contractor legally qualified and acceptable to the owner. If the proposal is made by an individual, his name and post office address must be shown, by a partnership the name and post office address of each partnership member must be shown; as a joint venture, the name and post office address of each must be shown; by a corporation, the name of the corporation and its business address must be shown, together with the name of the state in which it is incorporated, and the names, titles, and business addresses of the President, Secretary, and Treasurer.
4. All questions shall be submitted in writing to and received by the Purchasing Agent at the above address, a minimum of 7 days prior to the scheduled bid opening. The Purchasing Agent, will then forward both the question and the city's response to the question to all known prospective bidders.

IRREGULAR PROPOSALS

Bid proposals will be considered irregular and may be rejected for any of the following reasons:

1. If the proposal is on a form other than that furnished by the Owner or if the form is altered or any part thereof is detached.
2. If there are unauthorized additions, conditional or alternate bids, or irregularities of any kind which may tend to make the proposal incomplete, indefinite or ambiguous as to its meaning.
3. If the bidder adds any provisions reserving the right to accept or reject an award, or to enter into a contract pursuant to an award.
4. If the proposal does not contain a unit price for each pay item listed, except in the case of authorized alternate pay items.

DELIVERY OF BID PROPOSALS

When sent by mail, the sealed proposal shall be addressed to the City of Rochester, Purchasing Agent, 31 Wakefield Street, Rochester, NH 03867. All proposals shall be filed prior to the time and at the place specified in the invitation for bids. Proposals received after the time for opening of the bids will be returned to the bidder, unopened. Emailed or faxed bid proposals are not acceptable.

WITHDRAWAL OF BID PROPOSALS

A bidder will be permitted to withdraw his proposal unopened after it has been deposited if such request is received in writing prior to the time specified for opening the proposals.

PUBLIC OPENING OF BID PROPOSALS

Proposals will be opened and read publicly at the time and place indicated in the invitation for bids. Bidders, their authorized agents, and other interested parties are invited to be present.

DISQUALIFICATION OF BIDDERS

Either of the following reasons may be considered as being sufficient for the disqualification of a bidder and the rejection of her/his bid proposal(s):

1. Evidence of collusion among bidders.
2. Failure to supply complete information as requested by the bid specifications.

CONSIDERATION OF PROPOSALS

1. Bids will be made public at the time of opening and may be reviewed only after they have been properly recorded. In case of discrepancy between the prices written in words and those written figures, the prices written in words shall govern. In case of a discrepancy between the total shown in the proposal and that obtained by adding the products of the quantities of items and unit bid prices, the latter shall govern.
2. The right is reserved to reject any or all proposals, to waive technicalities or to advertise for new proposals, if in the judgment of the City, the best interest of the City of Rochester will be promoted thereby.
3. Bid results will be available on the website at www.rochesternh.net within 48 hours of the bid opening.

AWARD OF CONTRACT

The City holds the right, in its judgment, to award the contract to the bidder, which it feels is in the best interest of the City. If a contract is to be awarded, the Contractor/Vendor selection shall be based in part on possession of the necessary experience, organization, technical and professional qualifications, skills and facilities, reference checks, project understanding, approach, ability to comply with proposed or required time to completion or performance, licensing or certification, in good standing with Federal, State and Local agencies, possession of satisfactory record of performance, cost and to a responsible and qualified bidder whose proposal complies with all the requirements prescribed as soon as practical after the bid opening. No bid shall be withdrawn for a period of (60) sixty days subsequent to the opening of bids without the consent of the City of Rochester. The successful bidder will be notified, by the form mailed to the address on his proposal, that his bid has been accepted and that he has been awarded the contract.

CANCELLATION OF AWARD

The City reserves the right to cancel the award of any contract at any time before the execution of such contract by all parties without any liability or other claim against the City.

BID EVALUATION

In addition to the bid amount, additional factors will be considered as an integral part of the bid evaluation process, including, but not limited to:

1. The bidder's ability, capacity, and skill to perform within the specified time limits.
2. The bidder's experience, reputation, efficiency, judgment, and integrity.
3. The quality, availability and adaptability of the supplies and materials sold.
4. The bidder's past performance.
5. The sufficiency of bidder's financial resources to fulfill the contract.
6. The bidder's ability to provide future maintenance and/or services.
7. Any other applicable factors as the City determines necessary and appropriate (such as compatibility with existing equipment).

CONDITIONS AT SITE

Bidders shall be responsible for having ascertained pertinent local conditions, such as: location, accessibility and general character of the site. The character and extent of existing work within or adjacent to the site and any other work being performed thereon at the time of the submission of her/his bid.

LAWS, PERMITS AND REGULATIONS

1. The Contractor shall obtain and pay for all licenses and permits as may be required of him by law, and shall pay for all fees and charges for connection to outside services, and use of property other than the site of the work for storage of materials or other purposes.
2. The Contractor shall comply with all State and Local laws, ordinances, regulations and requirements applicable to work hereunder, including building code requirements. If the Contractor ascertains at any time that any requirement of this Contract is at variance with applicable laws, ordinances, regulations or building code requirements, she/he shall promptly notify the City of Rochester in writing.

CONTRACTOR'S AND SUBCONTRACTOR'S INSURANCE

1. The Contractor shall deliver with bid documents; certificates of all insurance required hereunder. The certificate shall state that the companies issuing insurance will endeavor to mail to the City of Rochester ten (10) days notice of cancellation, alteration or material change of any listed policies. The Contractor shall keep in force the insurance required herein for the period of the Contract. At the request of the City of Rochester, the Contractor shall promptly make available a copy of any and all listed insurance policies. The requested insurance must be written by a Company licensed to do business in New Hampshire at the time the policy is issued.
2. The City of Rochester, NH shall be listed as additional insured on all the Certificates of Insurance.

3. The Contractor shall require each Subcontractor employed on the Project to maintain the coverage listed below unless the Contractor's insurance covers activities of the Subcontractor on the Project.
4. No operations under this Contract shall commence until certificates of insurance attesting to the below listed requirements have been filed with and approved by the Department of Public Works, and the Contract approved by the City Manager.
 - a. Workmen's Compensation Insurance
Limit of Liability - \$100,000.00 per accident
 - b. Commercial General Liability
Limits of Liability
Bodily Injury: \$1,000,000.00 per occurrence, \$1,000,000.00 aggregate
Property Damage: \$500,000.00 per occurrence, \$200,000.00 aggregate
Combined Single Limit, Bodily Injury and Property Damage:
\$2,000,000.00 aggregate
 - c. Automobile Liability
Limits of Liability - \$500,000.00 per accident.
 - d. The Contractor shall indemnify, defend, and save harmless the City of Rochester and its agents and employees from and against any suit, action or claim of loss or expenses because of bodily injury. Including death at any time resulting there from, sustained by any person or persons or on account of damage to property, including loss of use thereof, whether caused by or contributed to by said City of Rochester, its agents, employees or others.

ACCIDENT PROTECTIONS

It is a condition of this Contract, and shall be made a condition of each subcontract entered into pursuant to the Contract. That a Contractor and any Subcontractors shall not require any laborer or mechanic employed in the performance of the Contract to work in surroundings or under working conditions which are unsanitary, hazardous, or dangerous to health or safety, as determined by construction safety and health standards of the Occupational Safety and Health Administration, United States Department of Labor, which standards include, by reference, the established Federal Safety and Health regulations for Construction. These standards and regulations comprise Part 1910 and Part 1926 respectively of Title 29 of the Code of Federal Regulations and are set forth in the Federal Register. In the event any revisions in the Code of Federal Regulations are published, such revisions will be deemed to supersede the appropriate Part 1910 and Part 1926, and be effective as of the date set forth in the revised regulation.

SUBCONTRACTS

1. Nothing contained in the Specifications or Drawings shall be construed as creating any contractual relationship between any Subcontractor and the City of Rochester. The Division or Sections of the Specifications are not intended to control the Contractor in dividing the work among Subcontractors or to limit the work performed by any trade.

2. The Contractor shall be as fully responsible to the City of Rochester for the acts and omissions of Subcontractors and of persons employed by her/him, as she/he is responsible for the acts and omissions of persons directly employed by her/him.

PROTECTION OF WORK AND PROPERTY

The Contractor shall, at all times, safely guard the City's property from injury or loss in connection with this Contract. She/he shall, at all times, safely guard and protect her/his own work and that of adjacent property from damage. All passageways, guard fences, lights and other facilities required for protection by State or Municipal laws, regulations and local conditions must be provided and maintained.

USE OF PREMISES AND REMOVAL OF DEBRIS

The Contractor expressly undertakes at his own expense:

1. To take every precaution against injuries to persons or damage to property;
2. To comply with the regulations governing the operations of premises which are occupied and to perform his Contract in such a manner as not to interrupt or interfere with the operation of the Institution;
3. To perform any work necessary to be performed after working hours or on Sunday or legal holidays without additional expense to the City, but only when requested to do so by the City;
4. To store his apparatus, materials, supplies and equipment in such orderly fashion at the site of the work as will not unduly interfere with the progress of his work or the work of any other Contractors;
5. Daily to clean up and legally dispose of (away from the site), all refuse, rubbish, scrap materials and debris caused by his operation. Including milk cartons, paper cups and food wrappings left by his employees, to the end that at all times the site of the work shall present a neat, orderly and workmanlike appearance;
6. All work shall be executed in a workmanlike manner by experienced mechanics in accordance with the most modern mechanical practice and shall represent a neat appearance when completed.

MATERIALS AND WORKMANSHIP

1. Unless otherwise specified, all materials and equipment incorporated into the work under the Contract shall be new. All workmanship shall be first class and by persons qualified in their respective trades.
2. Where the use of optional materials or construction method is approved, the requirements for workmanship, fabrication and installation indicated for the prime material or construction method shall apply wherever applicable. Required and necessary modifications and adjustments resulting from the substitution or use of an optional material or construction method shall be made at no additional cost to the City.

STANDARDS

1. Materials specified by reference to the number, symbol or title of a specific standard, such as a Commercial Standard, a Federal Specification, Department's Standard Specifications, a trade association standard or other similar standard. Shall comply with requirements in the latest revision thereof and any amendment or supplement thereto in effect on the date of advertisement, except as limited to type, class or grade or modified in such reference.
2. Reference in the Specifications to any article, device, product, material, fixture, form or type of construction by name, make or catalog number shall be interpreted as establishing a standard of quality and shall not be construed as limiting competition. In such cases the Contractor may, at his option, use any articles, device, product, material fixture, form or type of construction that, in the judgment of the City expressed in writing to all Bidders before opening of bids as an addendum, is an acceptable substitute to the specified.
3. Substitution During Bid Time: Whenever any particular brand or make of material or apparatus is called for in the Specifications, a Bidder's Proposal must be based upon such material or apparatus, or upon a brand or make which has been specifically approved as a substitution in an Addendum issued to all Bidders during the bidding time.
4. The intent is that the brand or make of material or apparatus that is called for herein establishes a standard of excellence that, in the opinion of the Consultant and Engineer, is necessary for this particular Project.
5. Substitution After Bid Opening: No substitutions will be considered after bids have been opened unless necessary due to strikes, lockouts, bankruptcy or discontinuance of manufacture, etceteras. In such cases, the Contractor shall apply to the City, in writing within ten (10) days of his realizing his inability to furnish the article specified, describing completely the substitution he desires to make.

EXTRAS

Except as otherwise herein provided, no charge for any extra work or material will be allowed unless the Director of Public Works has ordered the same, in writing.

GUARANTEE OF WORK

1. Except as otherwise specified, all work shall be guaranteed by the Contractor against defects resulting from the use of inferior materials, equipment or workmanship for one (1) year from the Date of Final Acceptance.
2. Make good any work or material, or the equipment and contents of said building or site disturbed in fulfilling any such guarantee.
3. In any case, wherein fulfilling the requirements of the Contract or of any guarantee, should the Contractor disturb any work guaranteed under another contract, the Contractor shall restore such disturbed work to a condition satisfactory to the Director of Public Works. And guarantee such restored work to the same extent as it was guaranteed under such other contracts.
4. If the Contractor, after notice, fails to proceed promptly to comply with the terms of the guarantee, the City of Rochester may have the defects corrected and the Contractor shall be

liable for all expense incurred.

5. All special guarantees applicable to definite parts of the work that may be stipulated in the Specifications or other papers forming a part of the Contract shall be subject to the terms of this paragraph during the first year of the life of such special guarantee.

DEFAULT AND TERMINATION OF CONTRACT

If the Contractor:

1. Fails to begin work under Contract within the time specified in the notice to proceed; or
2. Fails to perform the work with sufficient workers and equipment, or with sufficient materials to assume prompt completion of said work; or
3. Performs the work unsuitably or neglects or refuses to remove materials or to perform anew such work as may be rejected as unacceptable and unsuitable; or
4. Discontinues the prosecution of the work; or
5. Fails to resume work, which has been discontinued, within the time frames included in specifications; or
6. Becomes insolvent or has declared bankruptcy, or commits any act of bankruptcy or insolvency; or
7. Makes an assignment for the benefit of creditors; or
8. For any other causes whatsoever, fails to carry on the work in an acceptable manner the City of Rochester will give notice, in writing, to the Contractor for such delay, neglect, and default.

If the Contractor does not proceed in accordance with the Notice, then the City of Rochester will have full power and authority without violating the Contract to take the prosecution of the work out of the hands of the Contractor. The City of Rochester may enter into an agreement for the completion of said Contract according to the terms and conditions thereof, or use such other methods as in the City's opinion will be required for the completion of said Contract in an acceptable manner.

All extra costs and charges incurred by the City of Rochester as a result of such delay, neglect or default, together with the cost of completing the work under the Contract will be deducted from any monies due or which may become due to said Contractor. If such expenses exceed the sum which would have been payable under the contract, then the Contractor shall be liable and shall pay to the City of Rochester the amount of such excess.

OBTAINING BID RESULTS

Bid results will be available on the website at www.rochesternh.net within 48 hours of the bid opening.