

GENERAL INFORMATION

OWNER/APPLICANT/  
PREPARED FOR

MAP 114 LOT 7  
401 NORTH MAIN STREET, LLC  
549 US HIGHWAY 1 BYPASS  
PORTSMOUTH, NH 03801  
603-319-0440  
C/O ANTHONY DILORENZO

RESOURCE LIST

PLANNING/ZONING DEPARTMENT/  
CONSERVATION COMMISSION  
33 WAKEFIELD STREET  
ROCHESTER, NH 03867-1917  
603-335-1338  
SETH CREIGHTON, AICP, CHIEF PLANNER

BUILDING DEPARTMENT

33 WAKEFIELD STREET  
ROCHESTER, NH 03867  
603-335-7571  
JIM GRANT, DIRECTOR, ELECTRICAL INSPECTOR

PUBLIC WORKS

45 OLD DOVER ROAD  
ROCHESTER, NH 03867  
603-332-4095  
PETER NOURSE, P.E., DIRECTOR OF CITY SERVICES

POLICE DEPARTMENT

23 WAKEFIELD STREET  
ROCHESTER, NH 03867  
603-330-7131  
PAUL TOUSSAINT, CHIEF

FIRE DEPARTMENT

37 WAKEFIELD STREET  
ROCHESTER, NH 03867  
603-330-7180  
MARK KLOSE, FIRE CHIEF

NHDES HAZARDOUS WASTE REMEDIATION  
(BROWNFIELDS)

29 HAZEN DRIVE  
CONCORD, NH 03302-0095  
603-271-1169  
MINDY BUBIER, ENGINEER, PROJECT MANAGER

ASSOCIATED PROFESSIONALS

ARCHITECT  
TW DESIGNS  
254 DRAKE HILL RD, STRAFFORD, NH 03884  
603-664-2181  
JOHN TUTTLE, AIA, LEED AP

ENVIRONMENTAL SERVICES  
(SOIL MONITORING)  
GEOSIGHT, INC.  
186 GRANITE STREET  
3RD FLOOR, SUITE A  
MANCHESTER, NH 03101  
603-314-0820  
CHERYL A. BROWN, P.G., PROJECT GEOLOGIST

ENVIRONMENTAL SERVICES  
(WATER MONITORING)  
ENSAFE  
1F COMMONS DRIVE, SUITE 34  
LONDONDERRY, NEW HAMPSHIRE 03053  
603-437-8227  
ROBERT FRANCIS, SENIOR PROJECT MANAGER

ENVIRONMENTAL SERVICES  
(WILDLIFE & HABITAT ASSESORS)  
GZA ENVIRONMENTAL  
5 COMMERCE PARK NORTH  
BEDFORD, NH 03110  
603-232-8739  
TRACY TARR, SCIENTIST, ASSOCIATE PRINCIPAL

GEOTECHNICAL ENGINEER  
SLR CONSULTING  
2 COMMERCE DRIVE, SUITE 110,  
BEDFORD, NEW HAMPSHIRE, 03110  
603-668-1654  
ERIC TEALE, PRINCIPAL GEOTECHNICAL ENGINEER

TRAFFIC ENGINEER  
TFMORAN, INC.  
170 COMMERCE WAY, SUITE 102  
PORTSMOUTH, NH 03801  
603-472-4488  
JENNIFER PORTER, P.E., TRAFFIC ENGINEER

LIGHTING DESIGN  
SK & ASSOCIATES INC  
20/22 CARVER CIRCLE  
CANTON, MA 02021  
781-821-1700  
ANDREW DEGOUFF

PROPOSED  
AUTO DEALERSHIP

0 NORTH MAIN STREET  
ROCHESTER, NEW HAMPSHIRE

JUNE 1, 2021  
REVISED JULY 9, 2021



WAIVERS

THE FOLLOWING WAIVERS FROM THE CITY OF ROCHESTER SITE PLAN REGULATIONS ARE BEING REVIEWED BY THE PLANNING BOARD:

- CITY OF ROCHESTER SITE REVIEW REGULATIONS SECTION 5 - LANDSCAPING
- CITY OF ROCHESTER SITE REVIEW REGULATIONS SECTION 5(D)(89) - AT LEAST ONE BROAD-LEAVED SHADE TREE SHALL BE PLANTED IN THE FRONT BUFFER FOR EVERY 40 LINEAR FEET OF THE FRONT BUFFER
- CITY OF ROCHESTER SITE REVIEW REGULATIONS SECTION 10(A) - NUMBER OF REQUIRED PARKING SPACES
- CITY OF ROCHESTER SITE REVIEW REGULATIONS SECTION 10(H)(2) - SLOPED CURBING SHALL ALSO HAVE A 8-INCH VERTICAL REVEAL AND IT SHALL BE SET AT A 45 DEGREE ANGLE UNLESS OTHERWISE APPROVED BY THE PLANNING BOARD.

NEW HAMPSHIRE FISH & GAME NOTES

- IF SPOTTED, WOOD, OR BLANDING'S TURTLES ARE OBSERVED DURING CONSTRUCTION, CONTACT NHFG IMMEDIATELY UPON OBSERVATION, AND SAFELY RELOCATE TURTLES OUT OF CONSTRUCTION AREAS IF OBSERVED. OBSERVATIONS OF THREATENED AND ENDANGERED SPECIES SHOULD BE REPORTED TO NHFG BY EMAIL AT RAARP@MILDUFENH.GOV AND MELISSA.DOPERALSKI@MILDUFENH.GOV, WITH PHOTOGRAPHS (IF AVAILABLE).



SPOTTED TURTLE

NOTES

- SMALL, MOSTLY AQUATIC WITH BLACK OR DARK BROWN WITH YELLOW SPOTS
- FAIRLY FLAT SHALL COMPARED TO BLANDING'S TURTLE



WOOD TURTLE

NOTES

- 5-8 INCH SHELL, HIGHLY SCULPTED SHELL WHERE EACH LARGE SCUTE TAKES AN IRREGULAR PYRAMIDAL SHAPE.
- THE NECK AND FORELIMBS ARE ORANGE.
- AQUATIC BUT OFTEN MOVES ON LAND



BLANDING'S TURTLE

NOTES

- LARGE, DARK/BLACK DOWED SHELL WITH LIGHTER SPECKLES
- DISTINCT YELLOW THROAT/CHIN
- AQUATIC BUT OFTEN MOVES ON LAND



BALD EAGLE

NOTES

- BALD EAGLES ARE LEGALLY PROTECTED IN NEW HAMPSHIRE. POSSESSION AND TAKE (WHICH INCLUDES HARMING, HARASSING, INJURING AND KILLING) IS ILLEGAL.
- ADULTS ARE APPROXIMATELY 3' TALL WITH 6'-8' WING SPAN, AND HAVE DISTINCTIVE WHITE HEAD AND TAIL FEATHERS, AND A DARK BROWN BODY AND WINGS. EYES ARE PALE YELLOW AND THE BEAK AND FEET ARE BRIGHT YELLOW.
- IMMATURE BALD EAGLES ARE MOTTLED LIGHT BROWN, TAN, AND WHITE WITH BROWN EYES, BLACK BEAK, AND YELLOW FEET.

INDEX OF SHEETS


SHEET	SHEET TITLE
C-00	COVER
C-01	NOTES & LEGEND
S-01	EXISTING CONDITIONS PLAN
C-02	NHDES SHORELAND IMPACT PLAN
C-03	SITE PREPARATION & DEMOLITION PLAN
C-04	SITE LAYOUT PLAN
C-05	GRADING & DRAINAGE PLAN
C-06	UTILITY PLAN
C-07	SEWER PROFILE
C-08	LANDSCAPE PLAN
C-09	LANDSCAPE DETAILS
C-10	EROSION CONTROL PLAN
C-11	EROSION CONTROL NOTES
C-12	WB-67 TRUCK TURNING PLAN
C-13 TO C-21	DETAILS

REFERENCE PLANS BY ASSOCIATED PROFESSIONALS

SL1	PHOTOMETRIC LAYOUT CALCULATIONS AND SCHEDULES
-	PROPOSED FLOOR & ROOF PLANS
-	PROPOSED EXTERIOR ELEVATIONS
-	EXTERIOR ELEVATION RENDERING

PERMITS/APPROVALS

	NUMBER	APPROVED	EXPIRES
ROCHESTER PLANNING BOARD SITE PLAN REVIEW & CUP	-	-	-
ROCHESTER CONSERVATION COMMISSION CUP REVIEW	-	-	-
ROCHESTER DPW SEWER DISCHARGE PERMIT	-	-	-
ROCHESTER DPW DRIVEWAY PERMIT	-	-	-
NH FISH & GAME	-	-	-
NHDES ALT. OF TERRAIN	-	-	-
NHDES SHORELAND	-	-	-
NHDES SEWER	-	-	-
NHDES BROWNFIELDS (SOIL MANAGEMENT PLAN, ETC.)	-	-	-
NHDOIT SURPLUS PROPERTY DISPOSAL REQUEST	-	-	-
COP & SWPPP	-	-	-

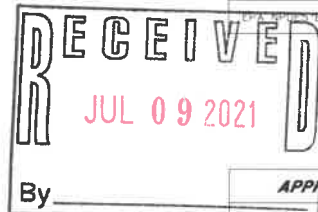

APPROVED BY THE CITY OF ROCHESTER PLANNING BOARD

ON \_\_\_\_\_  
BOARD MEMBER \_\_\_\_\_ AND  
BOARD MEMBER \_\_\_\_\_

SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

COVER

PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH  
OWNED BY & PREPARED FOR  
401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Copyright 2020 ©Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



THESE PLANS ARE PERMIT DRAWINGS ONLY AND HAVE NOT BEEN DETAILED FOR CONSTRUCTION OR BIDDING.

REV	DATE	DESCRIPTION	HEB	CHK
1	7/9/2021	REVISED PER TRG COMMENTS	HEB	CHK

Seacoast Division		Civil Engineers Structural Engineers Traffic Engineers Land Surveyors Landscape Architects Scientists		170 Commerce Way, Suite 102 Portsmouth, NH 03801 Phone (603) 431-2222 Fax (603) 431-0910 www.tfmoran.com	
F	47159.02	DR	HEB	FB	-
L		CK	ORR	CADFILE	47159-02_COVER
E					C-00



**LEGEND**

## ABBREVIATIONS

\_\_\_\_\_

1. THESE PLANS ARE PERMIT DRAWINGS ONLY AND HAVE NOT BEEN DETAIL FOR CONSTRUCTION OF

- 

- 

- 

## TAX MAP 114 LOT 7

### PROPOSED AUTO DEALERSHIP

0 NORTH MAIN STREET, ROCHESTER, NH

Seacoast Division

F	47159.02	DR	HEG	FB	-	0.01
---	----------	----	-----	----	---	------

---

Seacoast Division

**TFM** Traffic Engineers  
Land Surveyors  
Landscape Architects


Phone (603) 431-2222  
Fax (603) 431-0910

47159.02	DR	HEG	FB	—	C-01
	CK	CRR	CADFILE	47159-02 LEGEND-NOTES	





Jul 09, 2021 - 7:53am  
F:\MISC Projects\47159 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\PHOTOGRAPHIC REDUCTION DRAWINGS\47159-02\_NHDES\_Shoreland.dwg

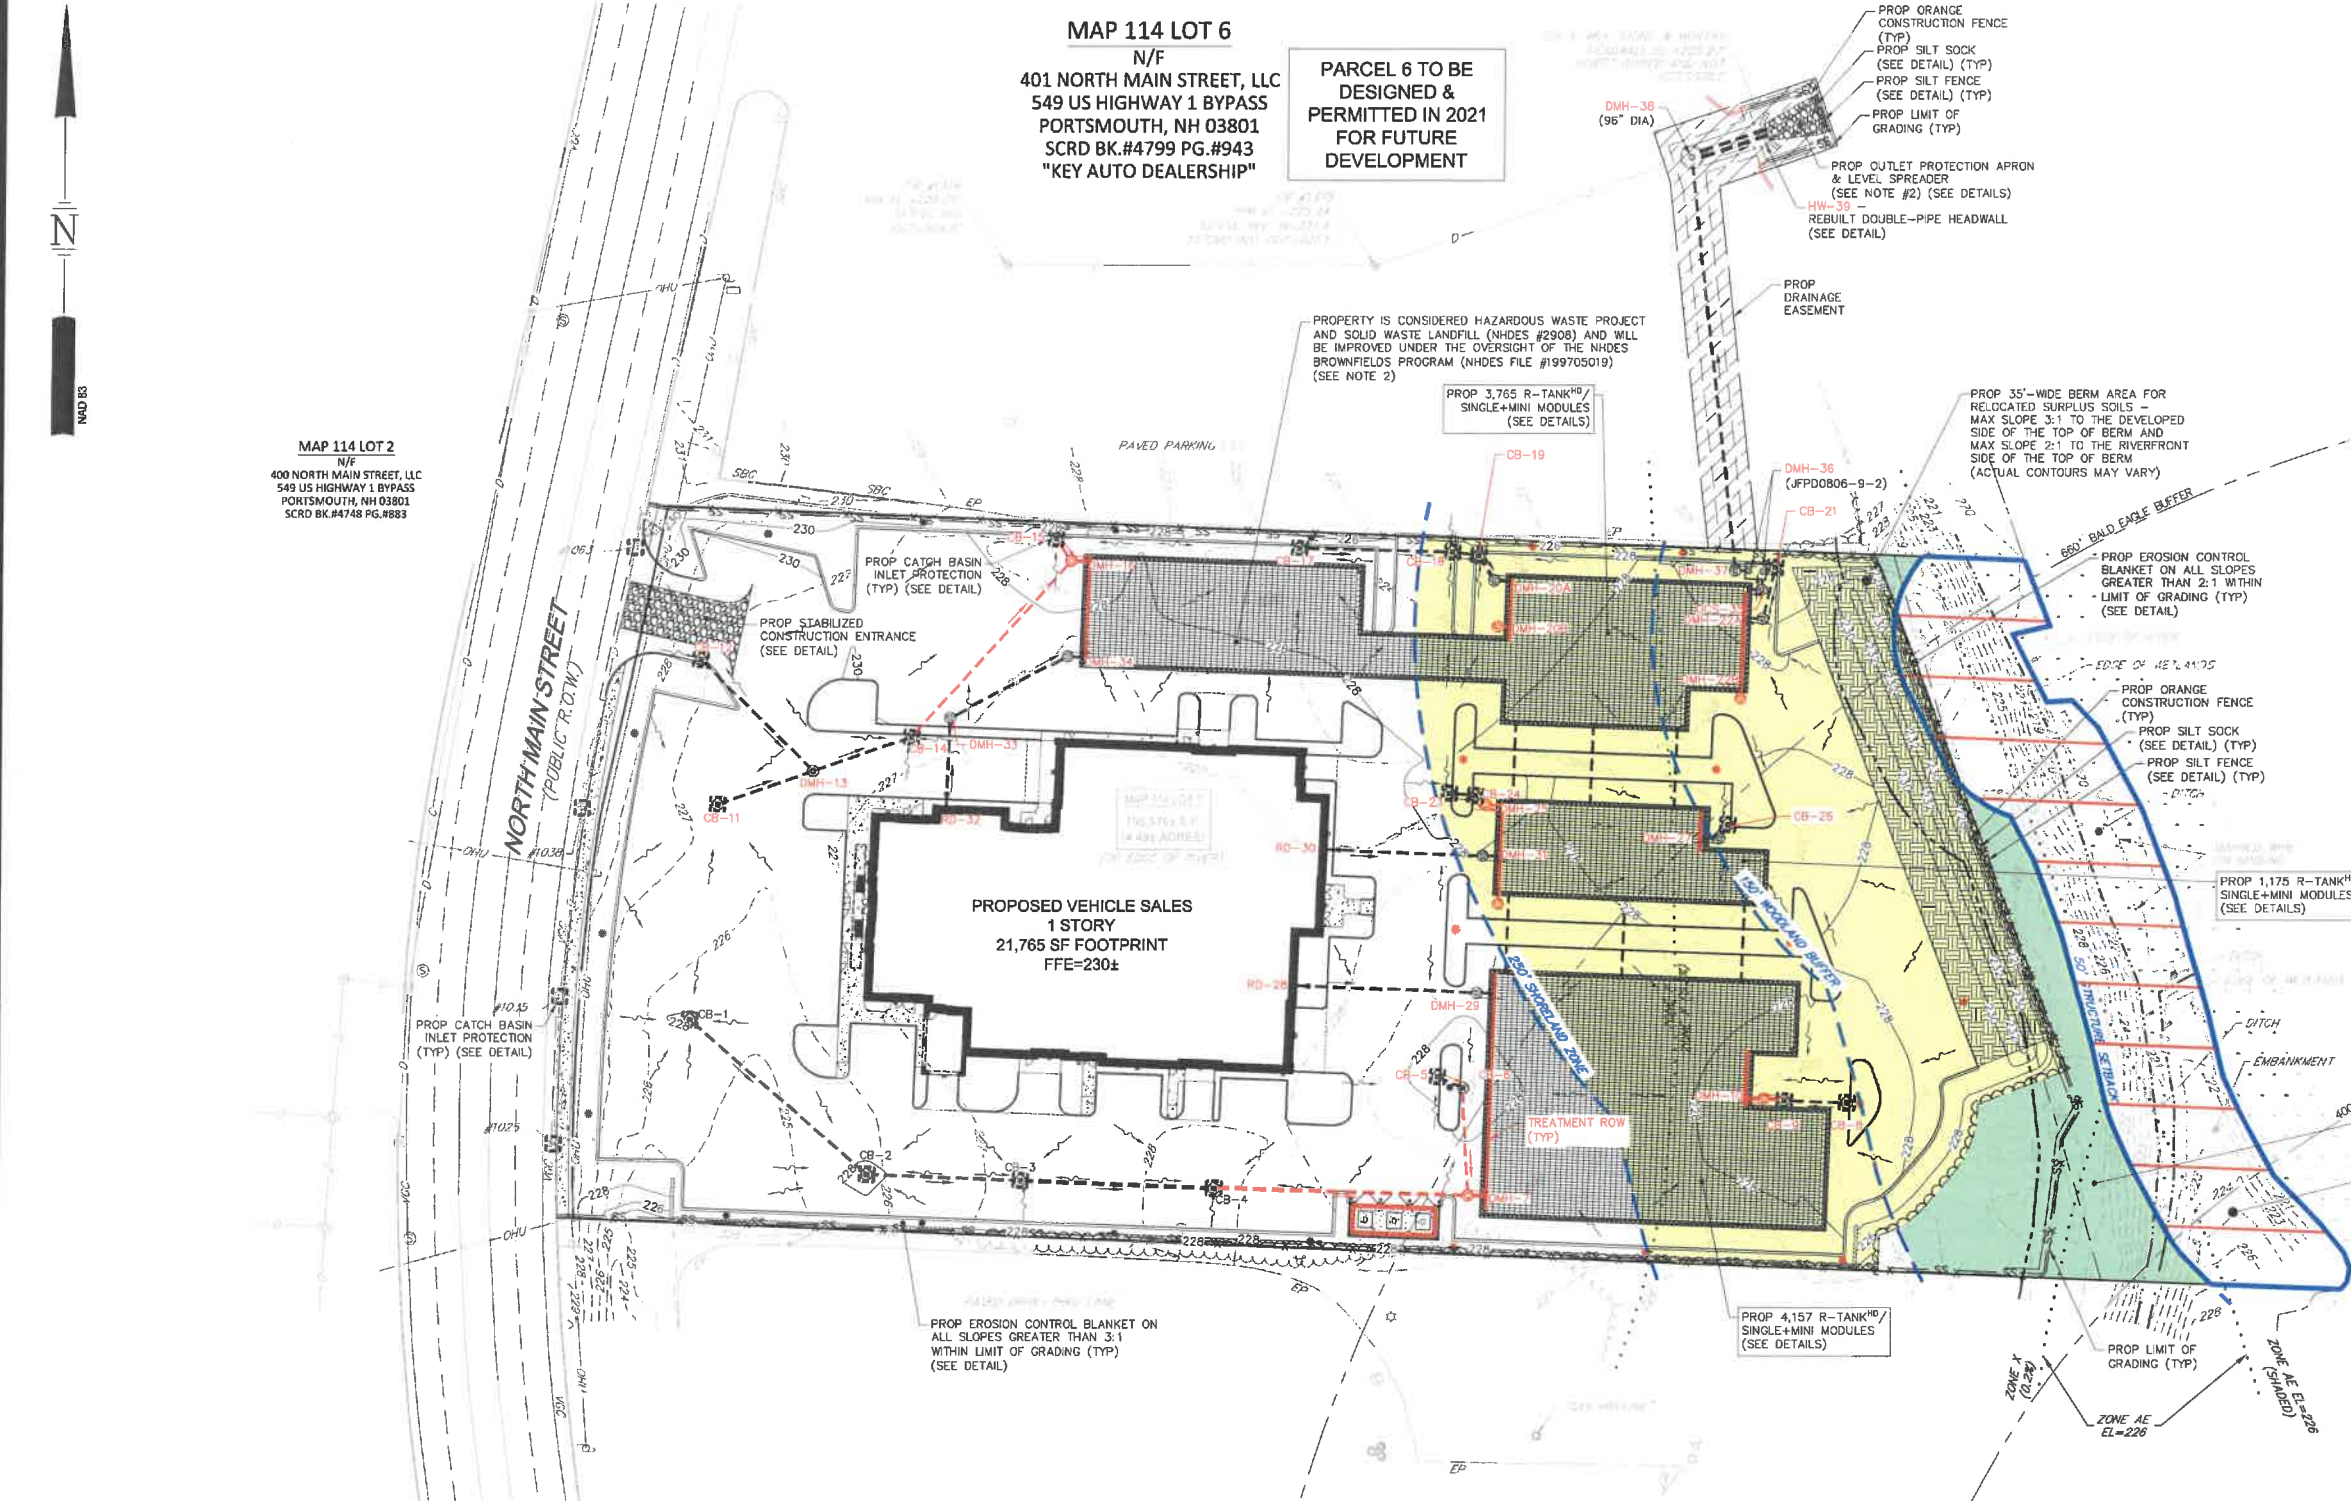

- NOTES**
1. SEE SHEET C-01 FOR NOTES.
- SHORELAND IMPACT AREA
  - AREA OF NATURAL WOODLAND BUFFER TO REMAIN IN AN UNALTERED STATE
  - WATERFRONT BUFFER

8,619 SF NATURAL WOODLAND BUFFER TO REMAIN IN UNALTERED STATE

EACH 25'X50' WATERFRONT BUFFER GRID SEGMENT EXCEEDS 25 POINTS - REFER TO PHOTO EXHIBIT IN NHDES SHORELAND APPLICATION

**SITE DEVELOPMENT PLANS**

TAX MAP 114 LOT 7

**NHDES SHORELAND IMPACT PLAN**

**PROPOSED AUTO DEALERSHIP**

**0 NORTH MAIN STREET, ROCHESTER, NH**

OWNED BY & PREPARED FOR

**401 NORTH MAIN STREET LLC**

**1"=80' (11"X17")**

**SCALE: 1"=40' (22"X34")**

**JUNE 1, 2021**

Seacoast Division

**TFM**

Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

DR HEG FB  
CK CRR CADFILE


47159-02\_NHDES\_SHORELAND

C-02

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



REV	DATE	DESCRIPTION	HEG	CHK
1	7/9/2021	REVISED PER TRC COMMENTS	HEG	CHK



Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



### CONSTRUCTION SEQUENCE NOTES (FOR ALTERATION OF TERRAIN)

- DO NOT DISCHARGE SEDIMENT-LADEN WATERS FROM CONSTRUCTION ACTIVITIES (RUNOFF, WATER FROM EXCAVATIONS) TO THE SUBSURFACE DETENTION BASIN DURING ANY STAGE OF CONSTRUCTION.
- DO NOT PLACE THE SUBSURFACE DETENTION SYSTEM INTO SERVICE UNTIL THE CONTRIBUTING AREAS HAVE BEEN FULLY STABILIZED.

HORIZONTAL SCALE 1"=40'  
40 20 0 40

REV	DATE	DESCRIPTION	DESIGNED	CHECKED
1	7/9/2021	REVISED PER TRC COMMENTS	HES/EMH	DR/CK

<b>Seacoast Division</b>					Civil Engineers Structural Engineers Traffic Engineers Land Surveyors Landscape Architects Scientists	170 Commerce Way, Suite 102 Portsmouth, NH 03801 Phone (603) 431-2222 Fax (603) 431-0910 <a href="http://www.tfmoran.com">www.tfmoran.com</a>
						
F or m	47159.02		DR	HEG	FB	-
			CK	CRR	CADFILE	47159-02_SITE PREP
						C-03

### NOTES

- SEE SHEET C-01 FOR NOTES.
- THE CONTRACTOR MUST BE QUALIFIED TO WORK WITH HAZARDOUS MATERIAL. SOIL AND MATERIALS FOUND WITHIN THE SOIL MAY NOT BE TRANSPORTED OFF-SITE. ALL WORK MUST BE PERFORMED IN ACCORDANCE WITH THE SOIL MANAGEMENT PLAN AND OTHER DOCUMENTS RELATIVE TO THE NHDES FILE #199705019 UNDER THE BROWNFIELDS COVENANT PROGRAM AND ALL OTHER PERMITS AND APPROVALS. THE SOIL MANAGEMENT PLAN MUST BE APPROVED PRIOR TO EARTHWORK.
- MONITORING WELLS SHALL BE DECOMMISSIONED AND RELOCATED IN COMPLIANCE WITH NHDES REGULATIONS AND GUIDANCE PER NHDES FILE #199705019 UNDER THE BROWNFIELDS COVENANT PROGRAM. COORDINATE WITH NHDES, GEOINSIGHT, ENSAFE, TFMORAN, AND PROPERTY OWNER.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING AND DETERMINING THE LOCATIONS, SIZE, AND ELEVATIONS OF ALL EXISTING UTILITIES, SHOWN OR NOT SHOWN ON THESE PLANS PRIOR TO THE START OF ANY DEMOLITION. THE LOCATIONS SHOWN ON THESE PLANS ARE NOT GUARANTEED BY THE OWNER OR THE ENGINEER. THE ENGINEER SHALL BE NOTIFIED IN WRITING OF ANY UTILITIES INTERFERING WITH THE PROPOSED DEMOLITION TO DETERMINE APPROPRIATE ACTION TO BE TAKEN BEFORE PROCEEDING WITH THE WORK. IT IS ALSO THE CONTRACTOR'S RESPONSIBILITY TO ANTICIPATE CONFLICTS AND REPAIR EXISTING UTILITIES AS NECESSARY TO COMPLETE THE WORK AT NO ADDITIONAL COST TO THE OWNER.
- THE CONTRACTOR SHALL MAINTAIN EMERGENCY ACCESS TO ALL AREAS AFFECTED BY WORK AT ALL TIMES.
- THE CONTRACTOR SHALL VERIFY ALL SURVEY INFORMATION IN THE FIELD AND REPORT ANY DISCREPANCIES TO THE ENGINEER PRIOR TO THE START OF CONSTRUCTION.
- EXISTING UTILITY SERVICES TO BE DISCONTINUED ARE TO BE CAPPED AS REQUIRED BY THE RESPECTIVE UTILITY COMPANIES.
- CONSTRUCTION DEBRIS AND INVASIVE SPECIES SHALL BE REMOVED FROM SITE AND DISPOSED OF IN A LEGAL MANNER.
- PRIOR TO THE START OF WORK, THE CONTRACTOR SHALL PLACE ORANGE CONSTRUCTION FENCING AROUND EACH TREE TO BE RETAINED THROUGHOUT CONSTRUCTION. NO STOCKPILES OF MATERIAL ARE PERMITTED WITHIN THE DRIP LINE OF THE TREES TO BE SAVED.
- CONTACT THE LANDSCAPE ARCHITECT IMMEDIATELY IF ANY TREES ARE DAMAGED DURING CONSTRUCTION.

### CONSTRUCTION SEQUENCE NOTES

TO MINIMIZE EROSION AND SEDIMENTATION DUE TO CONSTRUCTION, CONSTRUCTION SHALL FOLLOW THIS GENERAL CONSTRUCTION SEQUENCE AND SWPPP, IF APPLICABLE.

MODIFICATIONS TO THE SEQUENCE NECESSARY DUE TO THE CONTRACTOR'S SCHEDULE SHALL INCLUDE APPROPRIATE TEMPORARY AND PERMANENT EROSION AND SEDIMENTATION CONTROL MEASURES.

THE CONTRACTOR SHALL SCHEDULE WORK SUCH THAT ANY CONSTRUCTION AREA IS STABILIZED WITHIN 45 DAYS OF INITIAL DISTURBANCE EXCEPT AS NOTED BELOW. NO MORE THAN 5 ACRES OF DISTURBED LAND SHALL BE UNSTABILIZED AT ANY ONE TIME.

THE PROJECT SHALL BE MANAGED SO THAT IT MEETS THE REQUIREMENTS AND INTENT OF RSA 430:53 AND CHAPTER ARG 3800 RELATIVE TO INVASIVE SPECIES.

DO NOT TRAFFIC EXPOSED SOIL SURFACE OF INFILTRATION SYSTEMS WITH CONSTRUCTION EQUIPMENT. IF FEASIBLE, PERFORM EXCAVATIONS WITH EQUIPMENT POSITIONED OUTSIDE THE LIMITS OF THE INFILTRATION COMPONENTS OF THE SYSTEM.

DO NOT DISCHARGE SEDIMENT-LADEN WATERS FROM CONSTRUCTION ACTIVITIES (RUNOFF, WATER FROM EXCAVATIONS) TO THE STORMWATER SYSTEM. STORMWATER RUNOFF MUST BE DIRECTED TO TEMPORARY PRACTICES UNTIL STORMWATER BMP'S ARE STABILIZED.

DO NOT PLACE STORMWATER SYSTEM INTO SERVICE UNTIL THE CONTRIBUTING AREAS HAVE BEEN FULLY STABILIZED.

- NOTIFY EASEMENT OWNERS PRIOR TO COMMENCEMENT OF WORK.
- INSTALL ALL PERIMETER EROSION PROTECTION MEASURES AS INDICATED ON THE PLANS PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
- PONDS AND SWALES SHALL BE INSTALLED BEFORE ROUGH GRADING THE SITE.
- DURING CONSTRUCTION EVERY EFFORT SHALL BE MADE TO MANAGE SURFACE RUNOFF QUALITY. DAILY, OR AS REQUIRED, CONSTRUCT TEMPORARY BERMS, DRAINS, DITCHES, SILT BARRIERS, SEDIMENT TRAPS, ETC. MULCH AND SEED AS REQUIRED. (TEMPORARY SEED MIXTURE OF WINTER RYE APPLIED AT A RATE OF 2.5 LBS/1000 SF SHALL BE USED).
- CONDUCT MAJOR EARTHWORK, INCLUDING CLEARING AND GRUBBING, WITHIN THE LIMITS OF WORK. ALL CUT AND FILL SLOPES SHALL BE SEED WITHIN 72 HOURS AFTER GRADING.
- ALL STRIPPED TOPSOIL AND OTHER EARTH MATERIALS SHALL BE STOCKPILED OUTSIDE THE IMMEDIATE WORK AND WETLAND AREAS. A SILT BARRIER SHALL BE CONSTRUCTED AROUND THESE PILES IN A MANNER TO PROVIDE ACCESS AND AVOID SEDIMENT OUTSIDE OF THE WORK AREA.
- CONSTRUCT BUILDING PAD AND COMMENCE NEW BUILDING CONSTRUCTION.
- CONSTRUCT TEMPORARY CULVERTS AND DIVERSIONS AS REQUIRED.
- BEGIN PERMANENT AND TEMPORARY INSTALLATION OF SEED AND MULCH.
- PERFORM EARTHWORK NECESSARY TO ESTABLISH ROUGH GRADING AROUND PARKING FIELDS AND ACCESS DRIVES. MANAGE EXPOSED SOIL SURFACES TO AVOID TRANSPORTING SEDIMENTS INTO WETLANDS. PARKING LOTS SHALL BE STABILIZED WITHIN 72 HOURS OF ACHIEVING FINISHED GRADE.
- INSTALL SUBSURFACE UTILITIES (WATER, SEWER, GAS, ELECTRIC, COMMUNICATIONS, DRAINAGE, DRAINAGE FACILITIES, ETC.).
- CONSTRUCT PROPOSED ROADWAY, RAIN GARDENS, GRAVEL WETLANDS AND DRAINAGE SWALES. ALL DITCHES, SWALES, AND GRAVEL WETLANDS SHALL BE FULLY STABILIZED PRIOR TO DIRECTING FLOW TO THEM.
- COMPLETE BUILDING AND ALL OFF-SITE IMPROVEMENTS.
- COMPLETE SEEDING AND MULCHING. SEED TO BE APPLIED WITH BROADCAST SPREADER OR BY HYDRO-SEEDING, THEN ROLLED, RAKED, OR DRAGGED TO ASSURE SEED/SOIL CONTACT.
- REMOVE TEMPORARY EROSION CONTROL MEASURES AFTER SEEDING AREAS HAVE BECOME FIRMLY ESTABLISHED AND SITE IMPROVEMENTS ARE COMPLETE.
- DURING THE COURSE OF THE WORK AND UPON COMPLETION, THE CONTRACTOR SHALL REMOVE ALL SEDIMENT DEPOSITS, EITHER ON OR OFF SITE, INCLUDING CATCH BASINS, AND SUMPS, DRAIN PIPES AND DITCHES, CURB LINES, ALONG SILT BARRIERS, ETC. RESULTING FROM SOIL AND/OR CONSTRUCTION OPERATIONS.
- SEE WINTER CONSTRUCTION SEQUENCE FOR WORK CONDUCTED AFTER OCTOBER 15TH.

### SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

#### SITE PREPARATION & DEMOLITION PLAN

#### PROPOSED AUTO DEALERSHIP

0 NORTH MAIN STREET, ROCHESTER, NH

OWNED BY & PREPARED FOR


401 NORTH MAIN STREET LLC

1"=80' (11"X17')

SCALE: 1"=40' (22"X34')

JUNE 1, 2021



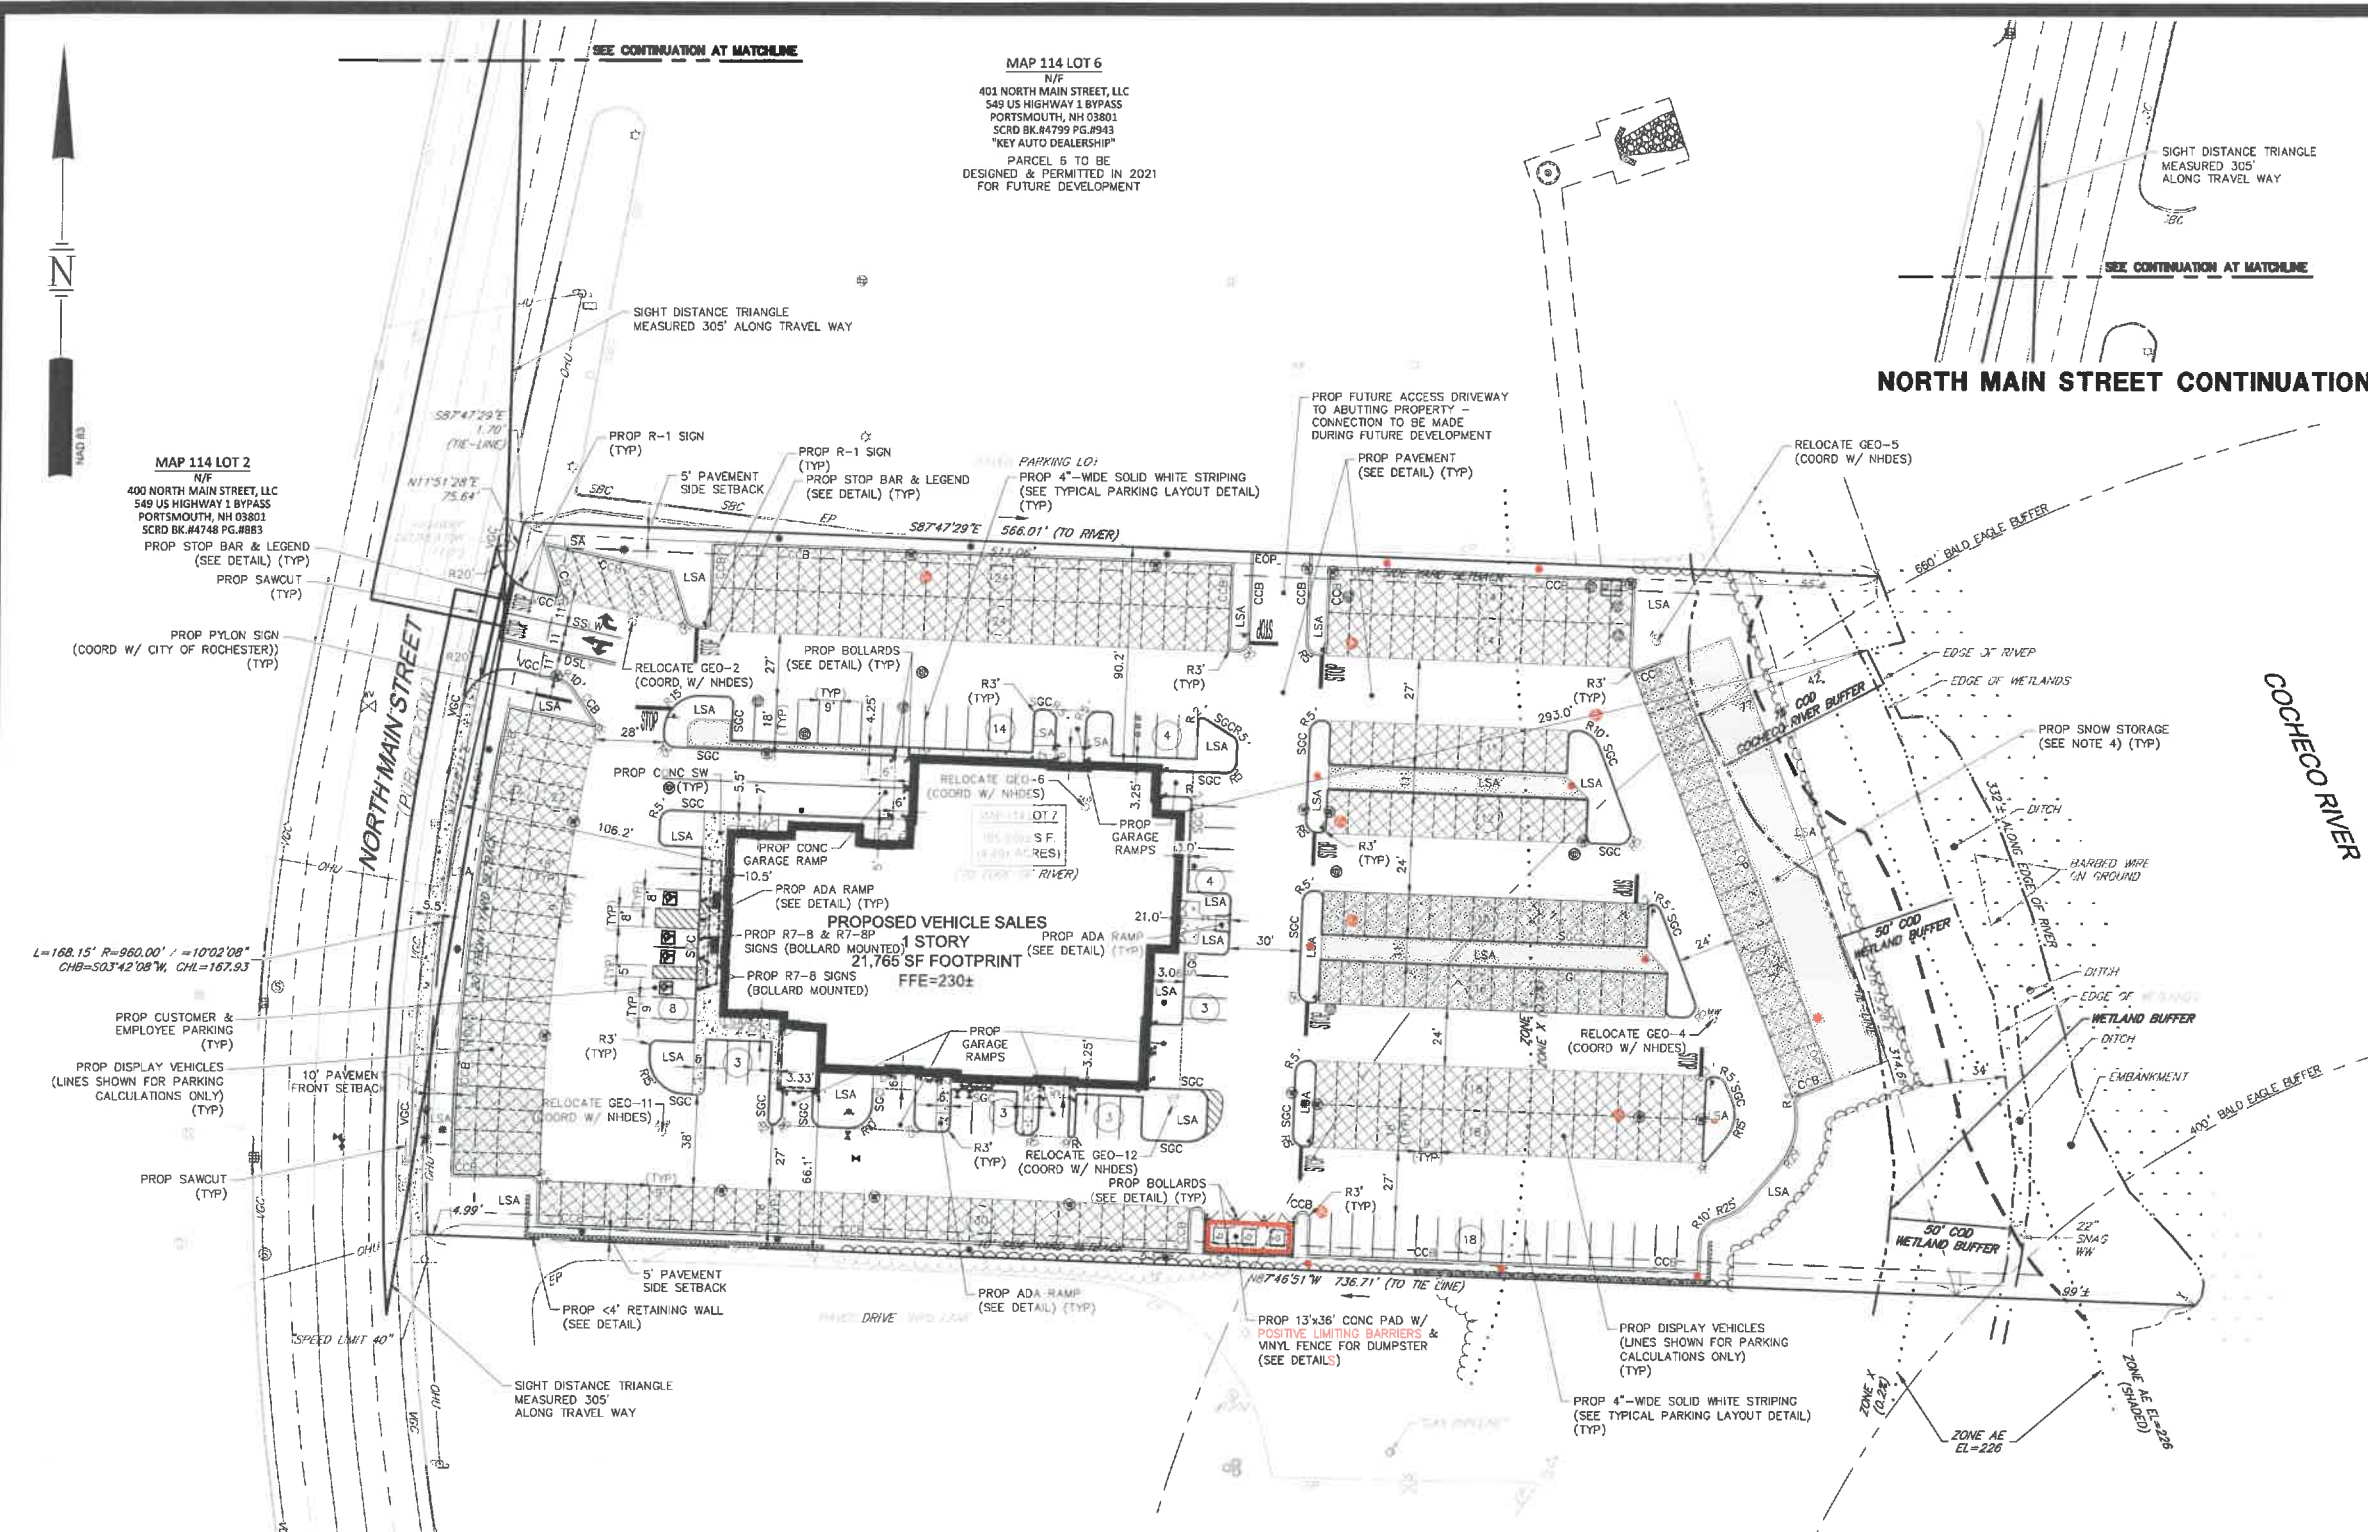

SITE DATA		
OWNER OF RECORD OF MAP 114 LOT 7: 401 NORTH MAIN STREET, LLC 549 US HIGHWAY 1 BYPASS PORTSMOUTH, NH 03801		
DEED REFERENCE TO PARCEL IS BK 4799 PG 945 AREA OF PARCEL = 195,576± SF OR 4.49± ACRES		
ZONED: HIGHWAY COMMERCIAL (HC) CONSERVATION OVERLAY DISTRICT (COD) (PORTION ONLY) SHORELAND QUALITY PROTECTION ZONE (PORTION ONLY)		
EXISTING USE: VACANT PROPOSED USE: VEHICLE SALES (NEW & USED)		
THE PURPOSE OF THIS PLAN IS TO CONSTRUCT A PROPOSED AUTO DEALERSHIP WITH A 1-STORY BUILDING UPON A VACANT LOT. ASSOCIATED IMPROVEMENTS INCLUDE AND ARE NOT LIMITED TO ACCESS, GRADING, STORMWATER MANAGEMENT SYSTEMS, UTILITIES, LIGHTING, AND LANDSCAPING. THE PROPERTY IS IN THE LOCATION OF A FORMER CITY LANDFILL CLOSED AND CLASSIFIED AS NON-OPERATING UNLINED LANDFILL. THE SITE IS FILED WITH NHDES AS HAZARDOUS WASTE PROJECT AND SOLID WASTE LANDFILL (#2908) AND WILL BE IMPROVED UNDER THE OVERSIGHT OF THE NHDES BROWNFIELDS PROGRAM (NHDES FILE #199705019).		
DIMENSIONAL REQUIREMENTS (CURRENT ZONING)		
MINIMUM LOT DIMENSIONS:	REQUIRED:	PROVIDED:
LOT AREA	20,000 SF	195,576± SF
LOT FRONTAGE	100 FT	300.6± FT
MINIMUM YARD DIMENSIONS:		
FRONT	20 FT	106.2 FT
SIDE	10 FT	66.1 FT
REAR	25 FT	293.0 FT
MAXIMUM STRUCTURE DIMENSIONS:		
STRUCTURE STORIES	3 STORIES	1 STORY
MINIMUM SETBACKS/BUFFER:		
PAVEMENT FRONT	10 FT	10 FT
PAVEMENT SIDE	5 FT	5 FT
PAVEMENT REAR	10 FT	77 FT
MAXIMUM LOT COVERAGE	85%	71.2%
SNOW STORAGE REQUIREMENTS		
SNOW STORAGE (SEE CALCULATION)	3,466 SF - 6,936 SF	18,394 SF (7,236 SF OFF-PAVEMENT)
PARKING REQUIREMENTS		
PARKING SPACES (SEE CALCULATION)	80 SPACES	60 SPACES (CUSTOMER/ EMPLOYEE)
ACCESSIBLE SPACES (REQ'D BY ADA)	4 SPACES (1 VAN SPACE)	286 SPACES (DISPLAY)
PARKING SPACE SIZE	9 FT X 18 FT	4 SPACES (2 VAN SPACES)
ASILE WIDTH (BETWEEN PARKING)	24 FT	9 FT X 17 FT
PARKING CALCULATIONS		
REQUIRED PARKING RATIO:		
INTERIOR MOTOR VEHICLE SALE/RENTAL:	1.5 SPACES / 1,000 GROSS SF	
EXTERIOR DISPLAY SPACES:	1 SPACE / 15 EXTERIOR DISPLAY	
MOTOR VEHICLE SERVICE BAYS:	4 SPACES / SERVICE BAY	
TOTAL PARKING SPACES REQUIRED:		
9,666 GROSS SF * 1.5 SPACE / 1,000 GROSS SF		= 14 SPACES +
266 EXTERIOR DISPLAY SPACES * 1 SPACE / 15 SPACES		= 18 SPACES +
12 SERVICE BAYS * 4 SPACES / SERVICE BAY		= 48 SPACES
TOTAL		= 80 SPACES
SNOW STORAGE CALCULATIONS		
REQUIRED PARKING RATIO:		
1 SF OF STORAGE AREA / 5 SF TO 10 SF OF CLEARING AREA		
TOTAL SNOW STORAGE REQUIRED		
34,652 SF CLEARING AREA X 1 SF / (5 SF TO 10 SF)		= 3,466 SF TO 6,931 SF

- NOTES**
- SEE SHEET C-04 FOR NOTES.
  - ALL DIMENSIONS ARE TO THE FACE OF CURB UNLESS NOTED OTHERWISE.
  - LIGHTING, SIGNAGE, LANDSCAPING, AND SCREENING SHALL MEET THE REQUIREMENTS OF THE CITY ZONING ORDINANCE AND SITE PLAN REGULATIONS.
  - SNOW SHALL NOT BE STOCKPILED OVER CATCH BASIN OR IN WETLANDS. SEE SNOW STORAGE LOCATIONS ON THE PLAN. SNOW STORAGE LOCATIONS ON PAVEMENT SHOULD BE USED ONLY IF NO OTHER SPACE IS AVAILABLE. IN THE EVENT THAT THE SNOW STORAGE AREAS PROVIDED ON THE SITE ARE COMPLETELY UTILIZED, EXCESS SNOW SHALL BE TRANSPORTED OFF SITE FOR DISPOSAL IN ACCORDANCE WITH NHDES REGULATION. IF SNOW IS STORED WITHIN PARKING AREA, KEEP CATCH BASINS CLEAR. ONLY NO SALT (SUCH AS DEICING ALTERNATIVES) OR LOW SALT APPLICATIONS ARE PERMITTED ON PARKING AREAS. SALT OR OTHER DEICING MATERIAL STORAGE MUST BE IN ACCORDANCE WITH NHDES AND CITY OF ROCHESTER REGULATIONS.

HEAVY DUTY PAVEMENT

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR

DATE

DESCRIPTION

DR

CK

47159-02\_Site

C-04

47159.02

DR

HEG

FB

CK

CRR

CADFILE

7/9/2021

REVISED PER TPO COMMENTS

HEG/CRR



Jul 09, 2021 - 7:44am  
F:\MISC Projects\47159 - North Main St - Rochester\47159-02 - C-05 North Main Street - AUTO DEALERSHIP\PRODUCTION DRAWINGS\47159-02\_Gradin.dwg

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



**MAP 114 LOT 2**  
N/E  
400 NORTH MAIN STREET, LLC  
549 US HIGHWAY 1 BYPASS  
PORTSMOUTH, NH 03801  
SCRD BK. #4748 PG. #883

**MAP 114 LOT 6**  
N/E  
401 NORTH MAIN STREET, LLC  
549 US HIGHWAY 1 BYPASS  
PORTSMOUTH, NH 03801  
SCRD BK. #4799 PG. #943  
"KEY AUTO DEALERSHIP"  
PARCEL 6 TO BE  
DESIGNED & PERMITTED IN 2021  
FOR FUTURE DEVELOPMENT

**MAP 114 LOT 8**  
N/E  
MAINLY ROCHESTER PIZZA, LLC  
P.O. BOX 66749  
FALMOUTH, ME 04105  
SCRD BK. #2425 PG. #804  
"DUNKIN' DONUTS"

## NOTES

- SEE SHEET C-01 FOR NOTES.
- THE STORMWATER SYSTEM HAS BEEN DESIGNED TO TIE INTO THE EXISTING STORMWATER SYSTEM ON PARCEL 6 AND DISCHARGE VIA A REBUILT HEADWALL. PRIOR TO INSTALLATION AND ORDERING MATERIALS, CONFIRM WITH THE ENGINEER THAT THE STORMWATER SYSTEM'S SIZING AND CONFIGURATION IS APPROPRIATE, BASED ON SURVEY, DESIGN, AND PERMITTING OF PARCEL 6.
- ALL DOORS AND GARAGE ENTRANCES SHALL BE AT FINISHED FLOOR ELEVATION UNLESS OTHERWISE NOTED.
- PROPOSED SPOT GRADES ARE PROVIDED TO THE NEAREST 0.05. THE CONTRACTOR, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE FINISHED GRADES MEET ADA STANDARDS FOR WHEEL CHAIR RAMPS, HANDICAP SPACES AND ACCESS AISLES, CROSSWALKS, SIDEWALKS, ETC.
- LENGTH OF PIPE AND PIPE SLOPE IS FOR CONVENIENCE ONLY. ACTUAL PIPE LENGTH SHALL BE DETERMINED IN THE FIELD.
- ALL PROPOSED DRAINAGE PIPES SHALL BE 12" AND HDPE, UNLESS OTHERWISE NOTED ON THE PLAN.
- DRAINAGE PIPES WITH LESS THAN 3' COVER SHALL BE INSULATED (SEE UTILITY TRENCH DETAIL) AND DRAINAGE CATCH BASINS WITH LESS THAN 3.5' OF COVER OVER INVERTS SHALL USE SLAB TOP CATCH BASIN (SEE DETAILS).

## DRAINAGE STRUCTURE TABLE

CB-1 (SLAB-TOP) RIM=227.95± INV=224.50 (OUT) SUMP=220.50	CB-14 (SLAB TOP) RIM=228.1± INV=223.70 (IN) INV=223.60 (OUT) SUMP=219.60	CB-26 RIM=226.15± INV=222.40 (OUT)
CB-2 (SLAB-TOP) RIM=227.85± INV=224.00 (IN) INV=223.90 (OUT) SUMP=219.90	CB-15 RIM=227.25± INV=222.75 (OUT) SUMP=218.75	DMH-27 RIM=226.3± INV=222.30 (IN) INV=222.20 (OUT) SUMP=221.20
CB-3 (SLAB TOP) RIM=228.00± INV=223.55 (IN) INV=223.45 (OUT) SUMP=219.45	DMH-16 RIM=227.5± INV=222.65 (CB-14) INV=222.65 (CB-15) INV=222.20 (OUT) SUMP=221.20	DMH-29 RIM=228.3± INV=223.85 (IN) INV=222.20 (OUT) SUMP=221.20
CB-4 RIM=228.15± INV=223.05 (IN) INV=222.95 (OUT) SUMP=218.95	CB-17 (SLAB TOP) RIM=228.00± INV=222.90 (OUT) SUMP=218.90	RD-30 INV=225.30 (OUT)
CB-5 RIM=227.65± INV=222.90 (OUT) SUMP=218.90	CB-18 (SLAB TOP) RIM=226.00± INV=222.55 (IN) INV=222.45 (OUT) SUMP=218.45	DMH-31 RIM=228.1± INV=224.05 (IN) INV=222.20 (OUT) SUMP=221.20
CB-6 RIM=227.25± INV=222.75 (IN) INV=222.65 (OUT) SUMP=218.65	CB-19 (SLAB TOP) RIM=226.00± INV=222.40 (IN) INV=222.30 (OUT) SUMP=218.30	DMH-33 RIM=229.7± INV=224.60 (IN) INV=224.50 (OUT)
DMH-7 RIM=228.8± INV=222.40 (CB-4) INV=222.40 (CB-6) INV=222.20 (OUT) SUMP=221.20	DMH-20A RIM=226.40± INV=222.25 (IN) INV=222.20 (OUT) SUMP=221.20	DMH-34 RIM=228.5± INV=222.45 (IN) INV=222.20 (OUT) SUMP=221.20
CB-8 (SLAB TOP) RIM=226.65± INV=222.75 (OUT) SUMP=218.75	DMH-20B RIM=227.1± INV=222.20 (OUT) SUMP=221.20	CCS-35 RIM=227.2± INV=220.20 (IN) INV=222.20 (0.5" ORIFICE) INV=223.30 (1" ORIFICE) INV=224.05 (6" ORIFICE) INV=224.35 (3" ORIFICE) INV=224.80 (18" ORIFICE - HORIZONTAL) INV=220.20 (OUT)
CB-9 (SLAB TOP) RIM=226.90± INV=222.50 (IN) INV=222.40 (OUT) SUMP=218.40	CB-21 RIM=226.85± INV=222.50 (OUT) SUMP=218.50	DMH-36 (JFPD0806-9-2) RIMS=227.0± INV=222.15 (IN) INV=221.65 (OUT)
DMH-10 RIM=227.1± INV=222.35 (IN) INV=222.20 (OUT) SUMP=221.20	DMH-22A RIM=227.50± INV=222.30 (IN) INV=222.20 (OUT) SUMP=221.20	DMH-37 RIM=227.3± INV=221.60 (IN) INV=221.50 (OUT)
CB-11 (SLAB TOP) RIM=228.00± INV=224.55 (OUT) SUMP=220.55	DMH-22B RIM=228.4± INV=222.20 (OUT) SUMP=221.20	DMH-38 (96" DIA) RIM=TD± INV=220.35 (IN) INV=220.20 (OUT)
CB-12 (SLAB TOP) RIM=228.3± INV=224.80 (OUT) SUMP=220.80	CB-23 RIM=227.45± INV=223.40 (OUT) SUMP=219.40	HW-39 INV=220.2±
DMH-13 RIM=229.2± INV=224.20 (DMH-12) INV=224.20 (DMH-13) INV=224.10 (OUT)	DMH-25 RIM=227.4± INV=223.1 (IN) INV=222.20 (OUT) SUMP=221.20	

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7  
**GRADING & DRAINAGE PLAN**  
**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**  
OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

1"=80' (11"X17")  
SCALE: 1"=40' (22"X34")

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

DR HEG FB  
CK CR CADFILE 47159-02\_GRADING


C-05

REV	DATE	DESCRIPTION	DR	CK
1	7/9/2021	REVISED PER TRC COMMENTS	HEG	FB

HORIZONTAL SCALE 1"=40'



Jul 09, 2021 - 7:56am  
F:\MSC Projects\47159 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\Design\PRODUCTION DRAWINGS\47159-02 - Utility.dwg

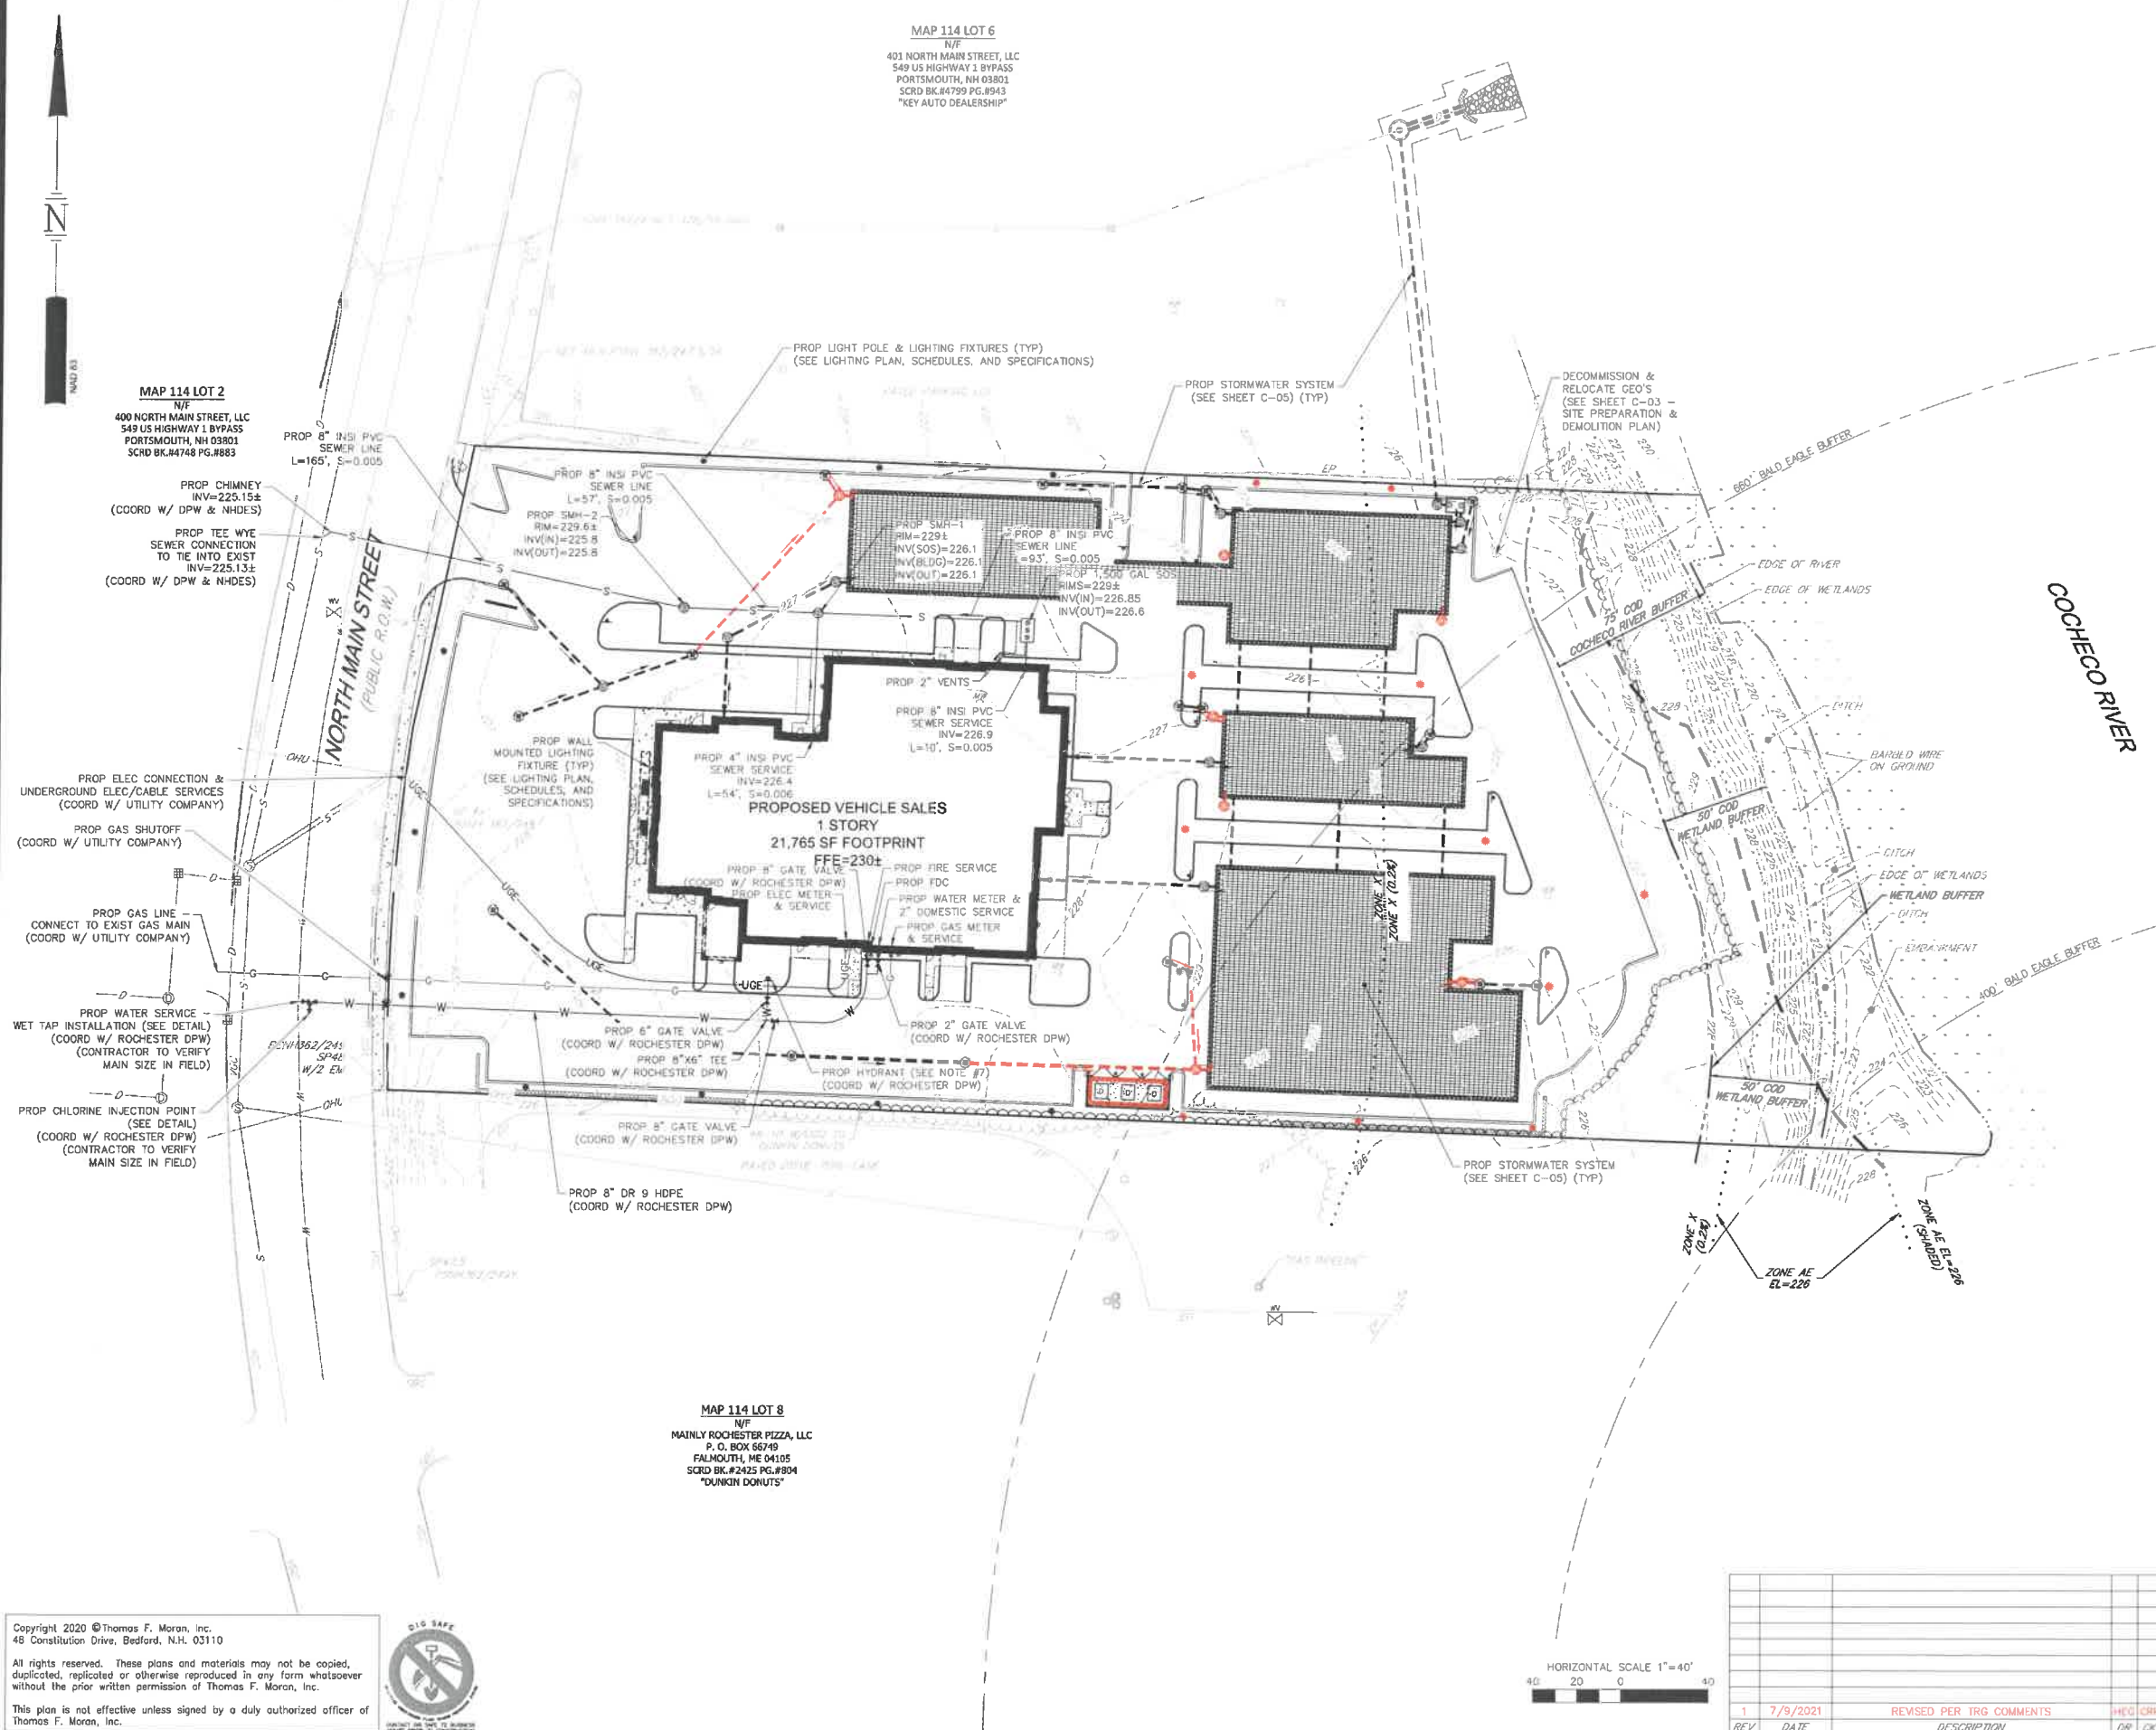

- ### NOTES
1. SEE SHEET C-01 FOR NOTES.
  2. ALL PROPOSED UTILITIES SHALL CONFORM TO THE CITY OF ROCHESTER'S STANDARDS OF INFRASTRUCTURE DESIGN.
  3. APPROPRIATE PERMITS AND APPROVALS FOR LAWFUL INSTALLATION AND OPERATION OF ABOVE GROUND PETROLEUM STORAGE TANKS (I.E. FUEL TANK, DIESEL GENERATOR, ETC.) MUST BE OBTAINED AND MAINTAINED PRIOR TO CONSTRUCTION AND OPERATION. ANY REQUIRED MODIFICATIONS TO THE SITE CONDITIONS MUST BE COORDINATED WITH THE ENGINEER OF RECORD.
  4. WATER AND DRAIN LINE CROSSINGS REQUIRE INSTALLATION OF RIGID INSULATION WHEN SEPARATION BETWEEN LINES IS LESS THAN 18". SEE UTILITY TRENCH DETAIL.
  5. A RED/WHITE STRIPED FIBERGLASS HYDRANT MARKER PILE WITH FLEXIBLE CONNECTION SHALL BE ATTACHED TO EACH NEW HYDRANT IN ORDER THAT THE HYDRANT CAN BE READILY LOCATED WHEN SNOW IS ON THE GROUND, PER CITY OF ROCHESTER REGULATIONS.
  6. CONTRACTOR IS REQUIRED TO LOCATE AND PROTECT MONITORING WELLS. ANY MODIFICATIONS TO EXISTING MONITORING WELLS SHALL BE DOCUMENTED WITH THE NHDES WITH COPY TO THE CITY.
  7. WATER SUPPLY CALCULATIONS MUST BE PROVIDED TO THE CITY OF ROCHESTER BUILDING DEPARTMENT PRIOR TO CONSTRUCTION. WATER SUPPLY REQUIREMENTS MUST BE EVALUATED AND IT SHOULD BE DETERMINED IF AND WHERE ADDITIONAL FIRE HYDRANTS MUST BE REQUIRED ON SITE.

### SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7  
**UTILITY PLAN**  
**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**  
OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

**1"=80' (11"X17")**  
**SCALE: 1"=40' (22"X34")** **JUNE 1, 2021**

**Seacoast Division**  
**TFM**

Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02	DR	HEG	FB	—	47159-02-UTILITY	C-06
	CK	ORR	CADFILE			

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.


This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.




REV	DATE	DESCRIPTION	BY	CHK
1	7/9/2021	REVISED PER TRG COMMENTS	HEG	ORR



Jul 09, 2021 - 7:55am  
F:\MISC Projects\47159 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\Design\PRODUCTION DRAWINGS\47159-02 - Profile - sewer.dwg

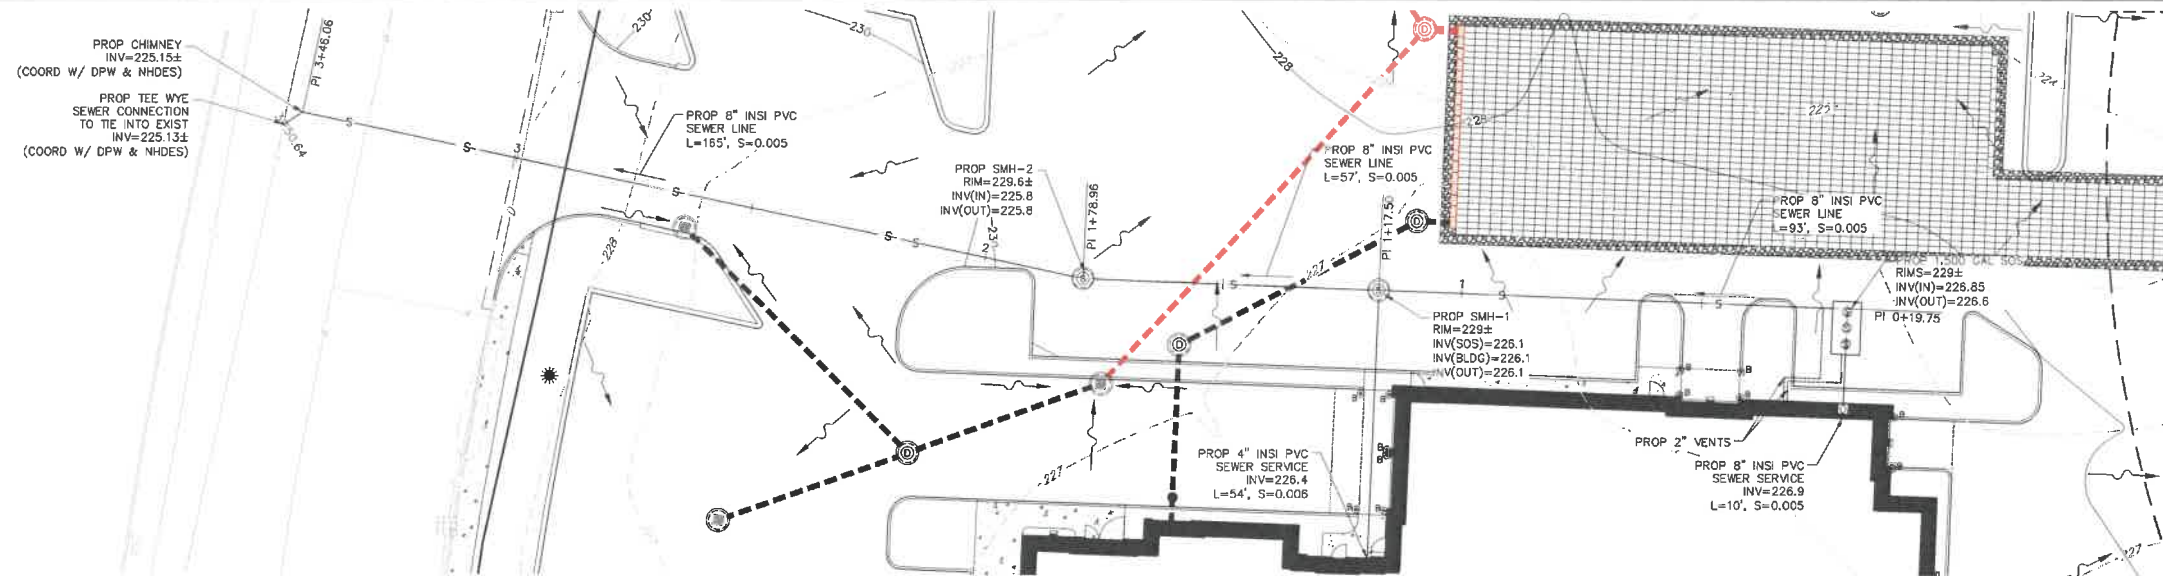

PLAN

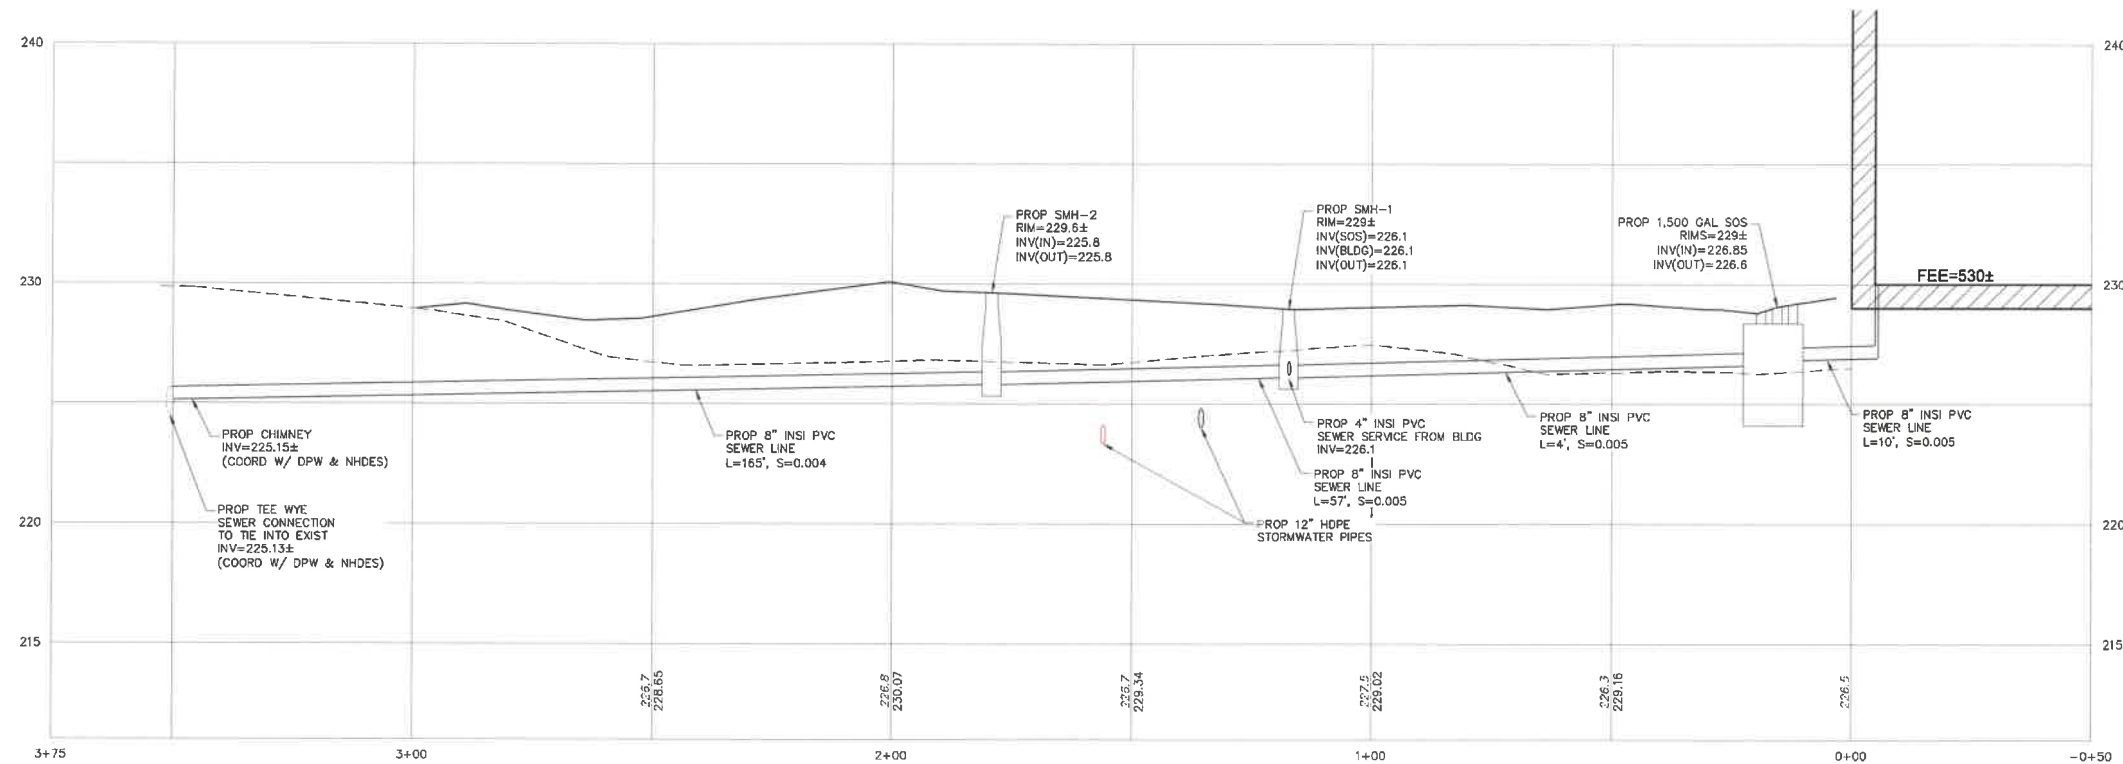

PROFILE

## NOTES

1. SEE SHEET C-01 FOR NOTES.

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

### SEWER PROFILE

**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**

OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

1"=40' (11"X17")  
SCALE: 1"=20' (22"X34")

JUNE 1, 2021

Seacoast Division




Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

Copyright 2020 ©Thomas F. Moran, Inc.  
46 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



REV	DATE	DESCRIPTION	HEG	CHK
1	7/9/2021	REVISED PER TRG COMMENTS	HEG	CHK

47159.02


DR HEG  
CK CRR

FB  
CADD FILE

47159-02\_PROFILE\_SEWER

C-07



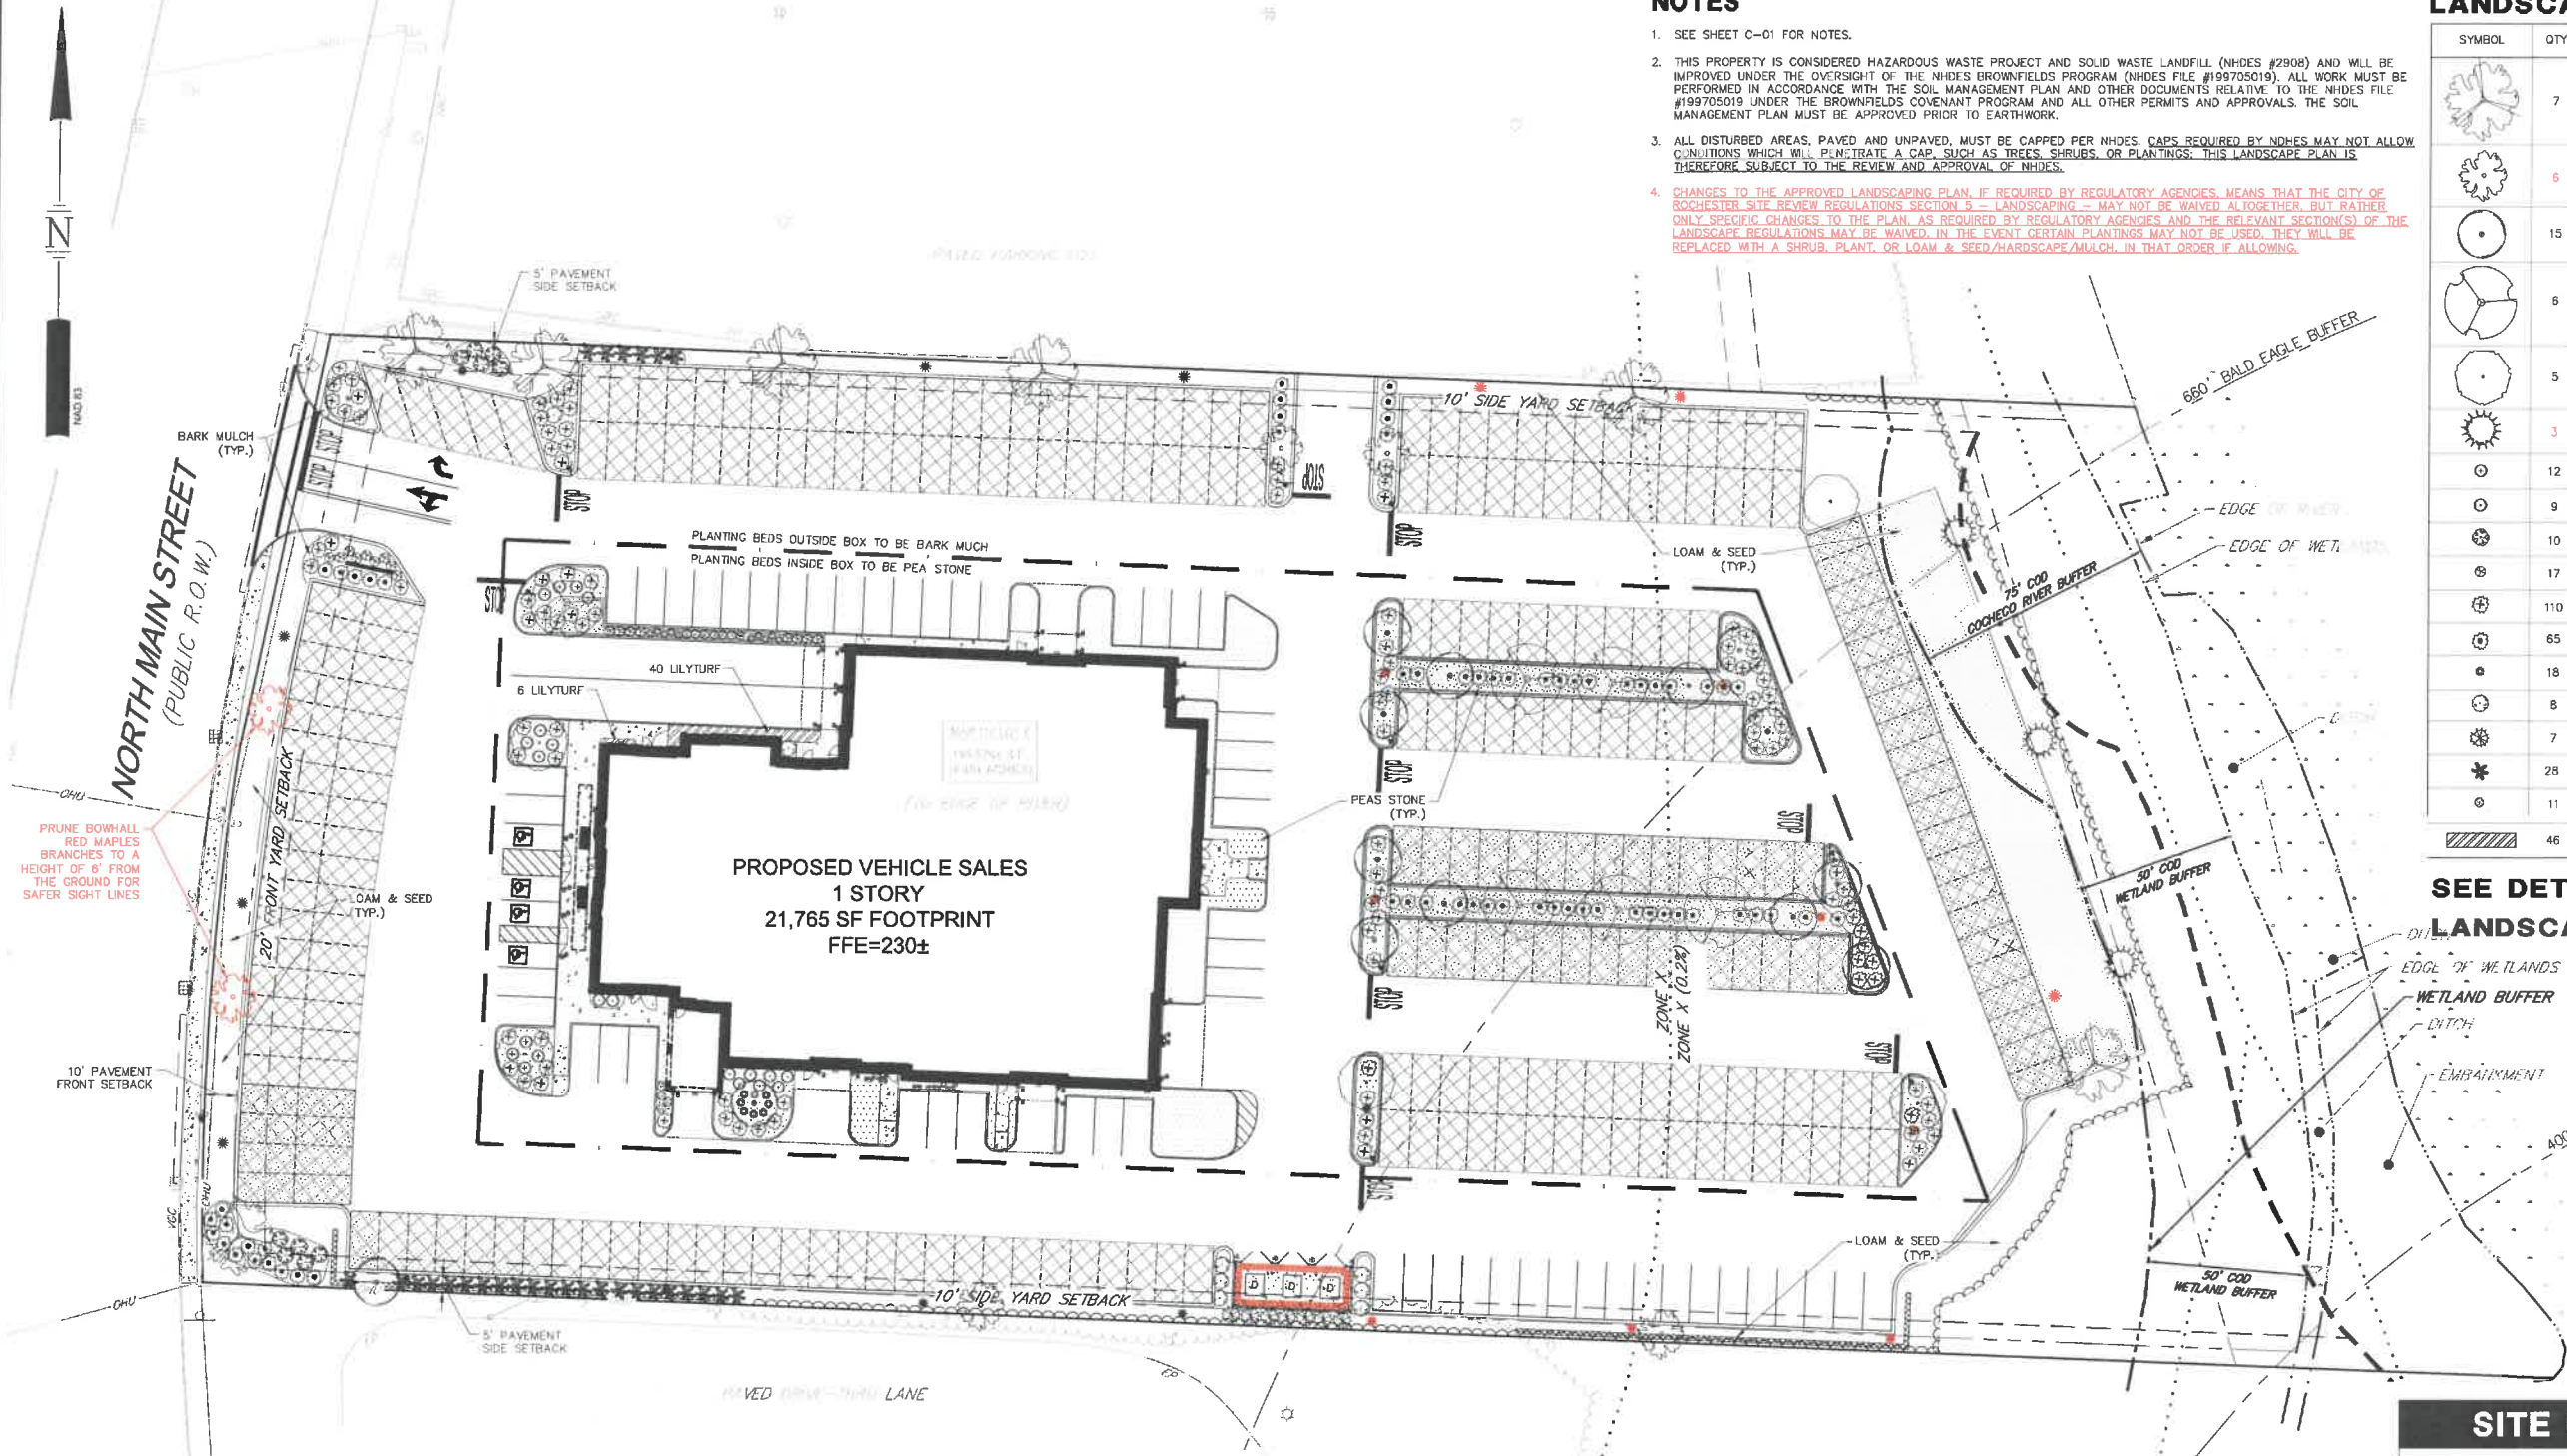

## NOTES

- SEE SHEET C-01 FOR NOTES.
- THIS PROPERTY IS CONSIDERED HAZARDOUS WASTE PROJECT AND SOLID WASTE LANDFILL (NHDES #2908) AND WILL BE IMPROVED UNDER THE OVERSIGHT OF THE NHDES BROWNFIELDS PROGRAM (NHDES FILE #199705019). ALL WORK MUST BE PERFORMED IN ACCORDANCE WITH THE SOIL MANAGEMENT PLAN AND OTHER DOCUMENTS RELATIVE TO THE NHDES FILE #199705019 UNDER THE BROWNFIELDS COVENANT PROGRAM AND ALL OTHER PERMITS AND APPROVALS. THE SOIL MANAGEMENT PLAN MUST BE APPROVED PRIOR TO EARTHWORK.
- ALL DISTURBED AREAS, PAVED AND UNPAVED, MUST BE CAPPED PER NHDES. CAPS REQUIRED BY NHDES MAY NOT ALLOW CONDITIONS WHICH WILL PENETRATE A CAP, SUCH AS TREES, SHRUBS, OR PLANTINGS. THIS LANDSCAPE PLAN IS THEREFORE SUBJECT TO THE REVIEW AND APPROVAL OF NHDES.
- CHANGES TO THE APPROVED LANDSCAPING PLAN, IF REQUIRED BY REGULATORY AGENCIES, MEANS THAT THE CITY OF ROCHESTER SITE REVIEW REGULATIONS SECTION 5 - LANDSCAPING - MAY NOT BE WAIVED ALTOGETHER, BUT RATHER ONLY SPECIFIC CHANGES TO THE PLAN, AS REQUIRED BY REGULATORY AGENCIES AND THE RELEVANT SECTION(S) OF THE LANDSCAPE REGULATIONS MAY BE WAIVED. IN THE EVENT CERTAIN PLANTINGS MAY NOT BE USED, THEY WILL BE REPLACED WITH A SHRUB, PLANT, OR LOAM & SEED/HARDSCAPE/MULCH, IN THAT ORDER IF ALLOWING.

## LANDSCAPE LEGEND

SYMBOL	QTY	BOTANICAL NAME COMMON NAME	SIZE	REMARKS
	7	ACER RUBRUM 'REDPOINTE' REDPOINTE RED MAPLE	3" TO 3 1/2" CAL.	B&B
	6	ACER RUBRUM 'BOWHALL' BOWHALL RED MAPLE	3" TO 3 1/2" CAL.	B&B
	15	MALUS 'SPRING SNOW' SPRING SNOW CRABAPPLE	2" TO 2 1/2" CAL.	B&B
	6	PLATANUS ACROFOLIA 'BLOODGOOD' BLOODGOOD LONDON PLANETREE	3" TO 3 1/2" CAL.	B&B
	5	ZELKOVA SERRATA 'GREEN VASE' GREEN VASE ZELKOVA	3" TO 3 1/2" CAL.	B&B
	3	PINUS STROBUS WHITE PINE	6' TO 7'	B&B
	12	AZALEA 'PLEASANT WHITE' PLEASANT WHITE AZALEA	3 GAL.	CONT.
	9	AZALEA 'GIRARD'S CRIMSON' GIRARD'S CRIMSON AZALEA	3 GAL.	CONT.
	10	CORNUS BAILEY RED TWIG DOGWOOD	3 GAL.	CONT.
	17	DEUTZIA 'YUKI SNOWFLAKE' YUKI SNOWFLAKE DEUTZIA	3 GAL.	CONT.
	110	JUNIPERUS H. 'BAR HARBOR' BAR HARBOR JUNIPER	3 GAL.	CONT.
	65	JUNIPERUS C. 'PRITZERIANA COMPACTA' COMPACT PRIZER JUNIPER	3 GAL.	CONT.
	18	SPIRAEA J. 'GOLDEN ELF' GOLDEN ELF SPIREA	3 GAL.	CONT.
	6	VIBURNUM D. 'BLUE MUFFIN' BLUE MUFFIN VIBURNUM	3' TO 4'	B&B
	7	THUJA O. 'TECHNY' MISSION ARBORVITAE	5' TO 6'	B&B
	28	PANICUM V. 'HEAVY METAL' HEAVY METAL SWITCH GRASS	3 GAL.	CONT.
	11	PENNISETUM ALOPECUROIDES 'HAEMEL' HAEMEL FOUNTAIN GRASS	1 GAL.	CONT.
	46	LIRIOP SPICATA CREEPING LILYTURF	1 GAL.	CONT.

SEE DETAIL SHEET FOR  
LANDSCAPE NOTES

## LANDSCAPE CALCULATIONS

GENERAL PROVISIONS: ARTICLE III SEC. 5(B)(12)

MINIMUM OF 25% OF THE TOTAL LAND AREA OF ANY DEVELOPMENT SITE SHALL BE DEVOTED TO LANDSCAPED AREAS OR LEFT IN AN UNALTERED NATURAL STATE.  
REQUIRED: 48,894 SF  
PROVIDED: 53,007 ± SF (27.1 ± %)

FRONT & SIDE BUFFER PLANTING REQUIREMENTS: ARTICLE III SEC. 5(D)

- ONE BROAD-LEAFED SHADE TREE PER 40 LINEAR FEET OF FRONT BUFFER  
REQUIRED: 25' / 40' = 6 TREES  
PROVIDED: 3 TREES  
\*WAIVER REQUIRED, ARTICLE III SEC. 5(D)(8b)
- TWO SHADE TREES, SPACED AT LEAST 40' APART, SHALL BE LOCATED WITHIN THE FRONT 50' OF EACH SIDE BUFFER.  
REQUIRED: 4 TREES, 40' APART  
PROVIDED: 4 SHADE TREES  
ARTICLE III SEC. 5(D)(8c)
- THE FRONT BUFFER AND FRONT 50 FEET OF BOTH SIDE BUFFERS SHALL BE PLANTED WITH SUFFICIENT TREES AND SHRUBS IN ORDER THAT, AT MATURITY (DEFINED HEREIN TO BE 5 YEARS FROM INSTALLATION), AT LEAST 33-1/3% OF THE AREA OF THE BUFFER, AS LOOKED DOWN UPON FROM ABOVE, WOULD BE COVERED BY THE CANOPIES/CROWNS OF THE TREES AND SHRUBS.

PARKING LOT PLANTING REQUIREMENTS: ARTICLE III SEC. 5(E)

- OFF-STREET PARKING AREAS SHALL BE SCREENED FROM THE PUBLIC RIGHT-OF-WAY TO PROVIDE AT LEAST 50% VERTICAL OPACITY ON AVERAGE UP TO A HEIGHT OF 3-1/2 FEET ABOVE GRADE, EXCLUDING SIGHT TRIANGLES AT VEHICULAR ENTRANCES AND EXITS. A MODERATELY DENSE HEDGE COMPOSED OF EVERGREEN SHRUBS SHALL BE PLANTED WHICH IS REASONABLY EXPECTED TO REACH THIS OPACITY AND HEIGHT WITHIN ONE YEAR.  
\*WAIVER REQUIRED, ARTICLE III SEC. 5(E)(2)
- THE LANDSCAPED MEDIAN SHALL BE PLANTED WITH EVERGREEN SHRUBBERY AND AT LEAST ONE ORNAMENTAL OR SHADE TREE FOR EVERY 30 LINEAR FEET OF THE MEDIAN.  
REQUIRED: 9 TREES BETWEEN THE TWO LANDSCAPED MEDIANS  
PROPOSED: 9 TREES AND EVERGREEN SHRUBS  
ARTICLE III SEC. 5(E)(8)
- SHADE AND/OR ORNAMENTAL TREES SHALL BE PLANTED IN AND AROUND THE PARKING LOT IN ORDER THAT NO SPOT ON THE PARKING LOT IS SITUATED FURTHER THAN 75 FEET FROM THE CENTER OF THE TRUNK OF A SHADE OR ORNAMENTAL TREE. ARTICLE III SEC. 5(E)(9)
- FOUNDATION PLANTING BUFFER. THE PLANNING BOARD SHALL DETERMINE IF A MINIMUM 4 FOOT WIDE FOUNDATION PLANTING BUFFER BETWEEN THE BUILDING AND ANY PARKING LOT OR DRIVEWAY SITUATED ON THE FRONT OR SIDE OF THE BUILDING WILL BE REQUIRED. THE FOUNDATION BED SHALL BE PLANTED WITH APPROPRIATE LANDSCAPING MATERIALS, INCLUDING GRASS, SHRUBBERY, FLOWERS, AND MULCH, AS DETERMINED BY THE APPLICANT. USE OF ORNAMENTAL TREES IS ENCOURAGED WHERE PRACTICAL. WHERE THERE IS A SIDEWALK ALONGSIDE THE BUILDING, THE FOUNDATION BUFFER MAY BE SITUATED ON EITHER SIDE OF THE SIDEWALK. A CONTINUOUS FOUNDATION PLANTING BUFFER IS PREFERRED BUT IT NEED NOT BE CONTINUOUS WHERE THERE ARE PROJECTING BUILDING ELEMENTS, SUCH AS ENTRANCES, BAYS, AND UTILITIES. [21]  
\*WAIVER REQUIRED, ARTICLE III SEC. 5(E)(11)

HORIZONTAL SCALE 1"=30'  
30 15 0 30

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

LANDSCAPE PLAN

PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH  
OWNED BY & PREPARED FOR  
401 NORTH MAIN STREET LLC

1"=60' (11"x17")  
SCALE: 1"=30' (22"x34")

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com


47159.02

DR HEG FB  
CK CK CADFILE 47159-02\_LANDSCAPE

C-08




Jul 09, 2021 - 7:46am  
F:\MISC Projects\47159 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\PRODUCTION DRAWINGS\47159-02 Landscape.dwg

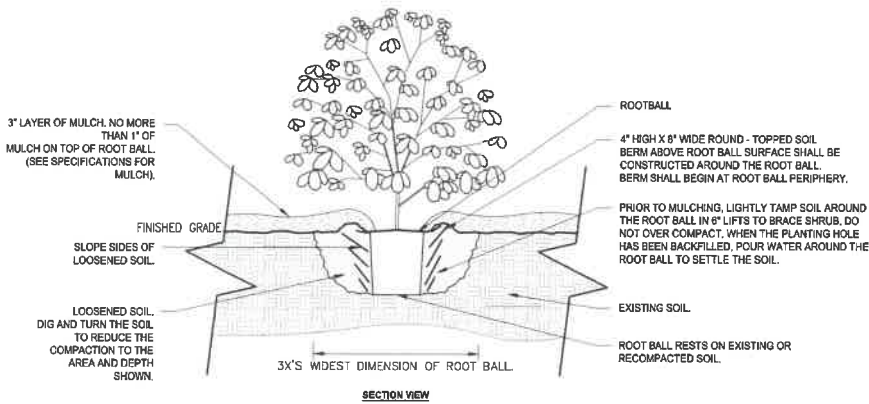


## SHRUB PLANTING

NOT TO SCALE

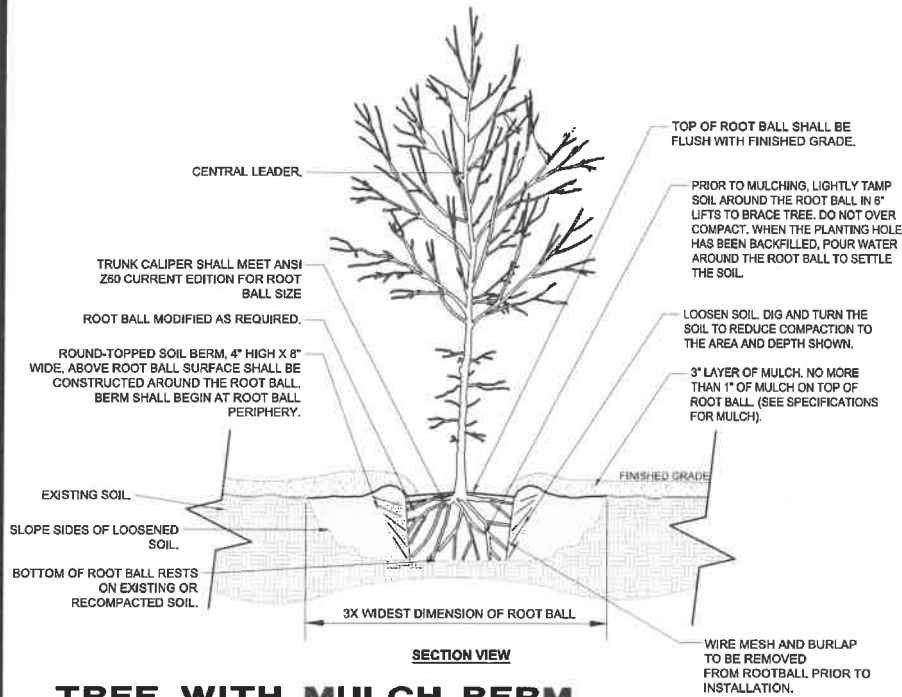

## TREE WITH MULCH BERM

NOT TO SCALE

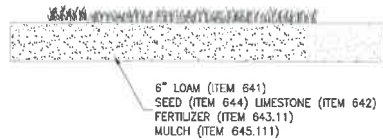

## LOAM & SEED

NOT TO SCALE

### LANDSCAPE NOTES

- CONTRACTOR WILL LOCATE, VERIFY AND MARK ALL EXISTING AND NEWLY INSTALLED UNDERGROUND UTILITIES PRIOR TO ANY LAWNWORK OR PLANTING. ANY CONFLICTS WHICH MIGHT OCCUR BETWEEN PLANTING AND UTILITIES WILL IMMEDIATELY BE REPORTED TO THE LANDSCAPE ARCHITECT OR OWNERS' REPRESENTATIVE, SO THAT ALTERNATE PLANTING LOCATIONS CAN BE DETERMINED.
- CONTRACTOR WILL FURNISH AND PLANT ALL PLANTS IN QUANTITIES AS SHOWN ON THIS PLAN. IN CASES OF DISCREPANCY BETWEEN PLAN AND LIST CLARIFY WITH LANDSCAPE ARCHITECT PRIOR TO PLACING PURCHASE ORDER AND AGAIN PRIOR TO PLANTING.
- SEE PLANTING DETAILS AND IF INCLUDED, SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- NO SUBSTITUTION OF PLANT MATERIALS WILL BE ALLOWED WITHOUT PRIOR WRITTEN APPROVAL OF THE LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO MAKE THE APPROPRIATE ARRANGEMENTS TO PROVIDE ALL PLANTS AND MATERIALS TO ACCOMMODATE PLANTING WITHIN THE TIME ALLOWED BY THE CONSTRUCTION SCHEDULE.
- PLANTING SHALL BE COMPLETED FROM APRIL 15TH THROUGH OCTOBER 15TH UNLESS OTHERWISE NOTED IN SPECIFICATIONS. THERE WILL BE NO PLANTING DURING JULY AND AUGUST UNLESS SPECIAL PROVISIONS ARE MADE FOR DROUGHT BY PROVIDING ADDITIONAL WATERING.
- ALL PLANTS WILL BE NURSERY GROWN.
- PLANTS WILL BE IN ACCORDANCE, AT A MINIMUM, WITH CURRENT EDITION OF "AMERICAN STANDARDS FOR NURSERY STOCK" AS PUBLISHED BY THE AMERICAN HORTICULTURE INDUSTRY ASSOCIATION.
- TREES WILL BE PRUNED IN ACCORDANCE WITH THE LATEST EDITION OF ANSI A300 PART 1, "TREE, SHRUB AND OTHER WOODY PLANT MAINTENANCE STANDARD PRACTICES".
- PLANTS MATERIAL IS SUBJECT TO APPROVAL / REJECTION BY THE LANDSCAPE ARCHITECT AT THE SITE AND AT THE NURSERY.
- ALL PLANTS WILL BE MOVED WITH ROOT SYSTEMS AS SOLID UNITS AND WITH BALLS OF EARTH FIRMLY WRAPPED WITH BURLAP. NO PLANT WILL BE ACCEPTED WHEN BALL OF EARTH SURROUNDING ITS ROOTS HAS BEEN BADLY CRACKED OR BROKEN BEFORE PLANTING. ALL PLANTS THAT CANNOT BE PLANTED AT ONCE WILL BE HEeled-IN BY SETTING IN THE GROUND AND COVERING THE BALLS WITH SOIL AND THEN WATERING. DURING TRANSPORT, ALL PLANT MATERIALS WILL BE WRAPPED WITH WIND PROOF COVERING.
- NEWLY PLANTED MATERIAL WILL BEAR THE SAME RELATIONSHIP TO FINISHED GRADE AS TO THE ORIGINAL GRADE OF THE PLANT PRIOR TO DIGGING.
- PROPOSED TREES OVERHANGING SIDEWALKS, ROADS OR PARKING WILL BEGIN BRANCHING NATURALLY (NOT PRUNED) AT 6' HEIGHT.
- MULCH FOR PLANTED AREAS (NOT INCLUDING RAIN GARDENS) WILL BE AGED SHREDDED PINE BARK, PARTIALLY DECOMPOSED, DARK BROWN IN COLOR AND FREE OF WOOD CHIPS UNLESS OTHERWISE SHOWN.
- PLANT MATERIAL WILL BE LOCATED OUTSIDE BUILDING DRIP LINES AND ROOF VALLEY POINTS OF CONCENTRATION TO PREVENT DAMAGE TO PLANTS. CLARIFY DISCREPANCIES WITH LANDSCAPE ARCHITECT PRIOR TO INSTALLATION.
- ALL DISTURBED AREAS NOT TO BE PAVED OR OTHERWISE TREATED, WILL RECEIVE SIX (6) INCH LOAM AND SEED AT THE DIRECTION OF THE LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE.
- ALL PLANT GROUPINGS WILL BE IN MULCH BEDS UNLESS OTHERWISE SPECIFIED OR NOTED ON PLANS. WHERE MULCHED PLANT BED ABUTS LAWN, PROMOTE TURF CUT EDGE.
- ALL PLANT BEDS WILL INTERSECT WITH PAVEMENT AT 90 DEGREES UNLESS OTHERWISE NOTED ON PLANS.
- ALL PLANT BED EDGES WILL BE SMOOTH AND CONSISTENT IN LAYOUT OF RADII AND TANGENTS. IRREGULAR, WAVY EDGES WILL NOT BE ACCEPTED.

### LANDSCAPE GUARANTEE AND MAINTENANCE NOTES

- CONTRACTOR WILL BE RESPONSIBLE FOR ALL MEANS, METHODS AND TECHNIQUES OF WATERING.
- CONTRACTOR WILL BEGIN WATERING IMMEDIATELY AFTER PLANTING. ALL PLANTS WILL BE THOROUGHLY WATERED TWICE DURING THE FIRST 48 HOUR PERIOD AFTER PLANTING. ALL PLANTS WILL BE WATERED WEEKLY, OR MORE OFTEN, IF NECESSARY DURING THE FIRST GROWING SEASON BUT NOT LESS THAN ONE YEAR.
- WATER ALL LAWNS AS REQUIRED. DO NOT LET NEWLY PLANTED LAWNS DRY OUT DURING THE FIRST FOUR WEEKS MINIMUM.
- ALL NEW LAWNS WILL BE MAINTAINED AND MOWED A MINIMUM THREE (3) TIMES BEFORE REQUESTING REVIEW BY LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE FOR ACCEPTANCE. MAINTENANCE AND MOWING WILL CONTINUE UNTIL ACCEPTED BY LANDSCAPE ARCHITECT OR OWNERS' REPRESENTATIVE IS ISSUED IN WRITING.
- THE CONTRACTOR WILL MAINTAIN AND GUARANTEE ALL PLANTINGS TO BE IN GOOD HEALTHY, FLOURISHING AND ACCEPTABLE CONDITION FOR A PERIOD OF ONE (1) YEAR BEGINNING AT THE DATE OF ACCEPTANCE BY THE LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE. ALL GRASSES, TREES AND SHRUBS THAT, IN THE OPINION OF THE LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE SHOWING LESS THAN 80% HEALTHY GROWTH AT THE END OF ONE (1) YEAR PERIOD WILL BE IMMEDIATELY REPLACED BY THE CONTRACTOR.
- ALL ORNAMENTAL GRASSES WILL BE CUT BACK EVERY FALL OR EARLY SPRING.
- DECIDUOUS PLANT MATERIAL INSTALLED AFTER SEPTEMBER 30 AND BEFORE APRIL 15 WILL NOT BE REVIEWED THAT SEASON FOR ACCEPTANCE DUE TO STAGE OF LEAF PHYSIOLOGY. THIS PLANT MATERIAL WILL NOT BE REVIEWED UNTIL FOLLOWING GROWING SEASON. GUARANTEE PERIOD WILL BEGIN ONLY AFTER ACCEPTANCE BY LANDSCAPE ARCHITECT OR OWNERS' REPRESENTATIVE.
- EVERGREEN PLANT MATERIAL INSTALLED AFTER OCTOBER 30 AND BEFORE APRIL 15 WILL NOT BE REVIEWED THAT SEASON FOR ACCEPTANCE DUE TO END OF GROWTH SEASON. THIS PLANT MATERIAL WILL NOT BE REVIEWED UNTIL FOLLOWING GROWING SEASON. GUARANTEE PERIOD WILL BEGIN ONLY AFTER ACCEPTANCE BY LANDSCAPE ARCHITECT OR OWNERS' REPRESENTATIVE.

### HYDROSEEDING NOTES

- HYDROSEEDING MAY BE USED AS AN ALTERNATE METHOD OF SEEDING. THE APPLICATION OF LIME STONE AS NECESSARY, FERTILIZER AND GRASS SEED MAY BE ACCOMPLISHED IN ONE OPERATION BY THE USE OF A SPRAYING MACHINE APPROVED BY THE LANDSCAPE ARCHITECT OR CIVIL ENGINEER. THE MATERIALS SHALL BE MIXED WITH WATER IN THE MACHINE AND SHALL CONFORM TO RELATIVE REQUIREMENTS OF SECTION 644 OF NH. STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.

### INVASIVE PLANT NOTES

- EXISTING NON-NATIVE, INVASIVE PLANT SPECIES WILL BE IDENTIFIED, REMOVED, DESTROYED AND LEGALLY DISPOSED OF IN ACCORDANCE WITH THE LATEST UNIVERSITY OF NEW HAMPSHIRE COOPERATIVE EXTENSION METHODS OF DISPOSING NON-NATIVE INVASIVE PLANTS. SEE "MANAGE AND CONTROL INVASIVES" AND PROPERLY DISPOSE OF INVASIVE PLANTS".

### PRICING & CONSTRUCTION DOCUMENT NOTES

- CONTRACTOR WILL PRICE PLANT MATERIAL IN QUANTITIES SUFFICIENT TO COMPLETE PLANTINGS GRAPHICALLY SHOWN ON THESE DRAWINGS OR IN PLANT LIST, WHICHEVER IS GREATER. IN CASES OF DISCREPANCY BETWEEN PLAN AND LIST CLARIFY WITH LANDSCAPE ARCHITECT PRIOR TO PLACING PURCHASE ORDER AND AGAIN PRIOR TO PLANTING.
- CONTRACTOR WILL VERIFY PRIOR TO PRICING IF SITE SOILS ARE VERY POORLY DRAINING OR IF LEDGE IS PRESENT. IF CONTRACTOR ENCOUNTERS VERY POORLY DRAINING SOILS (BATH TUB EFFECT) OR LEDGE THAT IMPACTS PROPOSED PLANTING PLAN, NOTIFY LANDSCAPE ARCHITECT OR OWNERS' REPRESENTATIVE FOR DIRECTION PRIOR TO PRICING AND AGAIN PRIOR TO PERFORMING ANY WORK.
- PARKING AREA PLANTED ISLANDS WILL HAVE MINIMUM OF 1'-0" TOPSOIL PLACED TO THE TOP OF CURB ELEVATION. REMOVE ALL CONSTRUCTION DEBRIS BEFORE PLACING TOPSOIL.
- EXISTING TREES SHOWN ON THE PLAN WILL REMAIN UNDISTURBED. ALL EXISTING TREES SHOWN TO REMAIN WILL BE PROTECTED WITH A 4-FOOT SNOW FENCE PLACED AT THE DRIP LINE OF THE BRANCHES OR AT 8 FEET MINIMUM FROM THE TREE TRUNK.
- COORDINATE WITH LANDSCAPE ARCHITECT'S CONTRACTED NUMBER OF SITE VISITS WHEN PLANNING FOR INSPECTION. NOTIFY LANDSCAPE ARCHITECT 72 HOURS MINIMUM IN ADVANCE OF REQUESTED SITE VISIT.
- CONTRACTOR WILL DEVELOP A WRITTEN WATERING SCHEDULE AND WILL SUBMIT WATERING SCHEDULE TO OWNERS' REPRESENTATIVE. CONTRACTOR WILL WATER ALL NEW PLANTS INCLUDING LAWNS THAT ARE NOT "IRRIGATED" VIA A PERMANENT IRRIGATION SYSTEM FOR THE FIRST 12 MONTHS.

### SEEDING NOTES

- SEEDING SHALL BE DONE BETWEEN APRIL 1 TO JUNE 15 OR AUGUST 15 TO OCTOBER 15, EXCEPT FOR RESEEDING OF BARE SPOTS AND MAINTENANCE. ALL DISTURBED AREAS NOT COVERED BY BUILDINGS, PAVING OR AREAS THAT HAVE NOT BEEN OTHERWISE DEVELOPED SHALL BE SEEDDED OR SODDED. SLOPES GREATER THAN 3:1 SHALL BE PROTECTED WITH AN EROSION CONTROL BLANKET. AFTER OCTOBER 15 DISTURBED SOILS SHALL BE PROTECTED IN ACCORDANCE WITH THE WINTER CONSTRUCTION NOTES.
- SLOPES UP TO AND INCLUDING 3:1 GRADE, SEED WILL BE NEW ENGLAND EROSION CONTROL & RESTORATION MIX PER NEW ENGLAND WETLANDS PLANTS INC., AMHERST, MA.
- SLOPES STEEPER THAN 3:1 GRADE, SEED WILL BE NEW ENGLAND EROSION CONTROL & RESTORATION MIX PER NEW ENGLAND WETLANDS PLANTS INC., AMHERST, MA. SEE CIVIL FOR ADDITIONAL EROSION CONTROL MEASURES.
- GENERAL SEED WILL BE NHDOT SPECIFICATION SECTION 644, TABLE 644-1-PARK SEED TYPE 15, INCLUDING NOTES TO TABLE 1, 2 & 3.

### IRRIGATION NOTES

- THE IRRIGATION SYSTEM SHALL BE DESIGNED BY AN APPROVED IRRIGATION DESIGN/BUILD CONTRACTOR OR BY AN APPROVED EQUAL, TO BE DETERMINED BY THE OWNERS REPRESENTATIVE/LANDSCAPE ARCHITECT.
- THE CONTRACTOR IS RESPONSIBLE FOR SUBMITTING THE IRRIGATION SYSTEM DESIGN AND SHOP DRAWINGS TO THE OWNER 30 DAYS PRIOR TO THE START OF CONSTRUCTION.
- THE CONTRACTOR SHALL VERIFY LOCATIONS OF ALL EXISTING AND PROPOSED UTILITIES AND NOTIFY THE OWNER'S REPRESENTATIVE OF CONFLICTS.
- THE IRRIGATION CONTRACTOR IS RESPONSIBLE FOR, BUT NOT LIMITED TO, THE COMPLETE INSTALLATION OF THE IRRIGATION SYSTEM AND SHALL FOLLOW ALL APPLICABLE CODES.
- REFER TO ARCHITECTURAL PLANS FOR LOCATION OF THE IRRIGATION SYSTEM'S BUILDING CONNECTION.
- REFER TO MANUFACTURER'S INSTRUCTIONS AND PRODUCT SPECIFICATIONS FOR INSTALLATION.

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7  
LANDSCAPE DETAILS

PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH  
OWNED BY & PREPARED FOR  
401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

OR HEG FB  
CK CRR CADFILE

47159-02\_LANDSCAPE

C-09

Copyright 2020 ©Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.


This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.





Jul 09, 2021 - 7:47am  
F:\MSC Projects\47159 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\Design\PRODUCTION DRAWINGS\47159-02 Erosion.dwg

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110  
All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.  
This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.

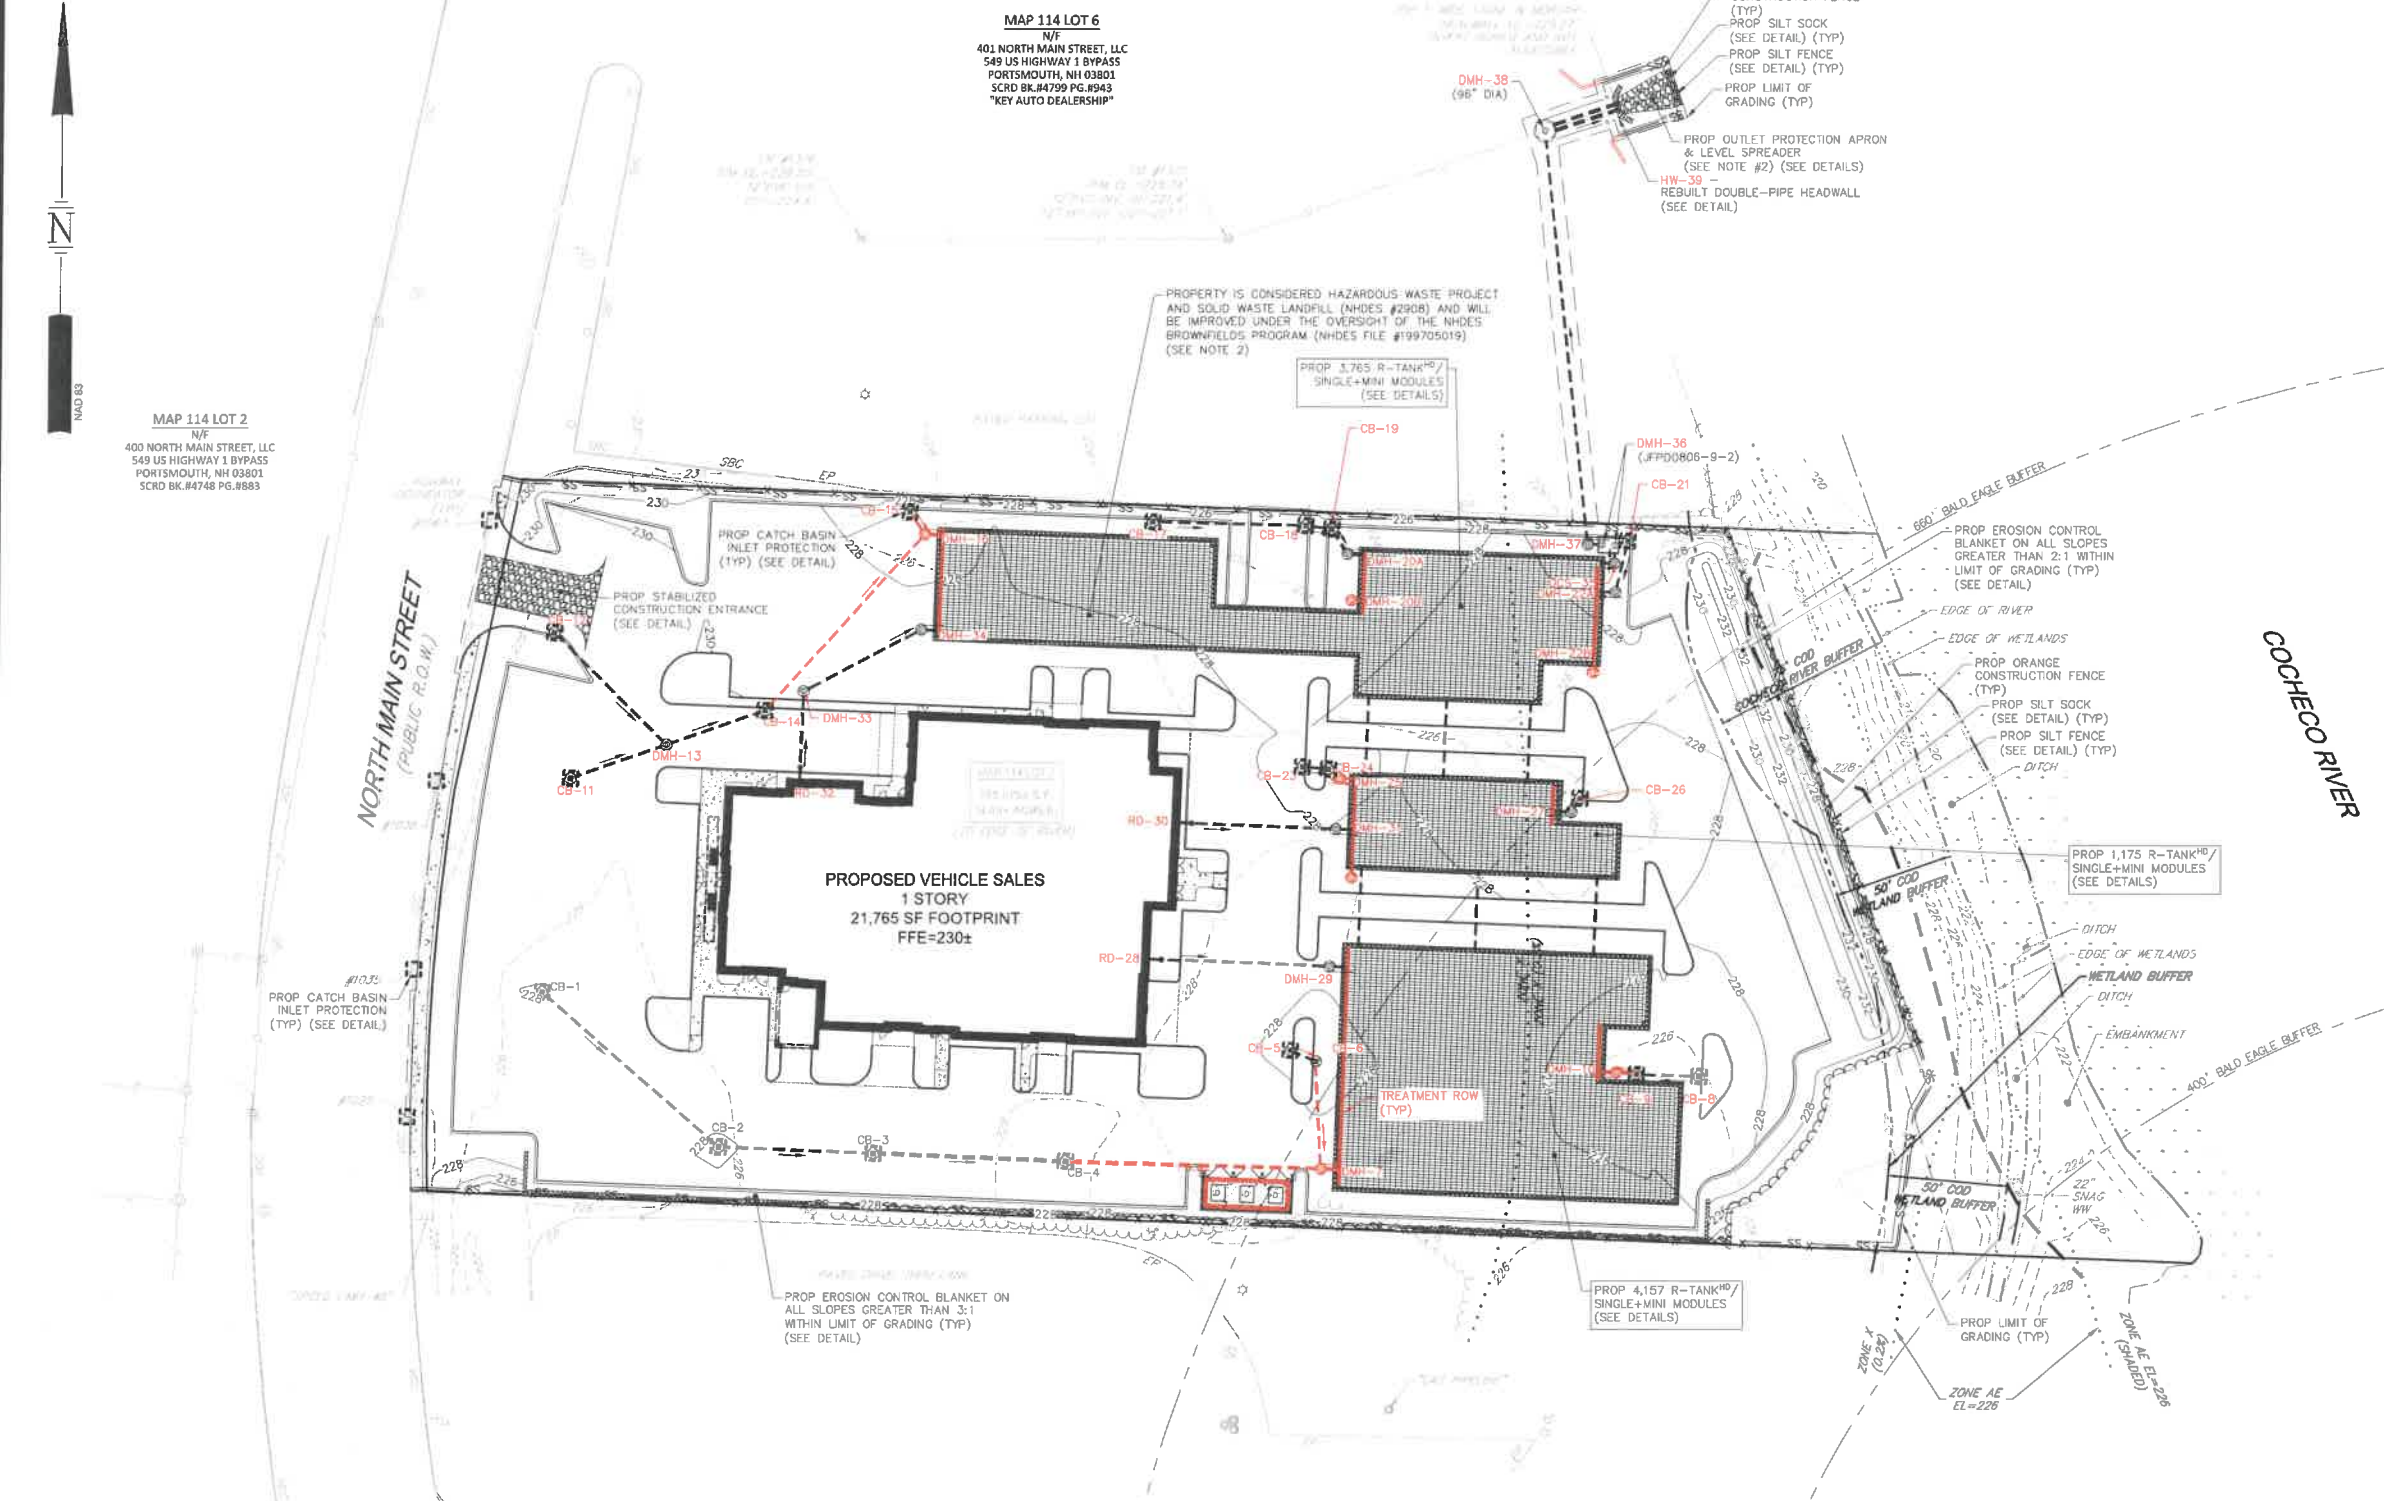

- ### NOTES
- SEE SHEET C-01 FOR NOTES.
  - THE CONTRACTOR MUST BE QUALIFIED TO WORK WITH HAZARDOUS MATERIAL. SOIL AND MATERIALS FOUND WITHIN THE SOIL MAY NOT BE TRANSPORTED OFF-SITE. ALL WORK MUST BE PERFORMED IN ACCORDANCE WITH THE SOIL MANAGEMENT PLAN AND OTHER DOCUMENTS RELATIVE TO THE NHDES FILE #199705019 UNDER THE BROWNFIELDS COVENANT PROGRAM AND ALL OTHER PERMITS AND APPROVALS. THE SOIL MANAGEMENT PLAN MUST BE APPROVED PRIOR TO EARTHWORK.
  - SEE GENERAL EROSION CONTROL NOTES ON THE EROSION CONTROL DETAIL SHEET AND THE APPROVED SWPPP.
  - INSTALL SILT BARRIER ALONG THE PERIMETER OF THE AREA TO BE DISTURBED AS FIRST ORDER OF WORK.
  - PROVIDE INLET PROTECTION BARRIERS AROUND ALL EXISTING AND PROPOSED STORM DRAINAGE INLETS WITHIN THE WORK LIMITS AND MAINTAIN FOR THE DURATION OF THE PROJECT UNTIL PAVEMENT HAS BEEN INSTALLED. INLET PROTECTION BARRIERS SHALL BE IN PLACE AT ALL CATCH BASINS PRIOR TO THE DISTURBANCE OF SOIL.
  - DUST CONTROL SHALL BE MAINTAINED THROUGHOUT THE CONSTRUCTION PERIOD. IT SHALL BE ACCOMPLISHED BY THE UNIFORM APPLICATION OF CALCIUM CHLORIDE AT THE RATE OF 1-1/2 POUNDS PER SQUARE YARD BY MEANS OF A LIME SPREADER OR OTHER APPROVED METHOD. WATER MAY ALSO BE USED FOR DUST CONTROL, AND APPLIED BY SPRINKLING WITH WATER TRUCK DISTRIBUTORS, AS REQUIRED.
  - THE SITE WILL REQUIRE A USEPA NPDES PERMIT FOR STORMWATER DISCHARGE FOR THE SITE CONSTRUCTION IF THE DISTURBANCE EXCEEDS ONE ACRE. THE CONSTRUCTION SITE OPERATOR SHALL DEVELOP AND IMPLEMENT A CONSTRUCTION STORM WATER POLLUTION PREVENTION PLAN (SWPPP) IN ACCORDANCE WITH EPA REGULATIONS AND THE CONSTRUCTION GENERAL PERMIT WHICH SHALL REMAIN ON SITE AND MADE ACCESSIBLE TO THE PUBLIC. THE SITE CONTRACTOR SHALL COORDINATE WITH THE OWNER TO SUBMIT AN EROSION CONTROL PLAN AT LEAST 14 DAYS IN ADVANCE OF ANY EARTHWORK ACTIVITIES AT THE SITE. A COMPLETED NOTICE OF TERMINATION (NOT) SHALL BE SUBMITTED TO NPDES PERMITTING AUTHORITY WITHIN 30 DAYS AFTER EITHER OF THE FOLLOWING CONDITIONS HAVE BEEN MET: FINAL STABILIZATION HAS BEEN ACHIEVED ON ALL PORTIONS OF THE SITE FOR WHICH THE PERMITTEE IS RESPONSIBLE FOR, OR ANOTHER OPERATOR/PERMITTEE HAS ASSUMED CONTROL OVER ALL AREAS OF THE SITE THAT HAVE NOT BEEN FINALLY STABILIZED.
  - SILT PROTECTION MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH THE DETAILS CONTAINED IN THIS PLAN SET.
  - CONSTRUCT JUTE MATTING ON ALL SLOPES STEEPER THAN 3:1, DISTURBED AREAS SLOPING TOWARDS WETLANDS AND ALL LOCATIONS SHOWN ON PLAN.
  - INSPECT EROSION CONTROL MEASURES WEEKLY AND AFTER EACH RAIN STORM OF 0.10" OR GREATER. REPAIR/MODIFY SILT BARRIER AS NECESSARY TO MAXIMIZE FILTER EFFICIENCY. REMOVE SEDIMENT WHEN SEDIMENT IS 1/3 THE STRUCTURE HEIGHT.
  - PROVIDE SILT BARRIERS AT THE BASE OF CUT AND FILL SLOPES UNTIL COMPLETION OF THE PROJECT OR UNTIL VEGETATION BECOMES ESTABLISHED ON SLOPES. EROSION PROTECTION BELOW FILL SLOPES SHALL BE PLACED IMMEDIATELY AFTER CLEARING, PRIOR TO EMBANKMENT CONSTRUCTION.
  - ALL DISTURBED AREAS SHALL BE REVEGETATED AS QUICKLY AS POSSIBLE. ALL CUT AND FILL SLOPES SHALL BE SEEDED WITHIN 72 HOURS AFTER GRADING.
  - ALL WORK AREAS TO BE STABILIZED AT THE END OF EACH WORK DAY AND PRIOR TO ANY PREDICTED SIGNIFICANT RAIN EVENT.
  - AN AREA SHALL BE CONSIDERED STABLE IF ONE OF THE FOLLOWING HAS OCCURRED:  
A. BASE COURSE GRAVELS, WHICH MEET THE REQUIREMENTS OF NHDOT STANDARD FOR ROAD AND BRIDGE CONSTRUCTION, 2016, ITEM 304.2, ARE INSTALLED IN AREAS TO BE PAVED  
B. A MINIMUM OF 85% VEGETATED GROWTH HAS BEEN ESTABLISHED  
C. A MINIMUM OF 3" OF NON-EROSIVE MATERIAL SUCH AS STONE OR RIP RAP HAS BEEN INSTALLED  
D. EROSION CONTROL BLANKETS HAVE BEEN PROPERLY INSTALLED
  - ALL CATCH BASINS, MANHOLES, AND DRAIN LINES SHALL BE THOROUGHLY CLEANED OF ALL SEDIMENT AND DEBRIS AFTER ALL AREAS HAVE BEEN STABILIZED.
  - CONTRACTOR IS RESPONSIBLE FOR MAINTAINING SLOPE STABILITY DURING CONSTRUCTION.
  - THE EROSION CONTROL PRACTICES SHOWN ON THESE PLANS ARE ILLUSTRATIVE ONLY AND SHALL BE SUPPLEMENTED BY THE SITE CONTRACTOR AS NEEDED.

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7  
**EROSION CONTROL PLAN**  
**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**  
OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

**1"=80' (11"X17")**  
**SCALE: 1"=40' (22"X34")**

**JUNE 1, 2021**

Seacoast Division

**TFM**

Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02	DR	HEG	FB	-	-
	CK	CR	CADFILE	47159-02_EROSION	C-10

REV	DATE	DESCRIPTION	HEG	CR
1	7/9/2021	REVISED PER TRC COMMENTS	HEG	CR



Jul 09, 2021 - 7:47am  
F:\MSC-Projects\47159-02 - North Main St - Rochester\47159-02 - No Main Street - AUTO DEALERSHIP\Design\PRODUCTION DRAWINGS\47159-02\_Erosion.dwg

SOIL CHARACTERISTICS

THE SOIL IN THE VICINITY OF THE SITE CONSIST OF UDORTHENTS, SANDY, THE MAJORITY OF THE SOIL IS HSG TYPE A.

DISTURBED AREA

THE TOTAL AREA TO BE DISTURBED IS APPROXIMATELY 174,814 SQUARE FEET (4.0± ACRES). CONSTRUCTION SHALL BE PHASED TO LIMIT DISTURBED AREAS TO LESS THAN 5 ACRES.

CRITICAL NOTE: THIS DRAWING IS PROVIDED FOR GENERAL GUIDANCE. ALL SPECIAL EROSION CONTROL MEASURES MUST BE EXECUTED IN ACCORDANCE WITH APPLICABLE CURRENT STATE AND LOCAL REGULATIONS, APPROVED SWPPP, AND PERMIT REQUIREMENTS.

SEQUENCE OF MAJOR ACTIVITIES

1. INSTALL STABILIZED CONSTRUCTION ENTRANCE AND TEMPORARY EROSION CONTROL MEASURES PER APPROVED SWPPP IF REQUIRED.
2. DEMOLISH EXISTING SITE WORK DESIGNATED FOR REMOVAL.
3. COMPLETE MAJOR GRADING OF SITE.
4. CONSTRUCT BUILDING PAD, STORMWATER SYSTEM, AND SITE UTILITIES.
5. CONSTRUCT PARKING LOT.
6. WHEN ALL CONSTRUCTION ACTIVITY IS COMPLETE AND SITE IS STABILIZED, REMOVE ALL INLET PROTECTION, SILT BARRIERS, AND SEDIMENT THAT HAS BEEN TRAPPED BY THESE DEVICES.
7. CONSULT APPROVED SWPPP FOR CONDITIONS RELATED TO NOTICE OF TERMINATION, IF REQUIRED.

EROSION AND SEDIMENT CONTROLS AND STABILIZATION PRACTICES

STABILIZATION SHALL BE INITIATED ON ALL LOAM STOCKPILES AND DISTURBED AREAS WHERE CONSTRUCTION ACTIVITY WILL NOT OCCUR FOR MORE THAN TWENTY ONE (21) CALENDAR DAYS BY THE FOURTEENTH (14TH) DAY AFTER CONSTRUCTION ACTIVITY HAS PERMANENTLY OR TEMPORARILY CEASED IN THAT AREA. ALL DISTURBED AREAS SHALL BE STABILIZED WITHIN 45 DAYS OF INITIAL DISTURBANCE. AN AREA SHALL BE CONSIDERED STABLE IF ONE OF THE FOLLOWING HAS OCCURRED:

1. BASE COURSE GRAVELS, WHICH MEET THE REQUIREMENTS OF NHDOT STANDARD FOR ROAD AND BRIDGE CONSTRUCTION, 2016, ITEM 304.2, HAVE BEEN INSTALLED IN AREAS TO BE PAVED;
2. A MINIMUM OF 85% VEGETATED GROWTH HAS BEEN ESTABLISHED;
3. A MINIMUM OF 3" OF NON-EROSIVE MATERIAL, SUCH AS STONE OR RIPRAP HAS BEEN INSTALLED; OR
4. EROSION CONTROL BLANKETS HAVE BEEN PROPERLY INSTALLED.

DURING CONSTRUCTION, RUNOFF WILL BE DIVERTED AROUND THE SITE WITH EARTH DIKES, PIPING OR STABILIZED CHANNELS WHERE POSSIBLE. SHEET RUNOFF FROM THE SITE WILL BE FILTERED THROUGH SILT BARRIERS. ALL STORM DRAIN INLETS SHALL BE PROVIDED WITH BARRIER FILTERS. STONE RIPRAP SHALL BE PROVIDED AT THE OUTLETS OF DRAINAGE PIPES WHERE EROSION VELOCITIES ARE ENCOUNTERED.

OFF SITE VEHICLE TRACKING

STABILIZED CONSTRUCTION ENTRANCES SHALL BE INSTALLED.

INSTALLATION, MAINTENANCE AND INSPECTION OF EROSION AND SEDIMENT CONTROLS

A. GENERAL

THESE ARE THE GENERAL INSPECTION AND MAINTENANCE PRACTICES THAT WILL BE USED TO IMPLEMENT THE PLAN.

1. STABILIZATION OF ALL SWALES, DITCHES, AND PONDS IS REQUIRED PRIOR TO DIRECTING FLOW TO THEM.
2. THE SMALLEST PRACTICAL PORTION OF THE SITE WILL BE DEVEUED AT ONE TIME. (5 AC MAX)
3. ALL CONTROL MEASURES WILL BE INSPECTED AT LEAST ONCE EACH WEEK AND FOLLOWING ANY STORM EVENT OF 0.10" OR GREATER.
4. ALL MEASURES WILL BE MAINTAINED IN GOOD WORKING ORDER. IF A REPAIR IS NECESSARY, IT WILL BE INITIATED WITHIN 24 HOURS OF REPORT.
5. BUILT UP SEDIMENT WILL BE REMOVED FROM SILT BARRIER WHEN IT HAS REACHED ONE THIRD THE HEIGHT OF THE BARRIER.
6. ALL DIVERSION DIKES WILL BE INSPECTED AND ANY BREACHES PROMPTLY REPAIRED.
7. TEMPORARY SEEDING AND PLANTING WILL BE INSPECTED FOR BARE SPOTS, WASHOUTS, AND UNHEALTHY GROWTH.
8. A MAINTENANCE INSPECTION REPORT WILL BE MADE AFTER EACH INSPECTION.
9. THE CONTRACTOR'S SITE SUPERINTENDENT WILL BE RESPONSIBLE FOR INSPECTIONS, MAINTENANCE AND REPAIR ACTIVITIES, AND FILLING OUT THE INSPECTION AND MAINTENANCE REPORT.

B. FILTERS / BARRIERS

1. SILT SOCKS
    - A. KNOTTED MESH NETTING MATERIAL SHALL BE DELIVERED TO SITE IN A 5 MIL CONTINUOUS, TUBULAR, HOPE 3/8" MATERIAL, FILLED WITH COMPOST CONFORMING TO THE FOLLOWING REQUIREMENTS:

PHYSICAL PROPERTY	TEST	REQUIREMENTS
PH	IMECC 04.11-A	5.0 TO 8.0
PARTICLE SIZE	IMECC 02.02-B	2" SIEVE AND MIN. 60% GREATER THAN THE 8" SIEVE
MOISTURE CONTENT	STNO TESTING	< 60%

MATERIAL SHALL BE RELATIVELY FREE OF INERT OR FOREIGN MAN-MADE MATERIALS
    - MATERIAL SHALL BE WEED FREE AND DERIVED FROM A WELL-DECOMPOSED SOURCE OF ORGANIC MATTER, FREE FROM ANY REFUSE, CONTAMINANTS OR OTHER MATERIALS TOXIC TO PLANT GROWTH.
  - B. SEDIMENT COLLECTED AT THE BASE OF THE SILT SOCK SHALL BE REMOVED ONCE IT HAS REACHED 1/3 OF THE EXPOSED HEIGHT OF THE SILT SOCK.
  - C. SILT BARRIER SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFUL PURPOSE, BUT NOT BEFORE THE UPSLOPE AREAS HAS BEEN PERMANENTLY STABILIZED.
2. SEQUENCE OF INSTALLATION

SEDIMENT BARRIERS SHALL BE INSTALLED PRIOR TO ANY SOIL DISTURBANCE OF THE CONTRIBUTING DRAINAGE AREA ABOVE THEM.

3. MAINTENANCE
  - A. SILT BARRIERS SHALL BE INSPECTED WEEKLY AND IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. THEY SHALL BE REPAIRED IF THERE ARE ANY SIGNS OF EROSION OR SEDIMENTATION BELOW THEM. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY. IF THERE ARE SIGNS OF UNDERCUTTING AT THE CENTER OR THE EDGES, OR IMPOUNDING OF LARGE VOLUMES OF WATER BEHIND THEM, SEDIMENT BARRIERS SHALL BE REPLACED WITH A TEMPORARY CHECK DAM.
  - B. SHOULD THE FABRIC DECOMPOSE OR BECOME INEFFECTIVE PRIOR TO THE END OF THE EXPECTED USABLE LIFE AND THE BARRIER STILL IS NECESSARY, THE FABRIC SHALL BE REPLACED PROMPTLY.
  - C. SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH STORM EVENT. THEY MUST BE REMOVED WHEN DEPOSITS REACH APPROXIMATELY ONE THIRDO (1/3) THE HEIGHT OF THE BARRIER.
  - D. ANY SEDIMENT DEPOSITS REMAINING IN PLACE AFTER THE SILT BARRIER IS NO LONGER REQUIRED SHALL BE DRESSED TO CONFORM WITH THE EXISTING GRADE, PREPARED AND SEEDED.

C. MULCHING

1. TIMING

IN ORDER FOR MULCH TO BE EFFECTIVE, IT MUST BE IN PLACE PRIOR TO MAJOR STORM EVENTS. THERE ARE TWO (2) TYPES OF STANDARDS WHICH SHALL BE USED TO ASSURE THIS:

- A. APPLY MULCH PRIOR TO ANY STORM EVENT.

THIS IS APPLICABLE WHEN WORKING WITHIN 100' OF WETLANDS. IT WILL BE NECESSARY TO CLOSELY MONITOR WEATHER PREDICTIONS, USUALLY BY CONTACTING THE NATIONAL WEATHER SERVICE, TO HAVE ADEQUATE WARNING OF SIGNIFICANT STORMS.

- B. REQUIRED MULCHING WITHIN A SPECIFIED TIME PERIOD.

THE TIME PERIOD CAN RANGE FROM 14 TO 21 DAYS OF INACTIVITY ON AN AREA, WHERE THE LENGTH OF TIME VARIES WITH SITE CONDITIONS. PROFESSIONAL JUDGMENT SHALL BE USED TO EVALUATE THE INTERACTION OF SITE CONDITIONS (SOIL ERODIBILITY, SEASON OF YEAR, EXTENT OF DISTURBANCE, PROXIMITY TO SENSITIVE RESOURCES, ETC.) AND THE POTENTIAL IMPACT OF EROSION ON ADJACENT AREAS TO CHOOSE AN APPROPRIATE TIME RESTRICTION.

2. GUIDELINES FOR WINTER MULCH APPLICATION.

WHEN MULCH IS APPLIED TO PROVIDE PROTECTION OVER WINTER (PAST THE GROWING SEASON) IT SHALL BE AT A RATE OF 6,000 POUNDS OF HAY OR STRAW PER ACRE. A TACKIFIER MAY BE ADDED TO THE MULCH.

3. MAINTENANCE

ALL MULCHES MUST BE INSPECTED PERIODICALLY, IN PARTICULAR AFTER RAINSTORMS, TO CHECK FOR RILL EROSION. IF LESS THAN 90% OF THE SOIL SURFACE IS COVERED BY MULCH, ADDITIONAL MULCH SHALL BE IMMEDIATELY APPLIED.

D. VEGETATIVE PRACTICE

1. AFTER ROUGH GRADING OF THE SUBGRADE HAS BEEN COMPLETED AND APPROVED, THE SUB GRADE SURFACE SHALL BE SCARIFIED TO A DEPTH OF 4". THEM, FURNISH AND INSTALL A LAYER OF LOAM PROVIDING A ROLLED THICKNESS AS SPECIFIED IN THESE PLANS. ANY DEPRESSIONS WHICH MAY OCCUR DURING ROLLING SHALL BE FILLED WITH ADDITIONAL LOAM, REGRADED AND REROLLED UNTIL THE SURFACE IS TRUE TO THE FINISHED LINES AND GRADES. ALL LOAM NECESSARY TO COMPLETE THE WORK UNDER THIS SECTION SHALL BE SUPPLIED BY THE SITE SUBCONTRACTOR.
2. ALL LARGE STIFF CLODS, LUMPS, BRUSH, ROOTS, DEBRIS, GLASS, STUMPS, LITTER, AND OTHER FOREIGN MATERIAL, AS WELL AS STONES OVER 1" IN DIAMETER, SHALL BE REMOVED FROM THE LOAM AND DISPOSED OF OFF SITE. THE LOAM SHALL BE RAKED SMOOTH AND EVEN.
3. THE LOAM SHALL BE PREPARED TO RECEIVE SEED BY REMOVING STONES, FOREIGN OBJECTS AND GRADING TO ELIMINATE WATER POCKETS AND IRREGULARITIES PRIOR TO PLACING SEED. FINISH GRADING SHALL RESULT IN STRAIGHT UNIFORM GRADES AND SMOOTH, EVEN SURFACES WITHOUT IRREGULARITIES TO LOW POINTS.
4. SHAPE THE AREAS TO THE LINES AND GRADES REQUIRED. THE SITE SUBCONTRACTOR'S ATTENTION IS DIRECTED TO THE SCHEDULING OF LOAMING AND SEEDING OF GRADED AREAS TO PERMIT SUFFICIENT TIME FOR THE STABILIZATION OF THESE AREAS. IT SHALL BE THE SITE SUBCONTRACTOR'S RESPONSIBILITY TO MAINTAIN THE AREAS DURING THE CONSTRUCTION PERIOD AND REGRADE, LOAM AND RESEED ANY DAMAGED AREAS.
5. ALL AREAS DISTURBED BY CONSTRUCTION WITHIN THE PROPERTY LINES AND NOT COVERED BY STRUCTURES, PAVEMENT, OR MULCH SHALL BE LOAMED AND SEEDED.
6. LIMESTONE SHALL BE THOROUGHLY INCORPORATED INTO THE LOAM LAYER AT A RATE OF 2 TONS PER ACRE IN ORDER TO PROVIDE A PH VALUE OF 5.5 TO 6.5.
7. FERTILIZER SHALL BE SPREAD ON THE TOP LAYER OF LOAM AND WORKED INTO THE SURFACE. FERTILIZER APPLICATION RATE SHALL BE 500 POUNDS PER ACRE OF 10-20-20 FERTILIZER.
8. SOIL CONDITIONERS AND FERTILIZER SHALL BE APPLIED AT THE RECOMMENDED RATES AND SHALL BE THOROUGHLY WORKED INTO THE LOAM. LOAM SHALL BE RAKED UNTIL THE SURFACE IS FINELY PULVERIZED, SMOOTH AND EVEN, AND THEN COMPACTED TO AN EVEN SURFACE CONFORMING TO THE REQUIRED LINES AND GRADES WITH APPROVED ROLLERS WEIGHING BETWEEN 4 1/2 POUNDS AND 5 1/2 POUNDS PER INCH OF WIDTH.
9. SEED SHALL BE SOWN AT THE RATE SHOWN BELOW. SOWING SHALL BE DONE ON A CALM, DRY DAY, PREFERABLY BY MACHINE, BUT IF BY HAND, ONLY BY EXPERIENCED WORKMEN. IMMEDIATELY BEFORE SEEDING, THE SOIL SHALL BE LIGHTLY RAKED. ONE HALF THE SEED SHALL BE SOWN IN ONE DIRECTION AND THE OTHER HALF AT RIGHT ANGLES TO THE ORIGINAL DIRECTION. IT SHALL BE LIGHTLY RAKED INTO THE SOIL TO A DEPTH NOT OVER 1/4" AND ROLLED WITH A HAND ROLLER WEIGHING NOT OVER 100 POUNDS PER LINEAR FOOT OF WIDTH.
10. HAY MULCH SHALL BE APPLIED IMMEDIATELY AFTER SEEDING AT A RATE OF 1.5 TO 2 TONS PER ACRE. MULCH THAT BLOWS OR WASHES AWAY SHALL BE REPLACED IMMEDIATELY AND ANCHORED USING APPROPRIATE TECHNIQUES FROM THE EROSION AND SEDIMENT CONTROL HANDBOOK.
11. THE SURFACE SHALL BE WATERED AND KEPT MOIST WITH A FINE SPRAY AS REQUIRED, WITHOUT WASHING AWAY THE SOIL, UNTIL THE GRASS IS WELL ESTABLISHED. ANY AREAS WHICH ARE NOT SATISFACTORILY COVERED WITH GRASS SHALL BE RESEDED, AND ALL NOXIOUS WEEDS REMOVED.
12. THE SITE SUBCONTRACTOR SHALL PROTECT AND MAINTAIN THE SEEDED AREAS UNTIL ACCEPTED, INCLUDING CUTTING, AS SPECIFIED HEREIN AFTER UNDER MAINTENANCE AND PROTECTION.
13. UNLESS OTHERWISE APPROVED, SEEDING SHALL BE DONE DURING THE APPROXIMATE PERIODS OF EARLY SPRING TO SEPTEMBER 30, WHEN SOIL CONDITIONS AND WEATHER ARE SUITABLE FOR SUCH WORK. IN NO CASE SHALL THE WEED CONTENT EXCEED 1 PERCENT BY WEIGHT. ALL SEED SHALL COMPLY WITH STATE AND FEDERAL SEED LAWS, FOR TEMPORARY PLANTINGS AFTER SEPTEMBER 30, TO EARLY SPRING AND FOR TEMPORARY PROTECTION OF DISTURBED AREAS:

A. FOLLOW ABOVE SLOPE, LOAM DEPTH AND GRADING REQUIREMENTS.	
B. FERTILIZER SHALL BE SPREAD AND WORKED INTO THE SURFACE AT A RATE OF 500 POUNDS PER ACRE.	
MULCHING AND SEEDING SHALL BE APPLIED AT THE FOLLOWING RATES:	
WINTER RYE (FALL SEEDING)	2.5 LBS/1,000 SF
OATS (SPRING SEEDING)	2.0 LBS/1,000 SF
MULCH	1.5 TONS/ACRE

E. CATCH BASIN INLET PROTECTION

1. INLET BASKET STRUCTURE

- A. INLET PROTECTION SHALL BE INSTALLED IMMEDIATELY PRIOR TO DISTURBING PAVEMENT AND SHALL REMAIN IN PLACE AND MAINTAINED UNTIL PAVEMENT BINDER COURSE IS COMPLETE.
- B. MOLD 6X6, 42 LB. WIRE SUPPORT AROUND INLET FRAME AND GRATE AND EXTEND 6" BEYOND SIDES. SECURE FILTER FABRIC TO WIRE SUPPORT.
- C. THE FILTER FABRIC SHALL BE A GEOTEXTILE FABRIC: POLYESTER, POLYPROPYLENE, STABILIZED NYLON, POLYETHYLENE OR POLYVINYLIDENE CHLORIDE MEETING THE FOLLOWING SPECIFICATIONS:

GRAB STRENGTH: 45 LB. MINIMUM IN ANY PRINCIPAL DIRECTION (ASTM D1682)
MULLEN BURST STRENGTH: MIN. 60PSI (ASTM D774)
- D. THE FABRIC SHALL HAVE AN OPENING NO GREATER THAN A NUMBER 20 U.S. STANDARD SIEVE AND A MINIMUM PERMEABILITY OF 120 GPM.
- E. THE INLET PROTECTION SHALL BE INSPECTED WITHIN 24 HOURS AFTER EACH RAINFALL OR DAILY DURING EXTENDED PERIODS OF PRECIPITATION. REPAIRS SHALL BE MADE IMMEDIATELY, AS NECESSARY, TO PREVENT PARTICLES FROM REACHING THE DRAINAGE SYSTEM AND/OR CAUSING SURFACE FLOODING.
- F. SEDIMENT DEPOSITS SHALL BE REMOVED AFTER EACH STORM EVENT, OR MORE OFTEN IF THE FABRIC BECOMES CLOGGED.

F. WINTER CONSTRUCTION SEQUENCE

1. ALL PROPOSED POST-DEVELOPMENT LANDSCAPED AREAS WHICH DO NOT EXHIBIT A MINIMUM OF 85% VEGETATIVE GROWTH BY OCTOBER 15TH, OR WHICH ARE DISTURBED AFTER OCTOBER 15TH, SHALL BE STABILIZED BY SEEDING AND INSTALLING EROSION CONTROL BLANKETS ON SLOPES GREATER THAN 3:1 AND SEEDING AND PLACING 3 TO 4 TONS OF MULCH PER ACRE, SECURED WITH ANCHORED NETTING, ELSEWHERE. THE PLACEMENT OF EROSION CONTROL BLANKETS OR MULCH AND NETTING SHALL NOT OCCUR OVER ACCUMULATED SNOW OR ON FROZEN GROUND AND SHALL BE COMPLETED IN ADVANCE OF THAW OR SPRING MELT EVENT.
2. ALL DITCHES OR SWALES WHICH DO NOT EXHIBIT A MINIMUM OF 85% VEGETATIVE GROWTH BY OCTOBER 15TH, OR WHICH ARE DISTURBED AFTER OCTOBER 15TH, SHALL BE STABILIZED WITH STONE OR EROSION CONTROL BLANKETS APPROPRIATE FOR THE DESIGN FLOW CONDITIONS.
3. AFTER OCTOBER 15TH, INCOMPLETE PARKING AREAS WHERE ACTIVE CONSTRUCTION HAS STOPPED FOR THE WINTER ALL TRAVEL SURFACES SHALL BE PROTECTED WITH A MINIMUM OF 3" OF CRUSHED GRAVEL PER NHDOT ITEM 304.3, OR IF CONSTRUCTION IS TO CONTINUE THROUGH THE WINTER SEASON BE CLEARED OF ANY ACCUMULATED SNOWFALL AFTER EACH STORM EVENT.

TIMING OF CONTROLS/MEASURES

AS INDICATED IN THE SEQUENCE OF MAJOR ACTIVITIES, SILT BARRIERS SHALL BE INSTALLED PRIOR TO COMMENCING ANY CLEARING OR GRADING OF THE SITE. STRUCTURAL CONTROLS SHALL BE INSTALLED CONCURRENTLY WITH THE APPLICABLE ACTIVITY. AREAS WHERE CONSTRUCTION ACTIVITY TEMPORARILY CEASES FOR MORE THAN TWENTY ONE (21) DAYS WILL BE STABILIZED WITH A TEMPORARY SEED AND MULCH WITHIN FOURTEEN (14) DAYS OF THE LAST DISTURBANCE. ONCE CONSTRUCTION ACTIVITY CEASES PERMANENTLY IN AN AREA, SILT BARRIERS AND ANY EARTH/DIKES WILL BE REMOVED ONCE PERMANENT MEASURES ARE ESTABLISHED.

WASTE DISPOSAL

1. WASTE MATERIALS  
ALL WASTE MATERIALS WILL BE COLLECTED AND STORED IN SECURELY LIDDED RECEPCTABLES. ALL TRASH AND CONSTRUCTION DEBRIS FROM THE SITE WILL BE DEPOSITED IN A DUMPSTER. NO CONSTRUCTION WASTE MATERIALS WILL BE BURIED ON SITE. ALL PERSONNEL WILL BE INSTRUCTED REGARDING THE CORRECT PROCEDURE FOR WASTE DISPOSAL BY THE SUPERINTENDENT.
2. HAZARDOUS WASTE  
ALL HAZARDOUS WASTE MATERIALS WILL BE DISPOSED OF IN THE MANNER SPECIFIED BY LOCAL OR STATE REGULATION OR BY THE MANUFACTURER. SITE PERSONNEL WILL BE INSTRUCTED IN THESE PRACTICES BY THE SUPERINTENDENT.
3. SANITARY WASTE  
ALL SANITARY WASTE WILL BE COLLECTED FROM THE PORTABLE UNITS A MINIMUM OF ONCE PER WEEK BY A LICENSED SANITARY WASTE MANAGEMENT CONTRACTOR.

SPILL PREVENTION

1. MATERIAL MANAGEMENT PRACTICES  
THE FOLLOWING ARE THE MATERIAL MANAGEMENT PRACTICES THAT WILL BE USED TO REDUCE THE RISK OF SPILLS OR OTHER ACCIDENTAL EXPOSURE OF MATERIALS AND SUBSTANCES DURING CONSTRUCTION TO STORMWATER RUNOFF:

A. AN EFFORT WILL BE MADE TO STORE ONLY SUFFICIENT AMOUNTS OF PRODUCTS TO DO THE JOB.
B. ALL MATERIALS STORED ON SITE WILL BE STORED IN A NEAT, ORDERLY MANNER IN THEIR PROPER (ORIGINAL IF POSSIBLE) CONTAINERS AND, IF POSSIBLE, UNDER A ROOF OR OTHER ENCLOSURE.
C. MANUFACTURER'S RECOMMENDATIONS FOR PROPER USE AND DISPOSAL WILL BE FOLLOWED.
D. THE SITE SUPERINTENDENT WILL INSPECT DAILY TO ENSURE PROPER USE AND DISPOSAL OF MATERIALS.
E. SUBSTANCES WILL NOT BE MIXED WITH ONE ANOTHER UNLESS RECOMMENDED BY THE MANUFACTURER.
F. WHENEVER POSSIBLE ALL OF A PRODUCT WILL BE USED UP BEFORE DISPOSING OF THE CONTAINER.

HAZARDOUS PRODUCTS:  
THE FOLLOWING PRACTICES WILL BE USED TO REDUCE THE RISKS ASSOCIATED WITH HAZARDOUS MATERIALS:

A. PRODUCTS WILL BE KEPT IN THEIR ORIGINAL CONTAINERS UNLESS THEY ARE NOT RESEALABLE.
B. ORIGINAL LABELS AND MATERIAL SAFETY DATA WILL BE RETAINED FOR IMPORTANT PRODUCT INFORMATION.
C. SURPLUS PRODUCT THAT MUST BE DISPOSED OF WILL BE DISCARDED ACCORDING TO THE MANUFACTURER'S RECOMMENDED METHODS OF DISPOSAL.
2. PRODUCT SPECIFICATION PRACTICES  
THE FOLLOWING PRODUCT SPECIFIC PRACTICES WILL BE FOLLOWED ON SITE:

PETROLEUM PRODUCTS:

ALL ON SITE VEHICLES WILL BE MONITORED FOR LEAKS AND RECEIVE REGULAR PREVENTIVE MAINTENANCE TO REDUCE LEAKAGE. PETROLEUM PRODUCTS WILL BE STORED IN TIGHTLY SEALED CONTAINERS WHICH ARE CLEARLY LABELED. ANY ASPHALT BASED SUBSTANCES USED ON SITE WILL BE APPLIED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS.

FERTILIZERS:

FERTILIZERS USED WILL BE APPLIED ONLY IN THE MINIMUM AMOUNTS DIRECTED BY THE SPECIFICATIONS. ONCE APPLIED FERTILIZER WILL BE WORKED INTO THE SOIL TO LIMIT EXPOSURE TO STORMWATER. STORAGE WILL BE IN A COVERED SHED OR ENCLOSED TRAILERS. THE CONTENTS OF ANY PARTIALLY USED BAGS OF FERTILIZER WILL BE TRANSFERRED TO A SEALABLE PLASTIC BIN TO AVOID SPILLS.

PAINTS:

ALL CONTAINERS WILL BE TIGHTLY SEALED AND STORED WHEN NOT REQUIRED FOR USE. EXCESS PAINT WILL NOT BE DISCHARGED TO THE STORM SEWER SYSTEM BUT WILL BE DISPOSED OF PROPERLY ACCORDING TO MANUFACTURER'S INSTRUCTIONS OR STATE AND LOCAL REGULATIONS.

CONCRETE TRUCKS:

CONCRETE TRUCKS WILL DISCHARGE AND WASH OUT SURPLUS CONCRETE OR DRUM WASH WATER IN A CONTAINED AREA DESIGNATED ON SITE.

SPILL CONTROL PRACTICES

IN ADDITION TO GOOD HOUSEKEEPING AND MATERIAL MANAGEMENT PRACTICES DISCUSSED IN THE PREVIOUS SECTION THE FOLLOWING PRACTICES WILL BE FOLLOWED FOR SPILL PREVENTION AND CLEANUP:

- A. MANUFACTURER'S RECOMMENDED METHODS FOR SPILL CLEANUP WILL BE CLEARLY POSTED AND SITE PERSONNEL WILL BE MADE AWARE OF THE PROCEDURES AND THE LOCATION OF THE INFORMATION AND CLEANUP SUPPLIES.
- B. MATERIALS AND EQUIPMENT NECESSARY FOR SPILL CLEANUP WILL BE KEPT IN THE MATERIAL STORAGE AREA ON SITE. EQUIPMENT AND MATERIALS WILL INCLUDE BUT NOT BE LIMITED TO BROOMS, DUSTPANS, VOPS, RAGS, GLOVES, GOGGLES, KITTY LITTER, SAND, SAWDUST, AND PLASTIC OR METAL TRASH CONTAINERS SPECIFICALLY FOR THIS PURPOSE.
- C. ALL SPILLS WILL BE CLEANED UP IMMEDIATELY AFTER DISCOVERY.
- D. THE SPILL AREA WILL BE KEPT WELL VENTILATED AND PERSONNEL WILL WEAR APPROPRIATE PROTECTIVE CLOTHING TO PREVENT INJURY FROM CONTACT WITH A HAZARDOUS SUBSTANCE.
- E. SPILLS OF TOXIC OR HAZARDOUS MATERIAL WILL BE REPORTED TO THE APPROPRIATE STATE OR LOCAL GOVERNMENT AGENCY, REGARDLESS OF THE SIZE.
- F. THE SPILL PREVENTION PLAN WILL BE ADJUSTED TO INCLUDE MEASURES TO PREVENT THIS TYPE OF SPILL FROM RECURRING AND HOW TO CLEANUP THE SPILL IF IT RECURS. A DESCRIPTION OF THE SPILL, ITS CAUSE, AND THE CLEANUP MEASURES WILL BE INCLUDED.
- G. THE SITE SUPERINTENDENT RESPONSIBLE FOR DAY-TO-DAY SITE OPERATIONS WILL BE THE SPILL PREVENTION AND CLEANUP COORDINATOR.

DUST CONTROL

THE CONTRACTOR SHALL BE RESPONSIBLE TO CONTROL DUST THROUGHOUT THE CONSTRUCTION PERIOD. DUST CONTROL METHODS SHALL INCLUDE, BUT NOT LIMITED TO SPRINKLING WATER ON EXPOSED AREAS, COVERING LOADED DUMP TRUCKS LEAVING THE SITE, AND TEMPORARY MULCHING. DUST CONTROL MEASURES SHALL BE UTILIZED SO AS TO PREVENT THE MIGRATION OF DUST FROM THE SITE TO ABUTTING AREAS.

SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7  
**EROSION CONTROL NOTES**  
**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**  
OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

**1"=80' (11"X17")**  
**SCALE: 1"=60' (22"X34")**

**JUNE 1, 2021**

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

**47159.02**

**C-11**

Copyright 2020 ©Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.





Jul 09, 2021 - 7:51am  
F:\WSC Projects\47159 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\Design\PRODUCTION DRAWINGS\47159-02 - Truck - WB.dwg



MAP 114 LOT 2  
N/F  
400 NORTH MAIN STREET, LLC  
549 US HIGHWAY 1 BYPASS  
PORTSMOUTH, NH 03801  
SCRD BK. #4759 PG. #883

MAP 114 LOT 6  
N/F  
401 NORTH MAIN STREET, LLC  
549 US HIGHWAY 1 BYPASS  
PORTSMOUTH, NH 03801  
SCRD BK. #4759 PG. #943  
"KEY AUTO DEALERSHIP"

WB-67 TRUCK  
TURNING MOVEMENT  
(TYP)

PROP  
DRAINAGE  
EASEMENT

NORTH MAIN STREET  
(Public Right-of-Way)

PROPOSED VEHICLE SALES  
1 STORY  
21,765 SF FOOTPRINT  
FFE=230±

ZONE X  
(0.25)

75' COD  
COCHECO RIVER BUFFER

660' BALD EAGLE BUFFER

EDGE OF RIVER

EDGE OF WETLANDS

DITCH

50' COD  
WETLAND BUFFER

DITCH

EDGE OF WETLANDS

EMBARMENT

400' BALD EAGLE BUFFER

50' COD  
WETLAND BUFFER

ZONE X  
(0.25)

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

ZONE AE  
EL=226

MAP 114 LOT 8  
N/F  
MAINLY ROCHESTER PIZZA, LLC  
P. O. BOX 66749  
PORTSMOUTH, ME 04105  
SCRD BK. #2425 PG. #804  
"DUNKIN' DONUTS"

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



HORIZONTAL SCALE 1"=40'  
40 20 0 40

REV	DATE	DESCRIPTION	HEG	CHK
1	7/9/2021	REVISED PER TRG COMMENTS	HEG	CHK

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7  
WB-67 TRUCK TURNING PLAN  
PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH  
OWNED BY & PREPARED FOR  
401 NORTH MAIN STREET LLC

1"=80' (11"X17")  
SCALE: 1"=40' (22"X34")

JUNE 1, 2021

Seacoast Division




Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02 DR HEG FB  
CK CRR CADFILE 47159-02\_TRUCK\_WB

C-12




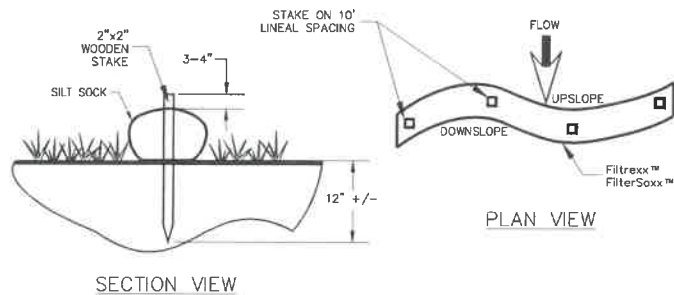

- NOTES:
1. SILT SOCK SHALL BE FILTREXX™ SILT SOCK™ NATURAL ORIGINAL OR APPROVED EQUIVALENT.
  2. ALL MATERIAL AND SIZES TO MEET FILTREXX SPECIFICATIONS.
  3. COMPOST MATERIAL SHALL BE DISPERSED ON SITE, AS DETERMINED BY THE ENGINEER.
  4. SILT SOCK SHALL BE INSPECTED PERIODICALLY AND AFTER ALL STORM EVENTS, AND REPAIR OR REPLACEMENT SHALL BE PERFORMED AS NEEDED.

### FILTREXX™ FILTERSOXX™ STAKING



NOT TO SCALE

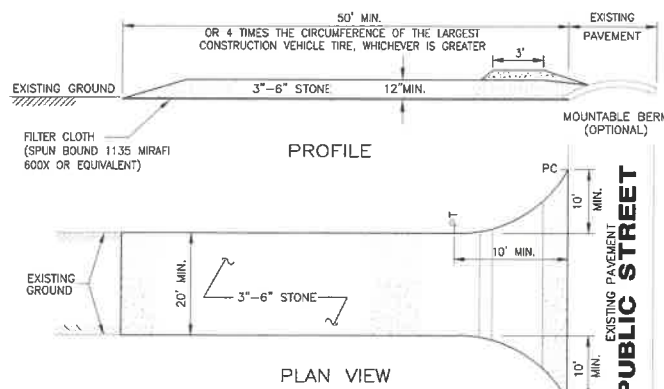

- NOTES:
1. FILTER CLOTH - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE SURFACE.
  2. WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
  3. MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
  4. WASHING - WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
  5. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN STORM EVENT.

### STABILIZED CONSTRUCTION ENTRANCE


NOT TO SCALE

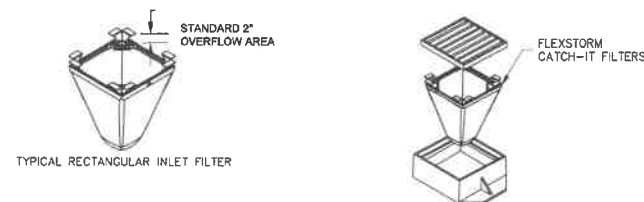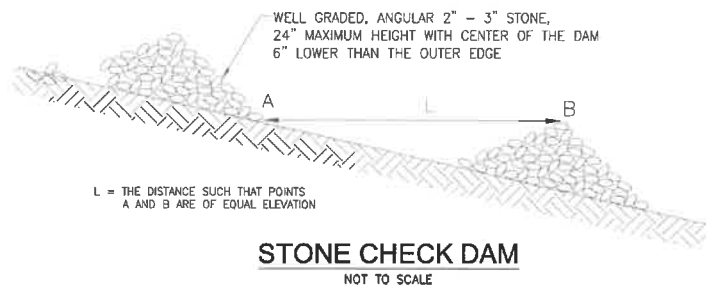

- NOTES:
1. INSTALL PER MANUFACTURER'S SPECIFICATIONS.
  2. INSPECTION SHOULD OCCUR FOLLOWING ANY RAIN EVENT  $> \frac{1}{2}$ ".
  3. EMPTY THE SEDIMENT BAG PER MANUFACTURER'S SPECIFICATIONS.
  4. REMOVED CAKED ON SILT FROM SEDIMENT BAG AND FLUSH WITH MEDIUM SPRAY WITH OPTIMAL FILTRATION.
  5. REPLACE BAG IF TORN OR PUNCTURED TO  $> \frac{1}{2}$ " DIAMETER ON LOWER HALF OF BAG.
- ALL PRODUCTS MANUFACTURED BY INLET & PIPE PROTECTION, INC. A DIVISION OF ADS, INC. WWW.INLETFILTERS.COM (866) 287-8655 INFO@INLETFILTERS.COM

### INLET PROTECTION


NOT TO SCALE

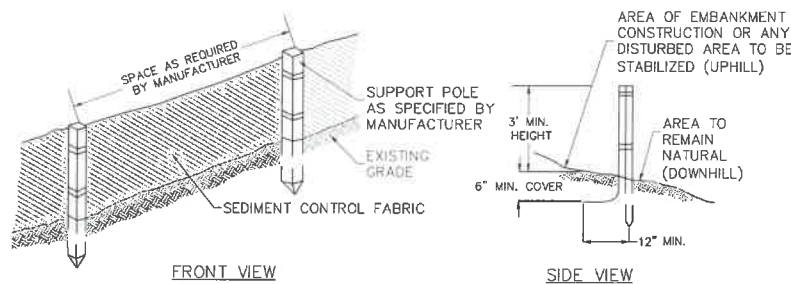

- NOTES:
1. THE GEOTEXTILE FABRIC SHALL MEET THE DESIGN CRITERIA FOR BEST MANAGEMENT PRACTICE FOR SILT FENCES, OF THE NEW HAMPSHIRE STORMWATER MANUAL, DECEMBER 2008.
  2. THE HEIGHT OF THE BARRIER SHALL NOT EXCEED 36 INCHES.
  3. WHEN JOINTS ARE NECESSARY, FILTER CLOTH SHALL BE SPLICED TOGETHER ONLY AT A SUPPORT POST, WITH A MINIMUM 6-INCH OVERLAP, AND SECURELY SEALED. SEE MANUFACTURER'S RECOMMENDATIONS.
  4. POSTS SHALL BE SPACED A MAXIMUM OF 10 FEET APART AT THE BARRIER LOCATION AND DRIVEN SECURELY INTO THE GROUND (MINIMUM OF 16 INCHES). WHEN EXTRA STRENGTH FABRIC IS USED WITHOUT THE WIRE SUPPORT FENCE, POST SPACING SHALL BE AS MANUFACTURER RECOMMENDS.
  5. A TRENCH SHALL BE EXCAVATED APPROXIMATELY 6 INCHES WIDE AND 6 INCHES DEEP ALONG THE LINE OF POSTS AND UPSLOPE FROM THE BARRIER IN ACCORDANCE WITH RECOMMENDATIONS.
  6. THE FABRIC SHALL NOT EXTEND MORE THAN 36 INCHES ABOVE THE ORIGINAL GROUND SURFACE, AND WILL EXTEND TO A MINIMUM OF 8 INCHES INTO THE TRENCH. FILTER FABRIC SHALL NOT BE STAPLED INTO EXISTING TREES.
  7. THE TRENCH SHALL BE BACKFILLED AND THE SOIL COMPACTED OVER THE FILTER FABRIC.
  8. FILTER BARRIERS SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFUL PURPOSE, BUT NOT BEFORE THE UPSLOPE AREA HAS BEEN PERMANENTLY STABILIZED.
  9. FILTER BARRIERS SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL, AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.
  10. SHOULD THE FABRIC DECOMPOSE OR BECOME INEFFECTIVE PRIOR TO THE END OF THE EXPECTED USABLE LIFE AND THE BARRIER STILL BE NECESSARY, THE FABRIC SHALL BE REPLACED PROMPTLY.
  11. SEDIMENT DEPOSITS SHOULD BE REMOVED WHEN THEY REACH APPROXIMATELY ONE-THIRD THE HEIGHT OF THE BARRIER.
  12. ANY SEDIMENT DEPOSITS REMAINING IN PLACE AFTER THE SILT FENCE OR FILTER BARRIER IS NO LONGER REQUIRED, SHALL BE DRESSED TO CONFORM TO THE EXISTING GRADE, PREPARED AND SEEDED.

### SILT FENCE


NOT TO SCALE

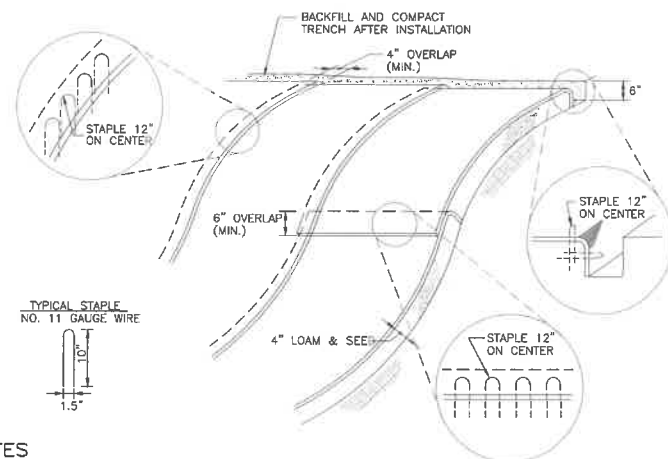

- NOTES:
1. INSTALL AT DISTURBED LOCATIONS WITH 2:1 SLOPES OR GREATER AND AS INDICATED PER PLANS.
  2. BEGIN AT THE TOP OF BLANKET INSTALLATION AREA BY ANCHORING BLANKET IN A 6" DEEP TRENCH. BACKFILL AND COMPACT TRENCH AFTER STAPLING.
  3. ROLL THE BLANKET DOWN THE SLOPE OR SWALE IN THE DIRECTION OF THE WATER FLOW.
  4. THE EDGES OF BLANKETS MUST BE STAPLED WITH APPROX. 4 INCH OVERLAP WHERE 2 OR MORE STRIP WIDTHS ARE REQUIRED.
  5. WHEN BLANKETS MUST BE SPLICED DOWN THE SWALE, PLACE BLANKET END OVER END WITH 6 INCH (MIN.) OVERLAP AND ANCHOR DOWN SLOPE BLANKET IN A 6 INCH DEEP TRENCH.
  6. BLANKET SHALL BE NORTH AMERICAN GREEN C125BN, EAST COAST EROSION CONTROL ECG-2B, AMERICAN EXCELSIOR COMPANY CURLEX III FIBRENET, ROLANKA GEONATURAL EROSION & SEDIMENT CONTROL MATTE JUTEMAT OR BIOD-OCT 30, OR APPROVED EQUAL.
  7. BLANKET SHALL BE PLACED WITHIN 24-HRS AFTER SOWING SEE IN THE AREA BEING COVERED

### EROSION CONTROL BLANKET



NOT TO SCALE

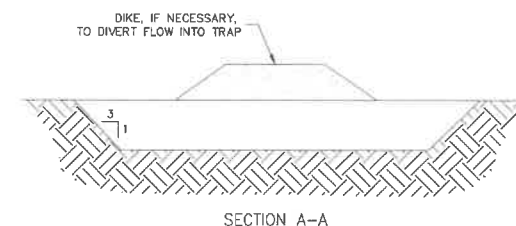

- NOTES:
1. SEDIMENT TRAP TO BE USED AS NECESSARY TO CONTAIN RUNOFF UNTIL BASINS/PONDS ARE STABILIZED. IF IT IS DETERMINED THAT CONSTRUCTION OF A SEDIMENT TRAP IS WARRANTED, CONSULT WITH ENGINEER TO DETERMINE APPROPRIATE NUMBER AND DIMENSIONS.
  2. 3,600 CF OF BASIN STORAGE IS REQUIRED FOR EVERY ACRE OF CONTRIBUTING DRAINAGE AREA.

### SEDIMENT TRAP


NOT TO SCALE

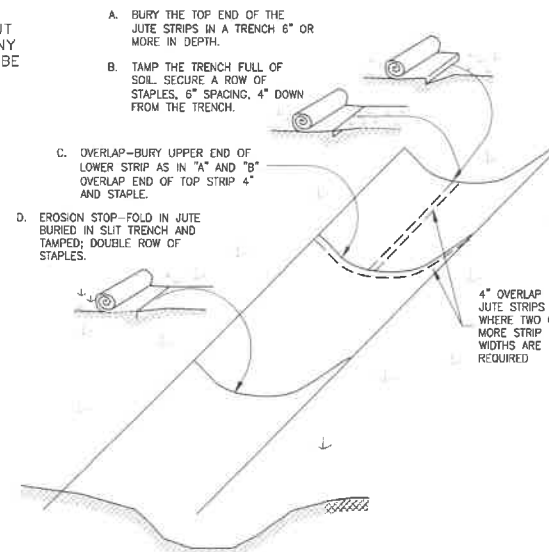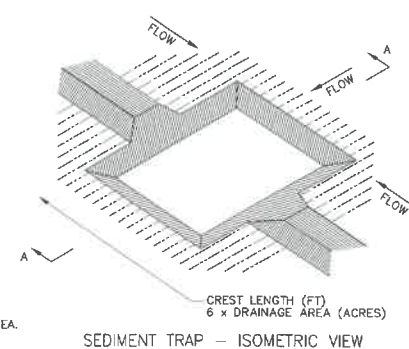

- NOTES:
1. MATTING SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS, INCLUDING STAPLE PATTERNS.
  2. STAPLES SHALL BE BIODEGRADABLE.

### JUTE MATTING

NOT TO SCALE

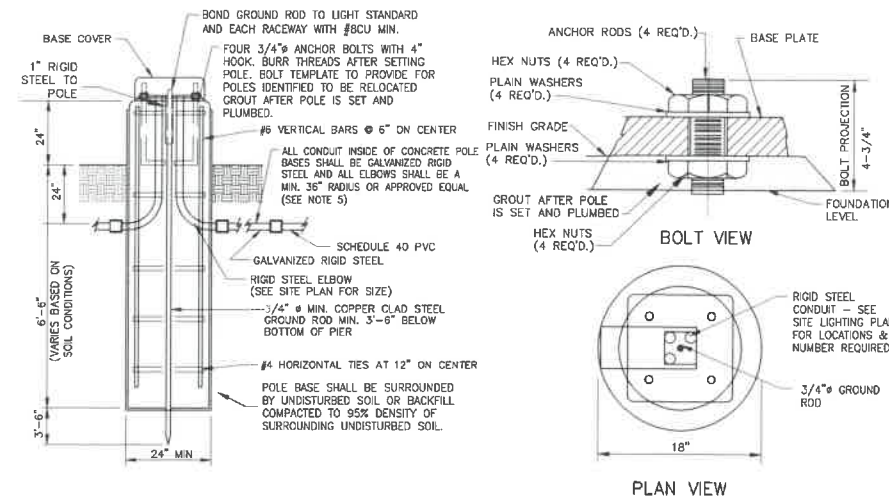

- NOTES:
1. CONCRETE TO BE 4000 PSI.
  2. BASE SHALL BE USED FOR ALL POLES WITH FIXTURE MOUNTING HEIGHT LESS THAN 25-FEET.
  3. POLE BASES TO BE SET A MINIMUM OF 4'-0" FROM EDGE OF PAVEMENT, EXCEPT WHERE OTHERWISE INDICATED ON DRAWING.
  4. BASE HEIGHT SHALL BE 2'-0" ABOVE PAVEMENT GRADE WHEN BASE IS WITHIN 2' OF PAVEMENT EDGE.
  5. EQUIVALENTS MUST MEET NATIONAL ELECTRICAL CODE AND LOCAL/STATE REQUIREMENTS

### LIGHT POLE BASE (24" MOUNTING HEIGHT)

NOT TO SCALE

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

### DETAILS

**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**  
 OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

SCALE: NTS

JUNE 1, 2021

Seacoast Division



Civil Engineers  
 Structural Engineers  
 Traffic Engineers  
 Land Surveyors  
 Landscape Architects  
 Scientists

170 Commerce Way, Suite 102  
 Portsmouth, NH 03801  
 Phone (603) 431-2222  
 Fax (603) 431-0910  
 www.tfmoran.com

47159.02

DR HEG FB  
 CK CRR CADFILE

47159-02\_DETAILS


C-13

REV	DATE	DESCRIPTION	HEG	CRR
1	7/9/2021	REVISED PER TRG COMMENTS	HEG	CRR





Jul 09, 2021 - 7:48am  
F:\WSC Projects\47159-02 - North Main St - Rochester\47159-02 - 0 - No Main Street - AUTO DEALERSHIP\Design\PRODUCTION DRAWINGS\47159-02\_Details.dwg

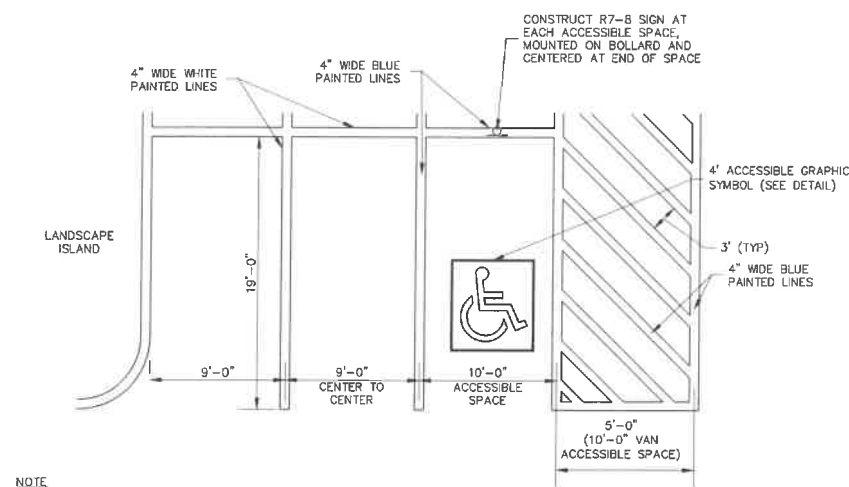


#### NOTE

1. TRAFFIC PAINT SHALL BE APPLIED AS SPECIFIED BY THE MANUFACTURER AND SHALL MEET THE REQUIREMENTS OF AASHTO M248 TYPE "F". APPLY TWO COATS.
2. SYMBOLS & PARKING STALLS SHALL CONFORM TO THE REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT, LATEST EDITION.
3. ALL PAINTED ISLANDS SHALL BE 4" WIDE DIAGONAL LINES AT 3'-0" OC BORDERED BY 4" WIDE LINES.
4. 2% MAXIMUM CROSS SLOPE ALLOWED IN ACCESSIBLE PARKING SPACES AND ACCESS AISLES.

### TYPICAL PARKING LAYOUT

NOT TO SCALE

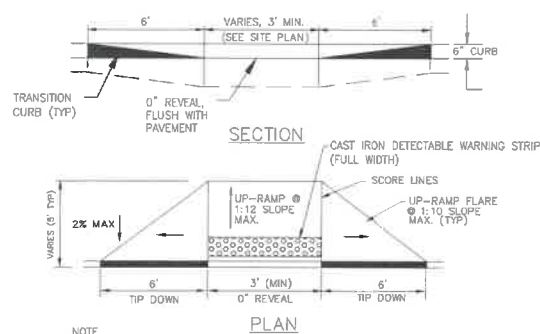


#### NOTE

1. RAMPS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE AMERICAN WITH DISABILITIES ACT, LATEST EDITION AND NHDOT SIDEWALK CURB RAMP DETAILS.

### STANDARD ACCESSIBLE RAMP (TYPE A)

NOT TO SCALE

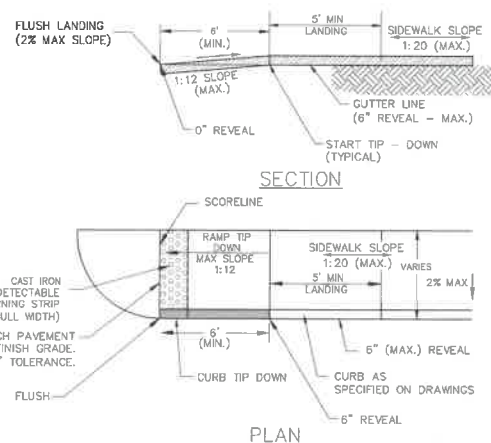


#### NOTE

1. RAMPS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE AMERICAN WITH DISABILITIES ACT, LATEST EDITION AND NHDOT SIDEWALK CURB RAMP DETAILS.

### SIDEWALK TIP DOWN RAMP (TYPE B)

NOT TO SCALE

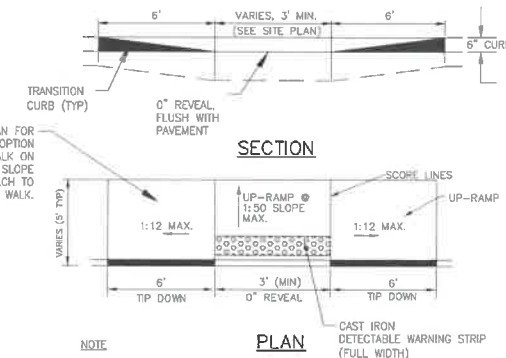


#### NOTE

1. RAMPS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE AMERICAN WITH DISABILITIES ACT, LATEST EDITION AND NHDOT SIDEWALK CURB RAMP DETAILS.

### SIDEWALK TIP DOWN RAMP (TYPE C)

NOT TO SCALE

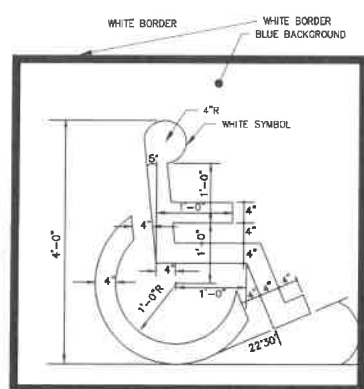


#### NOTES

1. TRAFFIC PAINT SHALL BE APPLIED AS SPECIFIED BY THE MANUFACTURER AND SHALL MEET THE REQUIREMENTS OF AASHTO M248 TYPE "F". APPLY TWO COATS.
2. SYMBOLS AND PARKING STALLS SHALL CONFORM TO THE REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT, LATEST EDITION.

### ACCESSIBLE GRAPHIC SYMBOL

NOT TO SCALE

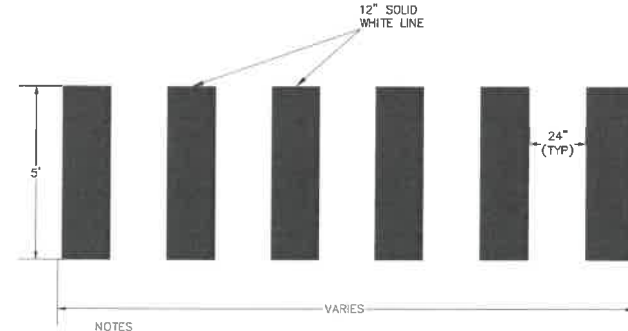


#### NOTES

1. TRAFFIC PAINT SHALL BE APPLIED AS SPECIFIED BY THE MANUFACTURER AND SHALL MEET THE REQUIREMENTS OF AASHTO M248 TYPE "F". APPLY TWO COATS.
2. CROSSWALK PAVEMENT MARKINGS SHALL BE INSTALLED IN LOCATIONS SHOWN ON THE PLANS WITHIN THE PROPOSED DEVELOPMENT ONLY. FOR CROSSWALK PAVEMENT MARKINGS WITHIN THE NHDOT RIGHT OF WAY, REFER TO THE "PLANS FOR SIGNALIZATION IMPROVEMENTS".

### ON-SITE CROSSWALK STRIPING

NOT TO SCALE

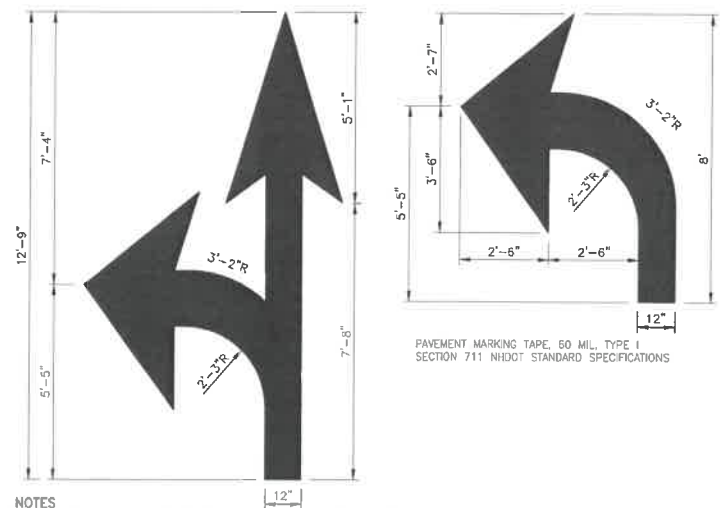


#### NOTES

1. ALL PAVEMENT MARKINGS WITHIN THE RIGHT OF WAY AND TRAFFIC SIGNS SHALL BE PLACED IN ACCORDANCE WITH THE GUIDE LINES OUTLINED IN THE MOST CURRENT EDITION OF THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD).
2. THE FURNISHING AND PLACING OF WHITE OR YELLOW PAVEMENT MARKINGS WITHIN THE RIGHT OF WAY SHALL CONFORM TO THE REQUIREMENTS OF THE N.H. DEPARTMENT OF TRANSPORTATION'S CURRENT STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION SECTION 632 REFLECTORIZED PAVEMENT MARKINGS. TRAFFIC PAINT NOT WITHIN THE RIGHT OF WAY SHALL BE APPLIED AS SPECIFIED BY THE MANUFACTURER AND SHALL MEET THE REQUIREMENTS OF AASHTO M248 TYPE "F". APPLY TWO COATS.
3. ALL CENTERLINES, EDGE LINES, AND LANE LINES SHALL BE 4 INCHES IN WIDTH. STOP BARS SHALL BE 18 INCHES WIDE.
4. SYMBOLS AND PARKING STALLS SHALL CONFORM TO THE REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT, LATEST EDITION.

### PAVEMENT MARKINGS

NOT TO SCALE

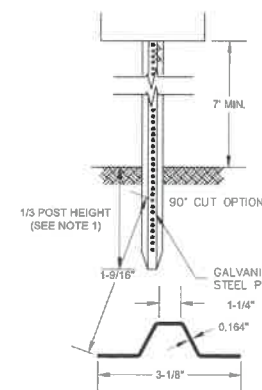


LENGTH: AS REQUIRED  
WEIGHT PER LINEAR FOOT: 2.50 LBS (MIN)  
HOLES: 3/8" DIAMETER, 1" C-C FULL LENGTH  
STEEL: SHALL CONFORM TO ASTM A-499 (GRADE 60) OR ASTM A-576 (GRADE 1070 - 1080)  
FINISH: SHALL BE PAINTED WITH 2 COATS OF AN APPROVED MEDIUM GREEN BAKED-ON OR AIR-DRIED PAINT OF WEATHER RESISTANT QUALITY. ALL FABRICATION SHALL BE COMPLETE BEFORE PAINTING.

#### NOTE

1. WHERE LEDGE APPLICATION EXISTS, DRILL & GROUT TO A MINIMUM OF 2'.
2. ALL SIGNAGE SHALL FOLLOW THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES STANDARDS AND NHDOT STANDARDS.
3. SIGN, HARDWARE, AND INSTALLATION SHALL CONFORM TO THE LATEST NHDOT STANDARD SPECIFICATIONS.

### SIGN POST


NOT TO SCALE

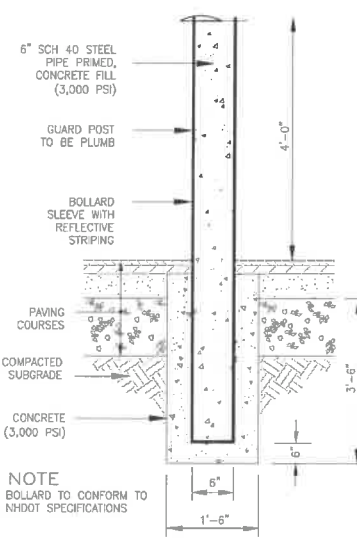

NOTE  
BOLLARD TO CONFORM TO NHDOT SPECIFICATIONS

### BOLLARD

NOT TO SCALE

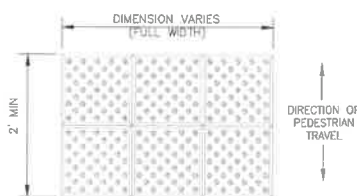


#### NOTES

1. DETECTABLE WARNING STRIP TO BE CAST-IRON (NHDOT ITEM 608.54), MANUFACTURED AND INSTALLED IN ACCORDANCE WITH THE AMERICAN WITH DISABILITIES ACT, LATEST EDITION.
2. MANUFACTURER SHALL BE NEENAH FOUNDARY CATALOG NO. 4984 (SPECIFY WIDTH), OR APPROVED EQUAL.
3. DETECTABLE WARNING STRIPS SHALL BE THE FULL WIDTH OF THE LANDING, BLENDED TRANSITION, OR CURB RAMP THEY ARE A PART OF AND SHALL BE A MINIMUM OF 2 FEET IN DEPTH.
4. THE ROWS OF TRUNCATED DOMES SHALL BE ALIGNED PERPENDICULAR TO THE GRADE BREAK BETWEEN THE RAMP, BLENDED TRANSITION OR LANDING AND THE STREET.

### DETECTABLE WARNING STRIP

NOT TO SCALE




#### NOTES

1. TRAFFIC PAINT SHALL BE APPLIED AS SPECIFIED BY THE MANUFACTURER AND SHALL MEET THE REQUIREMENTS OF AASHTO M248 TYPE "F". APPLY TWO COATS.
2. SYMBOL SHALL CONFORM TO THE REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT, LATEST EDITION.

### STOP BAR & LEGEND

NOT TO SCALE

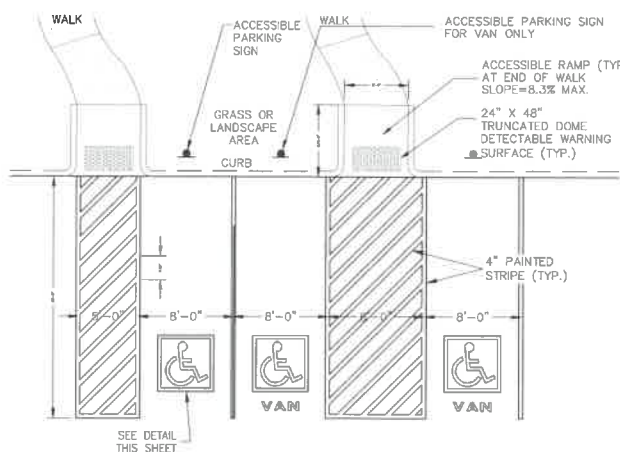

### ACCESSIBLE RAMP AT END OF WALK

NOT TO SCALE

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

### DETAILS

### PROPOSED AUTO DEALERSHIP

0 NORTH MAIN STREET, ROCHESTER, NH

OWNED BY & PREPARED FOR

401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

DR HEG  
CK CRR

PB  
CADFILE


-

47159-02\_DETAILS

C-14


REV	DATE	DESCRIPTION	HEG	CRR
1	7/9/2021	REVISED PER TRG COMMENTS	HEG	CRR



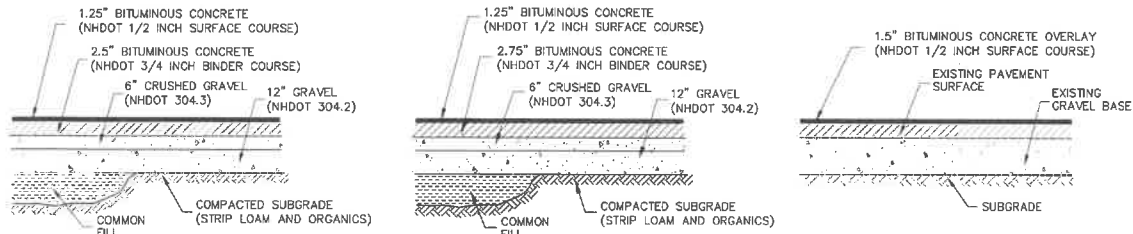


- NOTES**
1. SEE GRADING & EROSION CONTROL PLAN FOR PAVEMENT SLOPE AND CROSS-SLOPE.
  2. PROVIDE CLEAN BUTT TO EXISTING PAVEMENT-- USE TACK COAT. A TACK COAT SHALL ALSO BE PLACED BETWEEN GRAVEL COURSE AND SUCCESSIVE LAYERS OF BITUMINOUS CONCRETE. SPECIFICALLY, A TACK COAT SHALL BE PLACED ATOP THE BINDER COURSE PAVEMENT PRIOR TO PLACING THE WEARING COURSE.
  3. REMOVE ALL LOAM AND/OR YIELDING MATERIAL BELOW PAVEMENT.
  4. BITUMINOUS MATERIALS SHALL CONFORM TO NHDOT SPECIFICATION SECTION 401.
  5. BITUMINOUS CONCRETE SHALL BE COMPACTED TO AT LEAST 92-97% OF THEORETICAL MAXIMUM DENSITY AS DETERMINED BY ASTM D2041. PLACEMENT TEMPERATURES OF BITUMINOUS CONCRETE MIXES, IN GENERAL, RANGE BETWEEN 270 AND 310 DEGREES FAHRENHEIT.
  6. PAVEMENT BASE COURSE AGGREGATE SHALL CONFORM TO NHDOT SPECIFICATION SECTION 304, ITEM 304.3 AND COMPACTED TO A MINIMUM OF 95% OF ASTM D-1557.
  7. PAVEMENT SUBBASE COURSE AGGREGATE AND AGGREGATE FOR SUBGRADE REPAIR AREAS SHALL BE SUITABLE FOR USE AS STRUCTURAL FILL AND BE PROOF ROLLED AND COMPACTED TO 95% OF ASTM D-1557.
  8. THE EXPOSED SOIL SUBGRADE SHOULD BE PROOF ROLLED PRIOR TO THE PLACEMENT OF SUBBASE GRAVEL, AND SOFT AREAS SHOULD BE REPAIRED AND REPLACED.
  9. SEE SITE LAYOUT PLAN FOR HEAVY DUTY LOCATIONS. ALL OTHER LOCATIONS SHALL BE STANDARD DUTY.
  10. EXACT AREAS TO RECEIVE FULL-DEPTH PAVEMENT SECTION BASE AND SUB-BASE SHALL BE DETERMINED IN FIELD AT THE TIME OF CONSTRUCTION.

**PAVEMENT SECTION**  
NOT TO SCALE

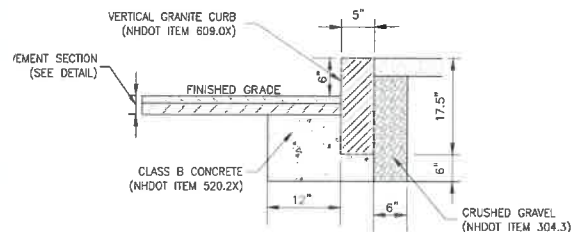


- NOTES**
1. MORTAR JOINTS AND OTHER INSTALLATION TO BE AS SPECIFIED IN NHDOT SECTION 609.
  2. ADJOINING STONES SHALL HAVE THE SAME OR APPROXIMATELY THE SAME LENGTH.

**VERTICAL GRANITE CURB**  
NOT TO SCALE

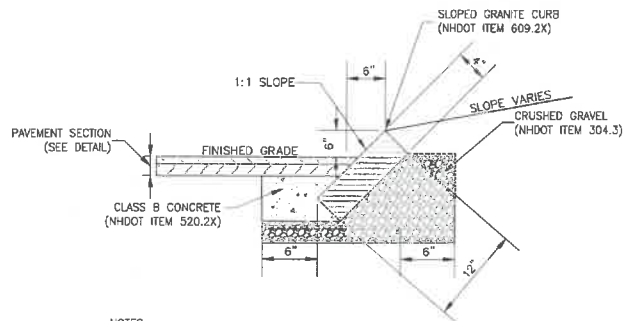


- NOTES**
1. MORTAR JOINTS AND OTHER INSTALLATION TO BE AS SPECIFIED IN NHDOT SECTION 609.
  2. ADJOINING STONES SHALL HAVE THE SAME OR APPROXIMATELY THE SAME LENGTH.

**SLOPED GRANITE CURB**  
NOT TO SCALE


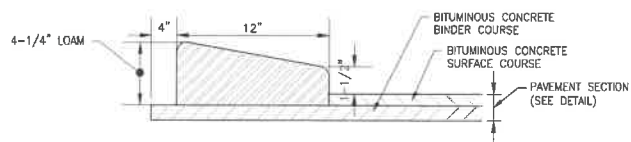


**CAPE CODE BERM WITH REVEAL**  
NOT TO SCALE

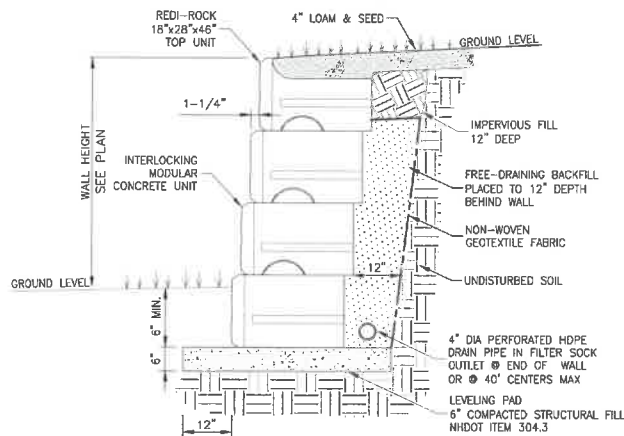


- NOTES**
1. THIS DETAIL IS ONLY FOR WALLS LESS THAN 4 FEET IN HEIGHT.
  2. FINAL WALL DESIGN SHALL BE SUBJECT TO THE RECOMMENDATIONS OF THE GEOTECHNICAL ENGINEER.

**UNREINFORCED RETAINING WALL  
(MODULAR CONCRETE UNIT)**  
NOT TO SCALE

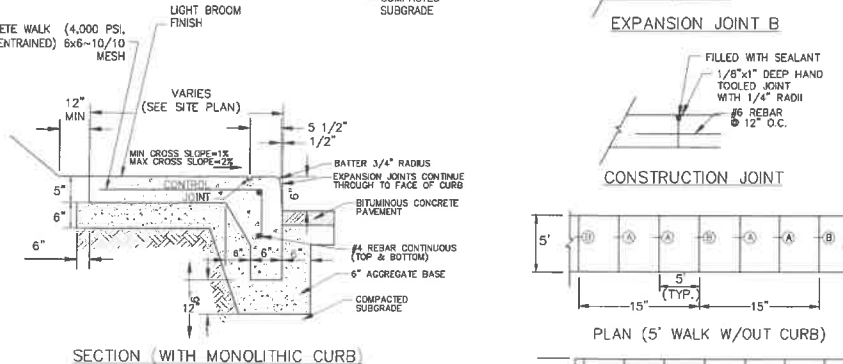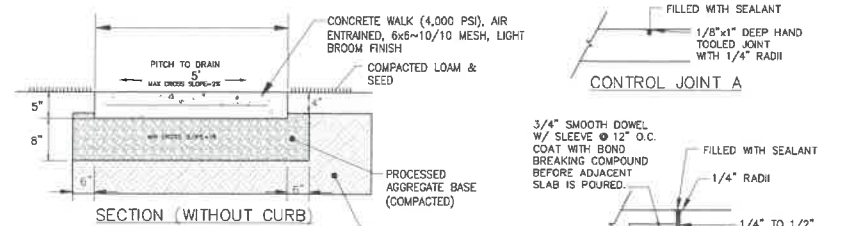


**SECTION (WITH MONOLITHIC CURB)**

**CONCRETE SIDEWALK**  
NOT TO SCALE

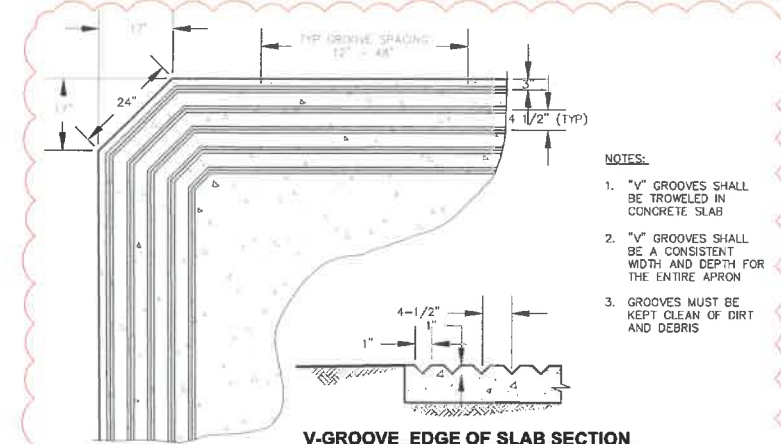







- NOTES:**
1. "V" GROOVES SHALL BE TROWELED IN CONCRETE SLAB
  2. "V" GROOVES SHALL BE A CONSISTENT WIDTH AND DEPTH FOR THE ENTIRE APRON
  3. GROOVES MUST BE KEPT CLEAN OF DIRT AND DEBRIS

**V-GROOVE EDGE OF SLAB SECTION**  
**POSITIVE LIMITING BARRIER**  
NOT TO SCALE

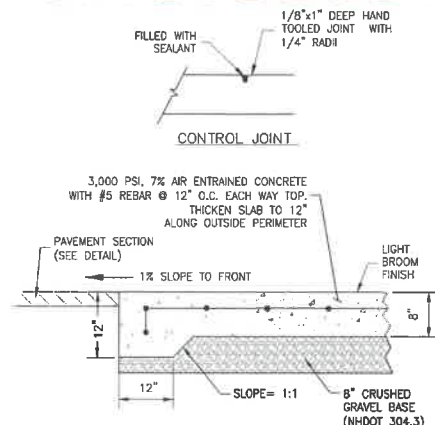


- NOTES**
1. PROVIDE CLEAN BUTT TO EXISTING PAVEMENT -- USE TACK COAT.


**CONCRETE PAD**  
NOT TO SCALE

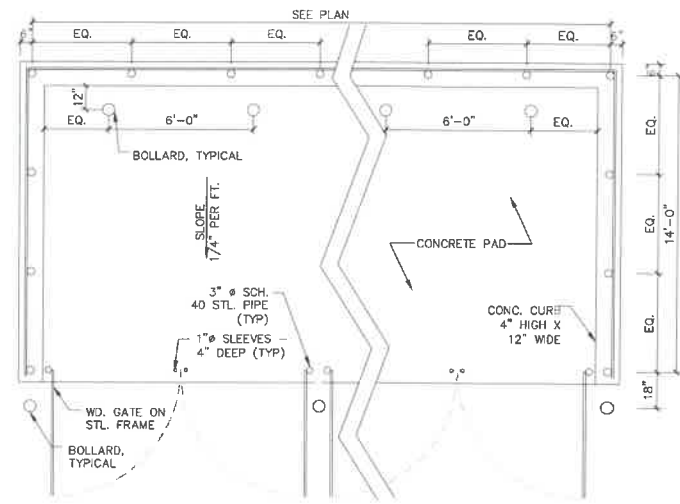

**PLAN VIEW**

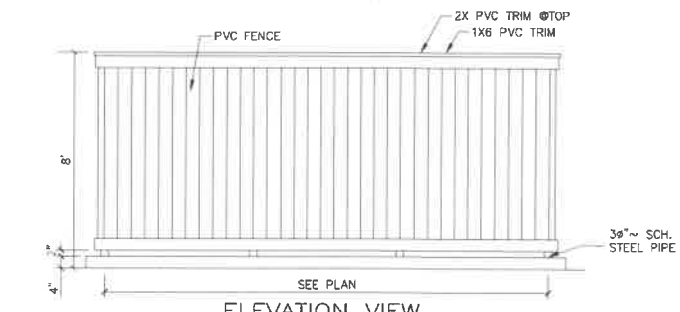

**ELEVATION VIEW**

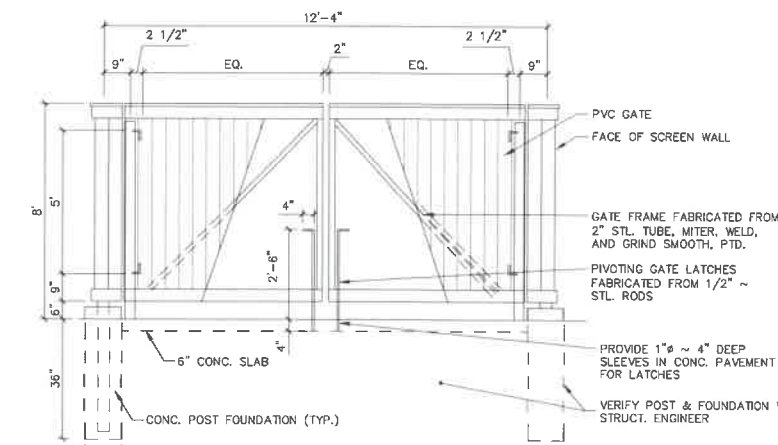

**GATE DETAIL**  
**VINYL DUMPSTER ENCLOSURE**  
NOT TO SCALE

**SITE DEVELOPMENT PLANS**

TAX MAP 114 LOT 7  
**DETAILS**

**PROPOSED AUTO DEALERSHIP**  
**0 NORTH MAIN STREET, ROCHESTER, NH**  
OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

SCALE: NTS

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

DR HEG FB

CK CRR CADFILE

47159-02\_DETAILS

C-15


Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.






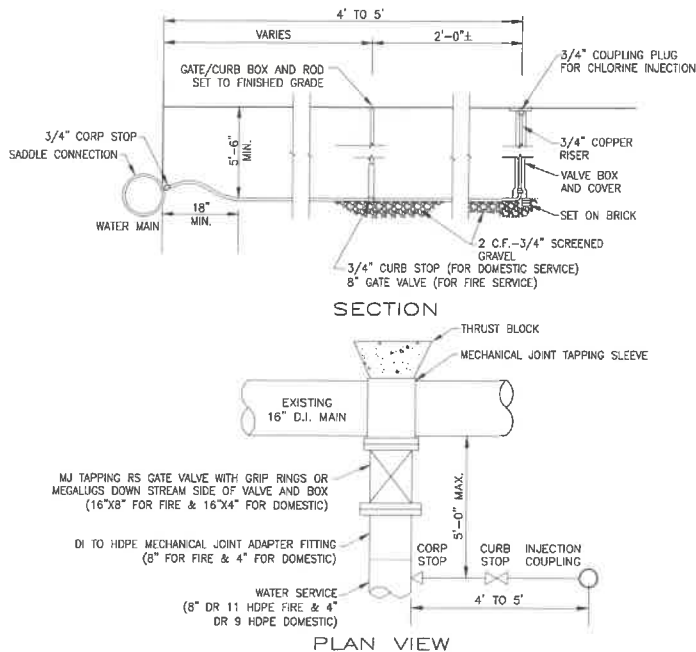


### CHLORINE INJECTION CONNECTION

NOT TO SCALE

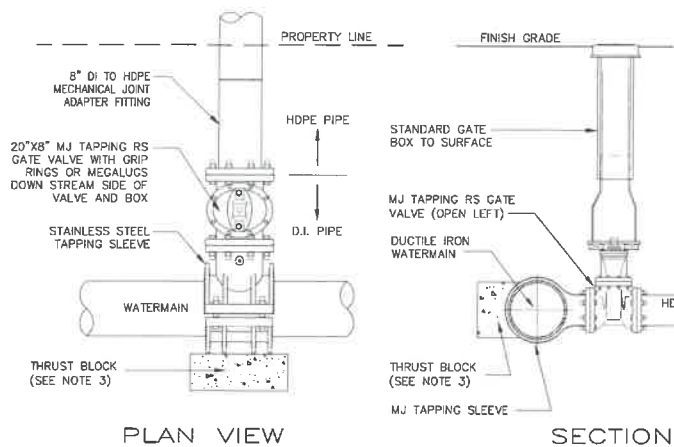


### WATER SERVICE WET TAP INSTALLATION

NOT TO SCALE

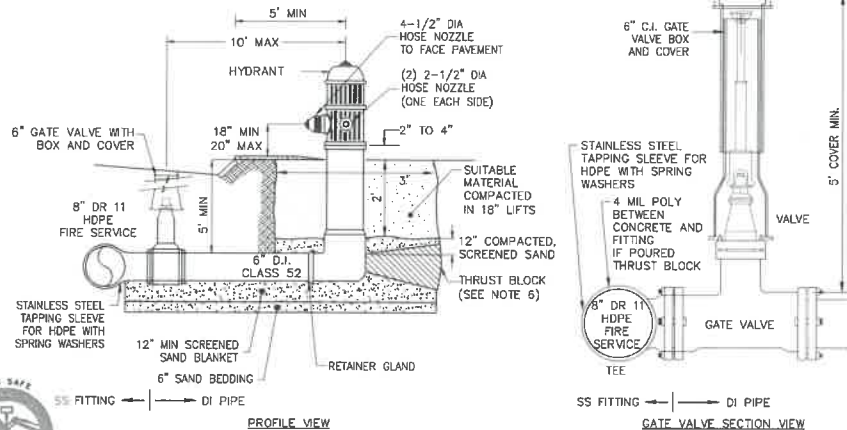


### FIRE HYDRANT & GATE VALVE

NOT TO SCALE

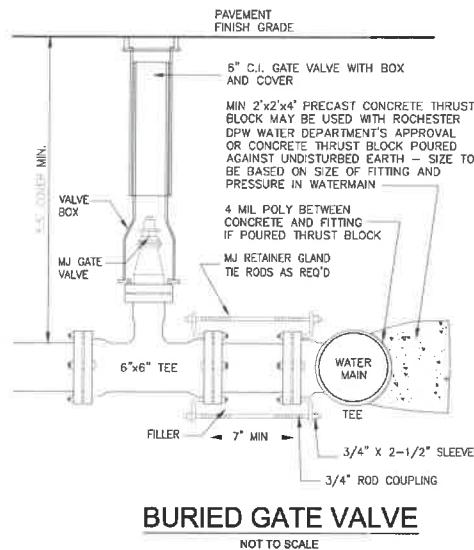


### BURIED GATE VALVE

NOT TO SCALE

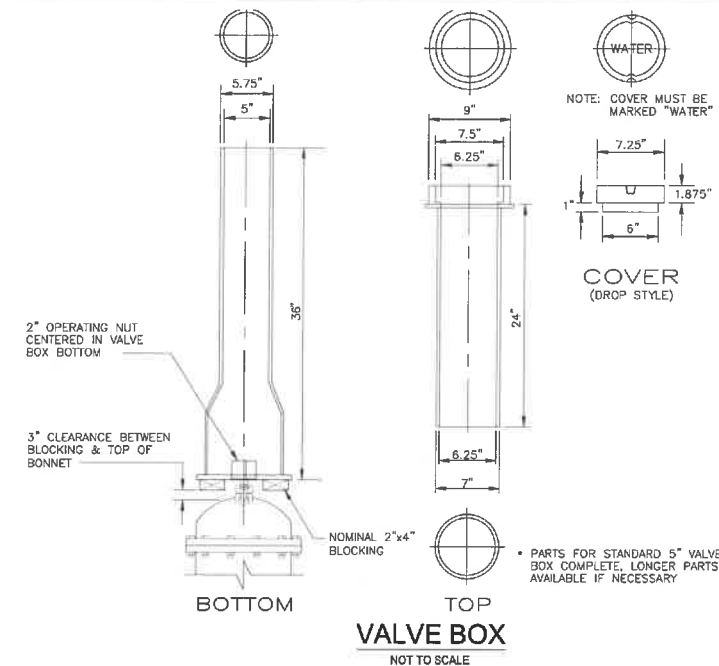

### VALVE BOX

NOT TO SCALE

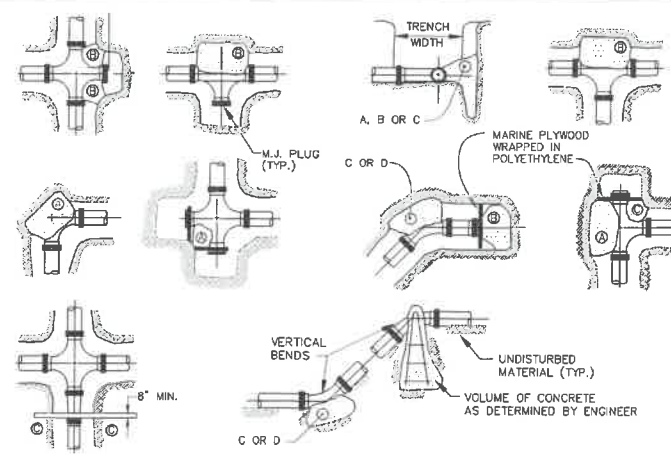

BEARING AREA REQUIRED, SQUARE FEET

TYPE OF BEARING MATERIAL AND ALLOWABLE LOADS, pfs	4" AND LESS DEGREE BEND				6" AND 8" DEGREE BEND				10" AND 12" DEGREE BEND			
	11 1/4	22 1/2	45	90	11 1/4	22 1/2	45	90	11 1/4	22 1/2	45	90
LOOSE SAND OR MEDIUM CLAY - 2,000	1.0	2.0	2.7	4.0	1.5	3.0	6.0	10.0	3.0	6.2	12.0	22.0
PACKED GRAVEL AND SAND - 4,000	1.0	1.0	1.5	2.0	1.0	1.5	3.0	5.0	1.5	3.1	6.0	11.0
ROCK - 10,000	1.0	1.0	1.0	1.0	1.0	1.0	1.2	2.0	1.0	1.3	2.4	4.4

BEARING AREA REQUIRED, SQUARE FEET

TYPE OF BEARING MATERIAL AND ALLOWABLE LOADS, pfs	14" AND 16" DEGREE BEND OR DEFLECTION				18" AND 20" DEGREE BEND OR DEFLECTION			
	11 1/4	22 1/2	45	90	11 1/4	22 1/2	45	90
LOOSE SAND OR MEDIUM CLAY - 2,000	6.0	12.0	22.5	40.0	9.5	19.0	37.0	67.0
PACKED GRAVEL AND SAND - 4,000	3.0	6.0	11.3	20.0	4.8	9.5	18.5	33.5
ROCK - 10,000	1.2	2.4	4.5	8.0	2.0	3.8	7.4	13.5

#### NOTES

- ALL MATERIAL, INSTALLATION PROCEDURES, MANUFACTURERS, AND DIMENSIONAL REQUIREMENTS SHALL CONFORM TO ROCHESTER'S INFRASTRUCTURE DESIGN STANDARDS AND ROCHESTER DPW'S ESTABLISHED RULES AND PROCEDURES.
- A PRECAST CONCRETE THRUST BLOCK IS PREFERRED BY ROCHESTER DPW AND MUST CONFORM TO ROCHESTER DPW'S INFRASTRUCTURE DESIGN STANDARDS.
- POUR THRUST BLOCKS AGAINST UNDISTURBED MATERIAL, WHERE TRENCH WALL HAS BEEN DISTURBED. EXCAVATE LOOSE MATERIAL AND EXTEND THRUST BLOCK TO UNDISTURBED MATERIAL. NO PIPE JOINTS SHALL BE COVERED WITH CONCRETE.
- ON BENDS AND TEES, EXTEND THRUST BLOCKS FULL LENGTH OF FITTING.
- PLACE BOARD IN FRONT OF ALL PLUGS BEFORE POURING THRUST BLOCKS. PLACE ROOFING FELT AROUND HYDRANT ELBOW BEFORE POURING THRUST BLOCKS AND ENSURE CONCRETE DOES NOT PLUG HYDRANT DRAIN PORTS.

### THRUST BLOCKS

NOT TO SCALE

#### NOTES

- ALL MATERIAL, INSTALLATION PROCEDURES, MANUFACTURERS, AND DIMENSIONAL REQUIREMENTS SHALL CONFORM TO ROCHESTER'S INFRASTRUCTURE DESIGN STANDARDS AND ROCHESTER DPW'S ESTABLISHED RULES AND PROCEDURES.
- IN LOCATIONS WITH EXISTING FILL SOILS, CONSULT WITH THE GEOTECHNICAL ENGINEER FOR METHODS TO PREPARE STABLE SUBGRADE AND REMOVAL OF MATERIAL IF NECESSARY.
- SUITABLE MATERIAL SHALL BE THE NATURAL MATERIAL EXCAVATED DURING THE COURSE OF CONSTRUCTION, BUT SHALL EXCLUDE DEBRIS, PIECES OF PAVEMENT, ORGANIC MATTER, TOP SOIL, ALL WET OR SOFT MUCK, PEAT OR CLAY, ALL EXCAVATED LEDGE MATERIAL, AND ALL ROCKS OVER 6" IN THE LARGEST DIMENSION, OR ANY MATERIAL WHICH, AS DETERMINED BY THE ENGINEER, WILL NOT PROVIDE SUFFICIENT SUPPORT OR MAINTAIN THE COMPLETED CONSTRUCTION IN A STABLE CONDITION. SUITABLE MATERIAL SHALL BE PLACED IN 12" LIFTS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
- RIGID STYROFOAM INSULATION (DOW HI-40 OR EQUAL) WITH 6" CLEAN SAND BLANKET AROUND WATER PIPE WHERE WATER AND DRAIN PIPE SEPARATION IS LESS THAN 18". TRACER WIRE SPECIFIED NON-METALLIC WATER LINES SHALL BE INSTALLED BELOW AND TO THE SIDE OF THE PIPE AND PER THE MANUFACTURER REQUIREMENTS. TRACER WIRE PRODUCT SHALL BE SELECTED FOR OPEN CUT INSTALLATION TECHNIQUE.

### WATER TRENCH

NOT TO SCALE

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

### DETAILS

### PROPOSED AUTO DEALERSHIP

0 NORTH MAIN STREET, ROCHESTER, NH

OWNED BY & PREPARED FOR

401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

DR HEG FB

CK CHR CADFILE

47159-02\_DETAILS

C-16

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.









## SEWER SERVICE NOTES

1) MINIMUM SIZE PIPE FOR SEWER SERVICE SHALL BE FOUR INCHES.

### 2) PIPE AND JOINT MATERIALS:

#### A. PLASTIC SEWER PIPE

1. PIPE AND FITTINGS SHALL CONFORM TO THE FOLLOWING ASTM STANDARDS:

ASTM STANDARDS	GENERIC PIPE MATERIAL	SIZES APPROVED
D3034	*PVC (SOLID WALL)	8" THROUGH 15" (SDR 35)
F679	PVC (SOLID WALL)	18" THROUGH 27" (T-1 & T-2)
F794	PVC (SOLID WALL)	4" THROUGH 18" (T-1 TO T-3)
F794	PVC (RIBBED WALL)	8" THROUGH 36"
D2680	*ABS (COMPOSITES WALL)	8" THROUGH 15"

\*PVC: POLY VINYL CHLORIDE

\*ABS: ACRYLONITRILE-BUTADIENE-STYRENE

2. JOINTS SEALS FOR PVC PIPE SHALL BE OIL RESISTANT COMPRESSION RINGS OF ELASTOMERIC MATERIAL CONFORMING TO ASTM D-3212 AND SHALL BE PUSH-ON, BELL AND SPIGOT TYPE.

ABS TRUSS PIPE AND FITTINGS SHALL CONFORM TO ASTM D-2680, POLYMER COMPOUNDING SHALL BE TO ASTM D-1788 (CLASS 322).

JOINTS FOR ABS TRUSS PIPE SHALL BE CHEMICAL WELDED COUPLINGS TYPE SC IN ACCORDANCE WITH ASTM D-2680, FORMING A CHEMICAL WELDED JOINT.

#### B. DUCTILE-IRON PIPE, FITTINGS AND JOINTS.

1. DUCTILE IRON PIPE AND FITTINGS SHALL CONFORM TO THE FOLLOWING STANDARDS OF THE UNITED STATES OF AMERICA STANDARDS INSTITUTE: A21.50 THICKNESS DESIGN OF DUCTILE IRON PIPE AND WITH ASTM A-536 DUCTILE IRON CASTINGS.

A21.51 DUCTILE IRON PIPE, CENTRIFUGALLY CAST IN METAL MOLDS OR SAND-LINED MOLDS FOR WATER OR OTHER LIQUIDS.

2. JOINTS SHALL BE OF THE MECHANICAL OR PUSH-ON TYPE. JOINTS AND GASKETS SHALL CONFORM TO:

A21.11 RUBBER GASKETS JOINTS FOR CAST IRON PRESSURE PIPE & FITTINGS

3) DAMAGED PIPE SHALL BE REJECTED AND REMOVED FROM THE JOB SITE.

4) JOINTS SHALL BE DEPENDENT UPON A NEOPRENE OR ELASTOMERIC GASKET FOR WATER-TIGHTNESS. ALL JOINTS SHALL BE PROPERLY MATCHED WITH THE PIPE MATERIALS USED. WHERE DIFFERING MATERIALS ARE TO BE CONNECTED, AS AT THE STREET SEWER WYE OR AT THE FOUNDATION WALL, APPROPRIATE MANUFACTURED ADAPTERS SHALL BE USED.

5) TEES AND WYES: WHERE A TEE OR WYE IS NOT AVAILABLE IN THE EXISTING STREET SEWER, AN APPROPRIATE CONNECTION SHALL BE MADE, FOLLOWING MANUFACTURERS' INSTRUCTIONS USING A BOLTED, CLAMPED OR EPOXY-CEMENTED SADDLE TAPPED INTO A SMOOTHLY DRILLED OR SAWN OPENING IN THE SEWER. THE PRACTICE OF BREAKING AN OPENING WITH A SLEDGE HAMMER, STUFFING CLOTH OR OTHER SUCH MATERIAL AROUND THE JOINT, OR APPLYING MORTAR TO HOLD THE CONNECTION, AND ANY OTHER SIMILAR CRUDE PRACTICES OR INEPT OR HASTY IMPROVISATIONS WILL NOT BE PERMITTED. THE CONNECTION SHALL BE CONCRETE ENCASED AS SHOWN IN THE DETAIL UP TO AND INCLUDING 15" DIAMETER.

6) SEWER SERVICE INSTALLATION: THE PIPE SHALL BE HANDLED, PLACED AND JOINTED IN ACCORDANCE WITH INSTALLATION GUIDES OF THE APPROPRIATE MANUFACTURER. IT SHALL BE CAREFULLY BEDDED ON A 6 INCH LAYER OF CRUSHED STONE AND/OR GRAVEL AS SPECIFIED IN NOTE 10. BEDDING AND RE-FILL FOR DEPTH OF 12 INCHES ABOVE THE TOP OF THE PIPE SHALL BE CAREFULLY AND THOROUGHLY TAMPED BY HAND OR WITH APPROPRIATE MECHANICAL DEVICES.

THE PIPE SHALL BE LAID AT A CONTINUOUS AND CONSTANT GRADE FROM THE STREET SEWER CONNECTION TO THE FOUNDATION AT A GRADE OF NOT LESS THAN 1/4" INCH PER FOOT. PIPE JOINTS MUST BE MADE UNDER DRY CONDITIONS. IF WATER IS PRESENT, ALL NECESSARY STEPS SHALL BE TAKEN TO DRY THE TRENCH.

7) TESTING: THE COMPLETED SEWER SERVICE SHALL BE SUBJECTED TO A THIRD PARTY LEAKAGE TEST IN ANY OF THE FOLLOWING MANNERS: (PRIOR TO BACKFILLING)

A. AN OBSERVATION TEE SHALL BE INSTALLED AS SHOWN AND WHEN READY FOR TESTING, AN INFLATABLE BLADDER OR PLUG SHALL BE INTRODUCED JUST UPSTREAM FROM THE OPENING IN THE TEE. AFTER INFLATION, WATER SHALL BE INSERTED INTO THE SYSTEM ABOVE THE PLUG TO A HEIGHT OF 5 FEET ABOVE THE LEVEL OF THE PLUG.

B. THE PIPE SHALL BE LEFT EXPOSED AND LIBERALLY HOSED WITH WATER, TO SIMULATE, AS NEARLY AS POSSIBLE, WET TRENCH CONDITIONS OR, IF TRENCH IS WET, THE GROUND WATER SHALL BE PERMITTED TO RISE IN THE TRENCH OVER THE PIPE. INSPECTIONS FOR LEAKS SHALL BE MADE THROUGH THE CLEANOUT WITH A FLASHLIGHT.

C. DRY FLUORESCENCE DYE SHALL BE SPRINKLED INTO THE TRENCH OVER THE PIPE. IF THE TRENCH IS DRY, THE PIPE SHALL BE LIBERALLY HOSED WITH WATER, OR IF THE TRENCH IS WET, GROUND WATER SHALL BE PERMITTED TO RISE IN THE TRENCH OVER THE PIPE. OBSERVATION FOR LEAKS SHALL BE MADE IN THE FIRST DOWN-STREAM MANHOLE.

LEAKAGE OBSERVED IN ANY ONE OF THE ABOVE ALTERNATE TESTS SHALL BE CAUSE FOR NON-ACCEPTANCE AND THE PIPE SHALL BE DUG-UP IF NECESSARY AND RE-LAID SO AS TO ASSURE WATER TIGHTNESS.

8) ILLEGAL CONNECTIONS: NOTHING BUT SANITARY WASTE FLOW FROM TOILETS, SINKS, LAUNDRY ETC. SHALL BE PERMITTED. ROOF LEADERS, FOOTING DRAINS, SUMP PUMPS OR OTHER SIMILAR CONNECTIONS CARRYING RAIN WATER, DRAINAGE OR GROUND WATER SHALL NOT BE PERMITTED.

9) WATER SERVICE SHALL NOT BE LAID IN SAME TRENCH AS SEWER SERVICE.

10) BEDDING: SCREENED GRAVEL AND/OR CRUSHED STONE FREE FROM CLAY, LOAM, ORGANIC MATERIAL AND MEETING ASTM C33-67.

100% PASSING	1 INCH SCREEN
90%-100% PASSING	3/4 INCH SCREEN
20%-55% PASSING	3/8 INCH SCREEN
0%-10% PASSING	#4 SIEVE
0%-5% PASSING	#8 SIEVE

WHERE ORDERED BY THE ENGINEER TO STABILIZE THE TRENCH BASE, SCREENED GRAVEL OR CRUSHED STONE 1/2 INCH TO 1 1/2 INCH SHALL BE USED.

11) LOCATION: THE LOCATION OF THE TEE OR WYE SHALL BE RECORDED AND FILED IN THE MUNICIPAL RECORDS. IN ADDITION, A FERROUS METAL ROD OR PIPE SHALL BE PLACED OVER THE TEE OR WYE AS DESCRIBED IN THE TYPICAL "CHIMNEY" DETAIL, TO AID IN LOCATING THE BURIED PIPE WITH A DIP NEEDLE OR PIPEFINDER.

12) CHIMNEYS: IF VERTICAL DROP INTO SEWER IS GREATER THAN 4 FEET, A CHIMNEY SHALL BE CONSTRUCTED FOR THE SEWER CONNECTION. CHIMNEY INSTALLATION AS RECOMMENDED BY THE PIPE MANUFACTURER MAY BE USED IF APPROVED BY THE ENGINEER.

## GRAVITY SEWER NOTES

1. MINIMUM SIZE PIPE FOR GRAVITY SEWER SHALL BE 8-INCHES.

2. PIPE AND JOINT MATERIALS FOR PLASTIC SEWER PIPE SHALL CONFORM TO THE FOLLOWING ASTM STANDARDS:

ASTM STANDARDS	GENERIC PIPE MATERIAL	SIZES APPROVED
D3034-04a	* PVC (SOLID WALL)	8" THROUGH 15" (SDR 35)
F679-03	PVC (SOLID WALL)	18" THROUGH 27" (T-1 & T-2)
F794-03	PVC (RIBBED WALL)	8" THROUGH 36"
F1760-01(2005)e1	PVC, RECYCLED	ALL DIAMETERS

\*PVC: POLY VINYL CHLORIDE

3. PLASTIC SEWER PIPE SHALL HAVE A PIPE STIFFNESS RATING OF AT LEAST 46 POUNDS PER SQUARE INCH AT 5 PERCENT PIPE DIAMETER DEFLECTION, AS MEASURED IN ACCORDANCE WITH ASTM D2412-02 DURING MANUFACTURE.

4. JOINTS SEALS FOR PVC PIPE SHALL BE OIL RESISTANT COMPRESSION RINGS OF ELASTOMERIC MATERIAL CONFORMING TO ASTM D-3212-96(e)(2003)e1 AND SHALL BE PUSH-ON, BELL AND SPIGOT TYPE.

5. DUCTILE-IRON PIPE, FITTINGS AND JOINTS SHALL CONFORM TO THE FOLLOWING STANDARDS OF THE AMERICAN WATER WORKS ASSOCIATION (AWWA).

AWWA C151/A21.51-02 THICKNESS DESIGN OF DUCTILE IRON PIPE AND WITH ASTM A-536-94 (2004) DUCTILE IRON CASTINGS.

AWWA C151/A21.51-02 DUCTILE IRON PIPE, CENTRIFUGALLY CAST IN METAL MOLDS OR SAND-LINED MOLDS FOR WATER OR OTHER LIQUIDS.

JOINTS SHALL BE OF THE MECHANICAL OR PUSH-ON TYPE. JOINTS AND GASKETS SHALL CONFORM TO AWWA C151/A21.11 RUBBER GASKETS JOINTS FOR CAST IRON PRESSURE PIPE & FITTINGS.

6. CONCRETE PIPE SHALL CONFORM TO AWWA C302-04.

7. PRESTRESSED CONCRETE CYLINDER PIPE AND FITTINGS SHALL CONFORM TO AWWA C301-99.

JOINTS SEALS FOR CONCRETE CYLINDER PIPE SHALL BE OIL RESISTANT ELASTOMERIC MATERIAL CONFORMING TO AWWA C301-99 SPECIFICATIONS.

8. DAMAGED PIPE SHALL BE REJECTED AND REMOVED FROM THE JOB SITE.

9. GRAVITY SEWER PIPE TESTING SHALL BE AS FOLLOWS:

ALL NEW GRAVITY SEWERS SHALL BE TESTED FOR WATER TIGHTNESS BY THE USE OF LOW-PRESSURE AIR TESTS.

LOW PRESSURE AIR TESTING SHALL BE IN CONFORMANCE WITH:

ASTM F1417-92(2005) "STANDARD TEST METHOD FOR INSTALLATION ACCEPTANCE OF PLASTIC GRAVITY SEWER LINES USING LOW PRESSURE AIR".

UNI-BELL PVC PIPE ASSOCIATION UNI-B-6, "LOW PRESSURE AIR TESTING OF INSTALLED SEWER PIPE".

10. ALL NEW GRAVITY SEWERS SHALL BE CLEANED AND VISUALLY INSPECTED AND SHALL BE TRUE TO LINE AND GRADE FOLLOWING INSTALLATION AND PRIOR TO USE.

11. ALL PLASTIC SEWER PIPE SHALL BE DEFLECTION TESTED NOT LESS THAN 30 DAYS FOLLOWING INSTALLATION.

12. THE MAXIMUM ALLOWABLE DEFLECTION OF FLEXIBLE SEWER PIPE SHALL BE 5.0 PERCENT OF THE AVERAGE INSIDE DIAMETER.

13. TRENCH CONSTRUCTION SHALL CONFORM TO THE FOLLOWING:

SEWERS SHALL BE BURIED TO A MINIMUM DEPTH OF 6' BELOW GRADE IN ALL ROADWAY LOCATIONS AND TO A MINIMUM DEPTH OF 4 FEET BELOW GRADE IN ALL CROSS COUNTRY LOCATIONS.

WHERE SEWER LINES CROSS WATER PIPES, A MINIMUM OF 18" VERTICAL SEPARATION BETWEEN THE TWO OUTSIDE PIPE WALLS SHALL BE OBSERVED. AT SEWER/WATER INTERSECTIONS, A MINIMUM OF 6 FEET SHALL BE PROVIDED FROM THE WATER LINE TO THE SEWER PIPE JOINT. 12" SEPARATION BETWEEN THE TWO OUTSIDE PIPE WALLS SHALL BE REQUIRED BETWEEN SEWER LINES AND ALL OTHER PIPES.

TRENCH DIMENSIONS FOR SEWER PIPE LESS THAN 15 INCHES IN DIAMETER, THE ALLOWABLE TRENCH WIDTH AT A PLANE 12 INCHES ABOVE THE PIPE SHALL BE NO MORE THAN 36 INCHES AND FOR PIPE 15 INCHES AND LARGER, THE ALLOWABLE WIDTH SHALL BE EQUAL TO THE PIPES OUTSIDE DIAMETER PLUS 24 INCHES.

PIPE TRENCH BEDDING MATERIAL AND FILL MATERIAL FOR EXCAVATION BELOW GRADE SHALL BE SCREENED GRAVEL OR CRUSHED STONE TO ASTM C33-03 STONE SIZE NO. 67. THE PIPE SAND BLANKET MATERIAL SHALL BE GRADED SAND FREE FROM ANY ORGANIC MATERIALS, GRADED SUCH THAT 100 PERCENT PASSED THE 1/2-INCH SIEVE AND A MAXIMUM OF 15 PERCENT PASSES A #200 SIEVE. IN LIEU OF A SAND BLANKET, A STONE ENVELOPE 6 INCHES THICK COMPLETELY AROUND THE PIPE USING 3/4-INCH STONE MAY BE USED.

PIPE BEDDING MATERIAL SHALL EXTEND FROM A HORIZONTAL PLANE THROUGH THE PIPE AXIS TO 6-INCHES BELOW THE BOTTOM OF THE OUTSIDE SURFACE OF THE PIPE.

PIPE SAND BLANKET MATERIAL SHALL COVER THE PIPE A MINIMUM OF 12 INCHES ABOVE THE CROWN OF THE OUTSIDE SURFACE.

COMPACTION SHALL BE IN 12-INCH LAYERS FOR BEDDING AND BLANKET MATERIALS.

BACKFILL MATERIAL SHALL BE IN 3-FOOT LAYERS TO THE GROUND SURFACE EXCEPT FOR ROAD CONSTRUCTION WHERE THE FINAL 3-FOOT SHALL BE COMPACTED IN 12-INCH LAYERS TO THE ROAD BASE SURFACE.






TRENCH BACKFILL MATERIAL IN ROADWAY LOCATIONS SHALL BE NATURAL MATERIALS EXCAVATED FROM THE TRENCH DURING CONSTRUCTION, EXCLUDING DEBRIS, PAVEMENT PIECES, ORGANIC MATTER, TOP SOIL, WET OR SOFT MUCK, PEAT, CLAY, EXCAVATED LEDGE, ROCKS OVER 6 INCHES IN THE LARGEST DIMENSION, OR ANY OTHER UNSUITABLE MATERIAL NOT APPROVED BY THE ENGINEER.

TRENCH BACKFILL AT CROSS-COUNTRY LOCATIONS SHALL BE AS DESCRIBED ABOVE EXCEPT THAT THE ENGINEER MAY PERMIT THE USE OF TOP SOIL, LOAM, MUCK OR PEAT, IF HE IS SATISFIED THAT THE COMPLETED CONSTRUCTION WILL BE ENTIRELY STABLE AND PROVIDED THAT EASY ACCESS TO THE SEWER FOR MAINTENANCE AND POSSIBLE RECONSTRUCTION, WHEN NECESSARY WILL BE PRESERVED. BACKFILL SHALL BE MOUND 6-INCHES ABOVE ORIGINAL GROUND.

BASE COURSE MATERIALS FOR TRENCH REPAIRS SHALL MEET THE REQUIREMENTS OF DIVISION 300 OF THE "STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION" OF NEW HAMPSHIRE DEPARTMENT OF TRANSPORTATION.

WHERE SHEETING IS PLACED ALONG SIDE OF THE PIPE AND EXTENDS BELOW MID-DIAMETER, THE SHEETING SHALL BE CUT OFF AND LEFT IN PLACE TO AN ELEVATION NOT LESS THAN ONE FOOT ABOVE THE TOP OF THE PIPE AND AT LEAST 3 FEET BELOW FINISH GRADE.

TRENCHES FOR SEWER PIPES WITH SLOPES OVER 0.08 FEET PER FOOT AND TRENCHES FOR SEWER PIPES BELOW THE SEASONAL HIGH GROUND WATER LEVEL SHALL HAVE IMPERVIOUS TRENCH DAMS CONSTRUCTED EVERY 300 FEET TO PREVENT POTENTIAL DISTURBANCE TO PIPE BEDDING AND BLANKET MATERIALS.

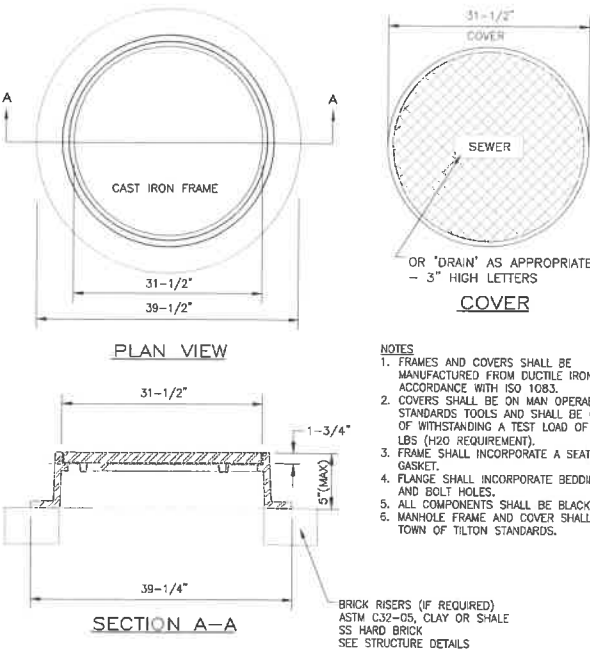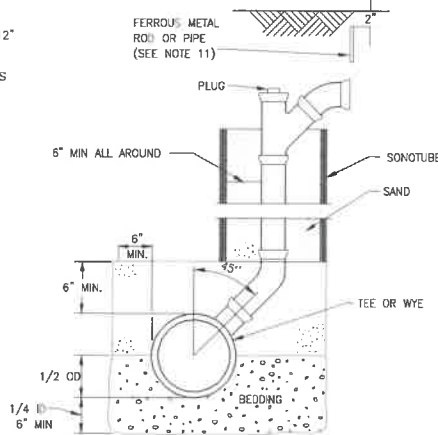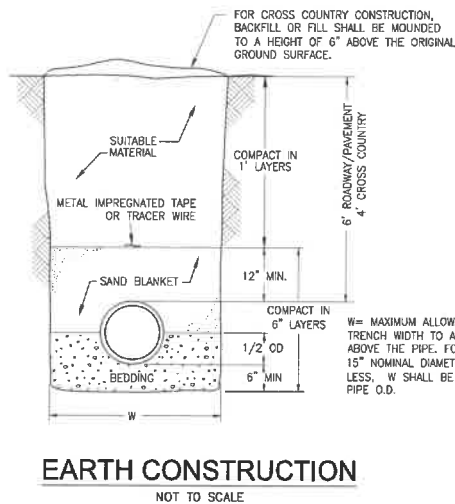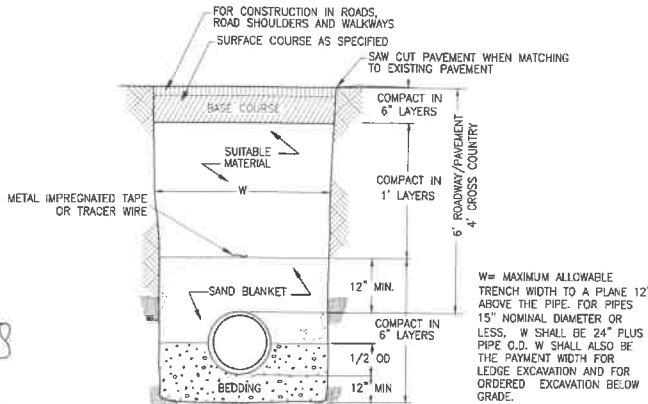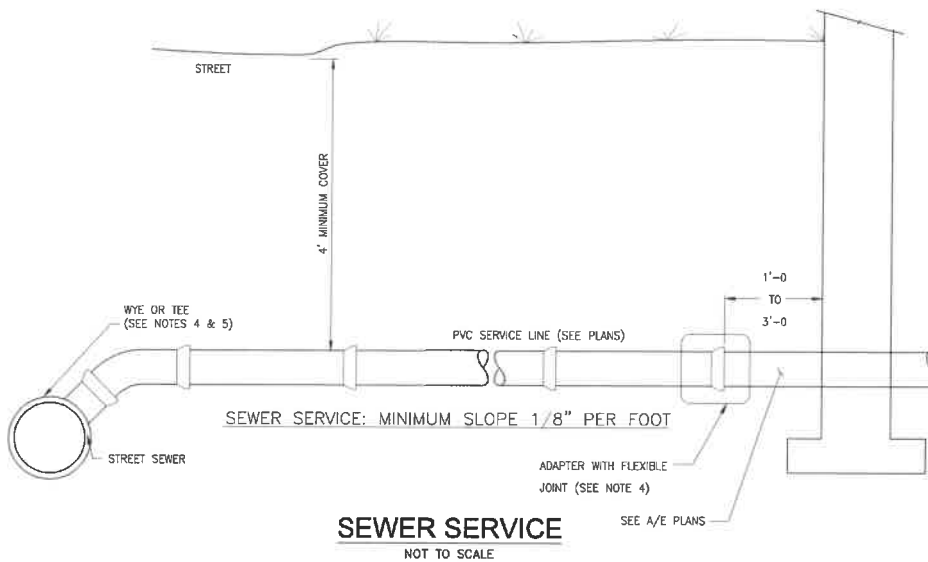

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

### DETAIL

### PROPOSED AUTO DEALERSHIP

0 NORTH MAIN STREET, ROCHESTER, NH

OWNED BY & PREPARED FOR

401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Seacoast Division

**TFM**

Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

47159.02

DR HEG FB

OK ORR CADFILE

47159-02\_DETAILS

C-18


Copyright 2020 ©Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.







24" OR 30" DIA  
CLEANOUT

1'-0"

1'-0"

RISER

1'-0" STEPS (IF REQ'D)

8'-0"

**SHEA**

PIPE TO MANHOLE CONNECTIONS  
SEE DETAILS A/B  
(SIZED TO SUIT)

6"

BASE

10"

9"

DETAIL B  
MORTAR AND GROUT  
BY CONTRACTOR

DETAIL B  
FLEXIBLE SLEEVE

EXTERIOR COATING  
IF REQ'D

FLAT TOP


HEIGHT	ITEM NO.	WEIGHT
1'-0"	MH/B-FT8ID	11

- NOTES:
1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
  2. REINFORCED STEEL CONFORMS TO ASTM A185 SPEC. 0.18 SQ. IN./LINEAL FT. AND 0.18 SQ. IN. (BOTH WAYS) BASE BOTTOM.
  3. DESIGN LOADING PER AASHTO HS-20, 1 TO 5 FEET COVER.
  4. MANHOLE DESIGN SPEC CONFORMS TO ASTM C478 SPEC FOR "PRECAST REINFORCED CONCRETE MANHOLE SECTIONS."
  5. BUTYL RESIN SECTION JOINT CONFORMS TO ASTM C990 SPECIFICATION.
  6. STEEL REINFORCED COPOLYMER POLYPROPYLENE PLASTIC STEP CONFORMS TO ASTM C478 SPEC.

RISER SECTION		
HEIGHT	ITEM NO	WEIGHT
2'-0"	MHB-24CS8ID	6.102
3'-0"	MHB-36CS8ID	9.153
4'-0"	MHB-48CS8ID	12.204
5'-0"	MHB-60CS8ID	15.255
6'-0"	MHB-72CS8ID	18.306

BASE SECTION		
HEIGHT	ITEM NO	WEIGHT
3'-6"	MHB-42S8ID	8.690
4'-6"	MHB-54S8ID	11.740
5'-6"	MHB-66S8ID	14.790

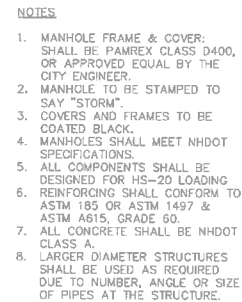

ADJUST TO GRADE WITH PRECAST CONCRETE PAVERS OR CONCRETE ADJUSTMENT RINGS

FRAME AND GRATE

ELEV 227.2'±

32"

INV=224.8'

4" RECTANGULAR PRECAST MANHOLE CONFORMING TO NHDOT STANDARD SPECIFICATIONS

3" ORIFICE  
INV=224.35'

6" ORIFICE  
INV=224.05'

1" ORIFICE  
INV=223.30'

6" CONCRETE WALLS

12" HDPE

18" HDPE TEE

12" HDPE

0.5" ORIFICE  
INV=222.20'

SEAL IN PLACE WITH NON-SHRINK MORTAR

4'-0"

12" COMPACTED CRUSHED STONE

222.20'

222.20'

HEADWALL OR CURB CUT

W<sub>up</sub>=UPSTREAM WIDTH

INSTALL ANIMAL SCREEN OVER HEADWALL OUTLETS

L=SEE TABLE

W<sub>dn</sub>=DOWNSTREAM WIDTH

HEADWALL OR CURB CUT

TYPE I GEOTEXTILE FABRIC

D=DEPTH OF STONE  
c50=6" (MIN.)

MINIMUM OUTLET APRON DIMENSIONS (SEE NOTE #1)				
OUTLET	L	W <sub>up</sub>	W <sub>dn</sub>	c50
HW#1	20'	4.5'	13'	0.5'

% OF WEIGHT SMALLER THAN THE GIVEN SIZE	SIZE OF STONE
100	4.50 TO 10
85	3.90 TO 7
50	3.00 TO 5
15	0.90 TO 2

**MAINTENANCE:**  
THE OUTLET PROTECTION SHOULD BE CHECKED AT LEAST ANNUALLY AND AFTER EVERY MAJOR STORM. IF THE RIP RAP HAS BEEN DISPLACED, UNDERMINED OR DAMAGED, IT SHOULD BE CHECKED TO SEE THAT EROSION IS NOT OCCURRING. THE DOWNSTREAM CHANNEL SHOULD BE KEPT CLEAR OF OBSTRUCTIONS SUCH AS FALLEN TREES, DEBRIS, AND SEDIMENT THAT COULD CHANGE FLOW PATTERNS AND/OR TAILWATER DEPTHS ON THE PIPES. REPAIRS MUST BE CARRIED OUT IMMEDIATELY TO AVOID ADDITIONAL DAMAGE TO THE OUTLET PROTECTION APRON.

**CONSTRUCTION SPECIFICATIONS:**

1. THE OUTLET APRON SIZING IS CONCEPTUAL AND SHOULD BE SIZED FOR STORMWATER FLOWS FROM PARCEL 6, WHICH WILL BE REDEVELOPED AND DESIGNED IN 2021. PRIOR TO INSTALLATION AND ORDERING MATERIALS, CONFIRM WITH THE ENGINEER THAT THE OUTLET PROTECTION IS APPROPRIATE SIZING AND STORMWATER SYSTEM'S APPROPRIATE S. APPROPRIATE S.
2. THE SUBGRADE FOR THE FILTER MATERIAL, GEOTEXTILE FABRIC, AND RIP RAP SHALL BE PREPARED TO THE LINES AND GRADES SHOWN ON THE PLANS.
3. THE ROCK OR GRAVEL USED FOR FILTER OR RIP RAP SHALL CONFORM TO THE SPECIFIED GRADATION.
4. GEOTEXTILE FABRICS SHALL BE PROTECTED FROM PUNCTURE OR TEARING DURING THE PLACEMENT. IF THE ROCK RIP RAP, DAMAGED AREAS IN THE FABRIC SHALL BE REPAIRED BY PLACING A PIECE OF FABRIC OVER THE DAMAGED AREA OR BY COMPLETE REPLACEMENT OF THE FABRIC. ALL OVERLAPS REQUIRED FOR REPAIRS OR JOINING TWO PIECES OF FABRIC SHALL BE A MINIMUM OF 12".
5. THE RIP RAP SHALL BE PLACED BY EQUIPMENT AND SHALL BE CONSTRUCTED TO THE FULL LAYER THICKNESS IN ONE OPERATION AND IN SUCH A MANNER AS TO PREVENT SEGREGATION OF THE STONE SIZES.
6. INSTALL ANIMAL SCREEN TO HEADWALL OUTLET.

**NOT TO SCALE**

STONE SIZE (% FINER)				
12"	6"	3"	1"	No. 4
100%	84-100%	68-83%	42-55%	8-12%

The diagram shows a cross-section of a rip-rap apron. From left to right: an existing ground line sloping up at 6:1 max. slope; a rip-rap slope protection layer with a level lip of spreader (min. 1' depth); a 2' wide rip-rap apron layer; a 1.5' (min.) wide layer; a variable width layer (see detail); and a final layer sloping down at 3:1 max. slope. A circular inset shows a detail of the 2' x 6" erosion stop. A table of stone size specifications is provided.


Labels in diagram:

- SET TOP OF 2x6 1" BELOW TOP OF BERM
- PRESSURE TREATED 2"x6" EROSION STOP ALONG LENGTH OF LEVEL SPREADER LIP
- LEVEL LIP OF SPREADER
- RIP RAP SLOPE PROTECTION, SEE STONE SIZE CHART (MIN. 1' DEPTH)
- 6:1 MAX. SLOPE
- EXISTING GROUND
- LENGTH VARIES
- 2'
- 1.5' (MIN.) LENGTH
- VARIES (SEE RIP RAP APRON DETAIL)
- 3:1 MAX. SLOPE
- MIRAFI 170N OR EQUAL
- VARIES (SEE PLAN) (LOAM & SEED SLOPE)

Figure 10 is a technical drawing showing a cross-section of a curb and gutter assembly. The main drawing shows a curb with a height of 4'-2" and a width of 7'-0". The gutter has a depth of 18" and a 4" weep hole. Two circular openings, each 12" in diameter, are shown with a 3" gap between them. A 12" minimum dimension is indicated for the gutter slope. A detail callout (2) shows a 1/2" diameter rebar.

NOTES:

1. THE HEADWALL AND NUMBER OF CULVERTS AND SIZING IS CONCEPTUAL AND SHOULD BE SIZED FOR STORMWATER FLOWS FROM PARCEL 6, WHICH WILL BE REDEVELOPED AND DESIGNED IN 2021. PRIOR TO INSTALLATION AND ORDERING MATERIALS, CONFIRM WITH THE ENGINEER THAT THE HEADWALL, CULVERTS, AND STORMWATER SYSTEM'S SIZING AND CONFIGURATION IS APPROPRIATE.
2. DESIGN WINGWALLS, IF NECESSARY PER GRADING & DRAINAGE PLAN.
3. INSTALL ANIMAL SCREEN TO HEADWALL OUTLET.

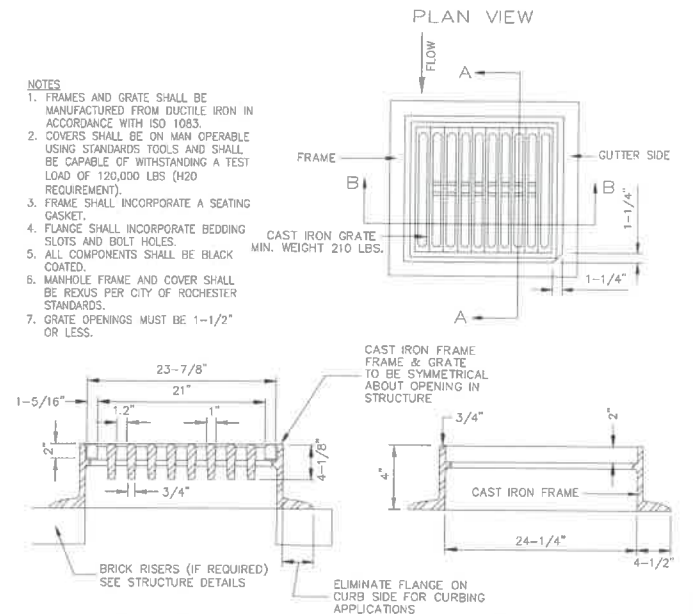[illegible]

SEE FRAME AND GRATE DETAIL

FACE OF CURBING

FINISH GRADE

CAST IRON FRAME SET ON FULL BED OF MORTAR AND SEALED WITH MORTAR.

ADJUST TO GRADE WITH HARD RED BRICK—2" MINIMUM, 12" MAX. (CONCRETE COLLARS AND BARREL BLOCKS ARE NOT ACCEPTABLE.)

6" PRECAST SLAB SECTION

12"

6"

24"x24" OPENING

5" MINIMUM WALL THICKNESS (8" IF UNREINFORCED)

48" MINIMUM

FLAT TOOL JOINT ON ALL EXPOSED BRICK

OPTIONAL: FOR GREASE TRAP BASIN USE TEE (MATCH PIPE SIZE)

END OF PIPE TO BE FLUSH WITH INSIDE WALL

VARIES SEE PLAN VIEWS FOR DEPTH

6" MIN

48" SUMP

FLOW →

SEAL AROUND PIPES WITH NON-SHRINK MORTAR FLUSH WITH STRUCTURE

SEAL ALL FACTORY PRECAST JOINTS W/ BITUMINOUS SEAL

PRECAST CONCRETE BASE SECTION

EXISTING SUBGRADE OR COMPACTED FILL

6" MINIMUM DRAINAGE STONE

52" DIA

NOTE: ALL PRECAST SECTIONS SHALL CONFORM TO ASTM C-478

## SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

## DETAILS

**PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH**

OWNED BY & PREPARED FOR  
**401 NORTH MAIN STREET LLC**

**SCALE, NTS**

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
[www.tfmorgan.com](http://www.tfmorgan.com)

47159.02

DR	HEG	FB	-
CK	CRR	CADFILE	47159-02 DETAILS

C-19






FRAME AND COVER  
(DIAMETER VARIES)  
N.T.S.

GENERAL NOTES:

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. FOR SITE SPECIFIC DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHT, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS REPRESENTATIVE. [www.conteches.com](http://www.conteches.com)
3. JELLYFISH WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
4. STRUCTURE SHALL MEET AASHTO HS-20 OR PER APPROVING JURISDICTION REQUIREMENTS, WHICHEVER IS MORE STRINGENT, ASSUMING EARTH COVER OF 0' - 10', AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET AASHTO M309 LOAD RATING AND BE CAST WITH THE CONTECH LOGO.
5. STRUCTURE SHALL BE PRECAST CONCRETE CONFORMING TO ASTM C-857, ASTM C-918, AND AASHTO LOAD FACTOR DESIGN METHOD.
6. OUTLET PIPE INVERT IS EQUAL TO THE CARTRIDGE DECK ELEVATION.
7. THE OUTLET PIPE DIAMETER FOR NEW INSTALLATIONS IS RECOMMENDED TO BE ONE PIPE SIZE LARGER THAN THE INLET PIPE AT EQUAL OR GREATER SLOPE.
8. NO PRODUCT SUBSTITUTIONS SHALL BE ACCEPTED UNLESS SUBMITTED 10 DAYS PRIOR TO PROJECT BID DATE, OR AS DIRECTED BY THE ENGINEER OF RECORD.


INSTALLATION NOTES:

- A. ANY SUB-BASE, BACKFILL, DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STRUCTURE.
- C. CONTRACTOR WILL INSTALL AND LEVEL THE STRUCTURE, SEALING THE JOINTS, LINE ENTRY AND EXIT POINTS (NON-SHRINK GROUT WITH APPROVED WATERSTOP OR FLEXIBLE BOOT).
- D. CARTRIDGE INSTALLATION, BY CONTECH, SHALL OCCUR ONLY AFTER SITE HAS BEEN STABILIZED AND THE JELLYFISH UNIT IS CLEAN AND FREE OF DEBRIS. CONTACT CONTECH TO COORDINATE CARTRIDGE INSTALLATION WITH SITE STABILIZATION.

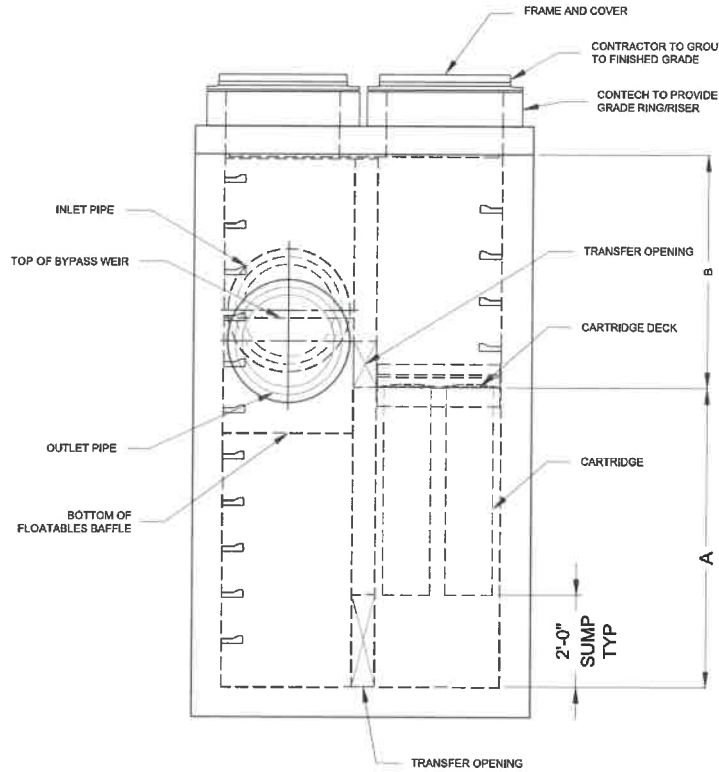

ELEVATION VIEW

*Jellyfish® Filter*

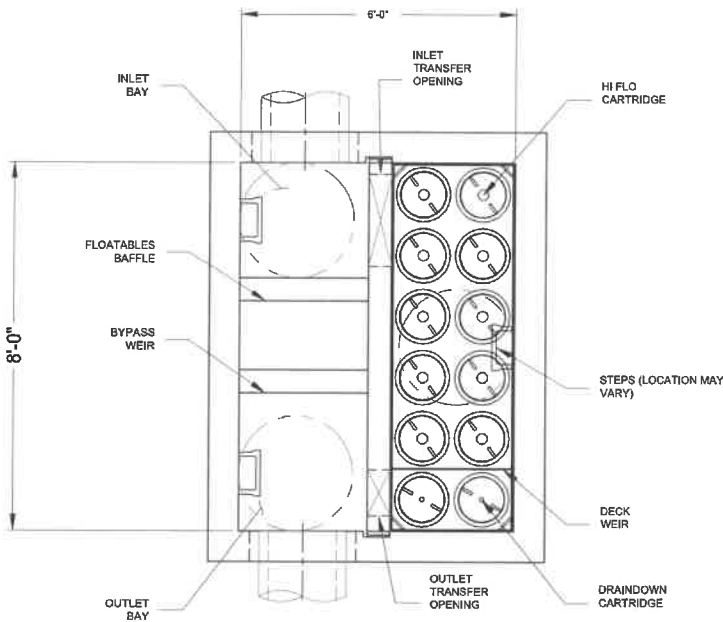

PLAN VIEW

(TOP SLAB NOT SHOWN FOR CLARITY)

JELLYFISH TREATMENT DEVICE

(JFPD0806-9-2)

NOT TO SCALE

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

DETAILS

PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH

OWNED BY & PREPARED FOR  
401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists

170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
[www.tfmoran.com](http://www.tfmoran.com)

REV	DATE	DESCRIPTION	DR	CK
1	7/9/2021	REVISED PER TRG COMMENTS	HEG	CKM

47159.02 DR HEG FB -  
OK CRR CADFILE 47159-02-DETAILS

C-20




NOTES

- THIS PORT IS USED TO PUMP WATER INTO THE SYSTEM AND RE-SUSPEND ACCUMULATED SEDIMENT SO THAT IT MAY BE PUMPED OUT.
- MINIMUM REQUIRED MAINTENANCE INCLUDES A QUARTERLY INSPECTION DURING THE FIRST YEAR OF OPERATION AND A YEARLY INSPECTION THEREAFTER, FLUSH AS NEEDED.
- ONLY R-TANK<sup>HD</sup>, R-TANK<sup>SD</sup>, R-TANK<sup>MD</sup>, AND R-TANK<sup>LD</sup> MAY BE USED IN TRAFFIC APPLICATIONS.
- IF MAINTENANCE PORT IS LOCATED IN A NON-TRAFFIC AREA, A PLASTIC CAP CAN BE USED IN LEU OF A FRAME AND COVER WITH CONCRETE COLLAR.





DEPTH SUMMARY

TYPE	A	B	DIA.
R-TANK <sup>LD</sup>	12" MIN - 35" MAX	AS SHOWN ON PLANS	12"
R-TANK <sup>MD</sup>	20" MIN - 5.99' MAX	12"	12"
R-TANK <sup>SD</sup>	18" MIN - 9.99' MAX	12"	12"
R-TANK <sup>HD</sup>	12" MIN - 5.00' MAX	6"	10"
R-TANK <sup>TD</sup>	6" MIN - 16.67' MAX	N/A	12"

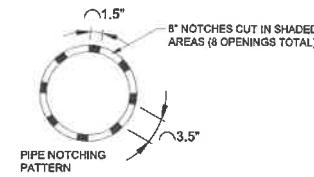

R-TANK MAINTENANCE PORT

NOT TO SCALE



MODULE DATA

GEOMETRY: LENGTH = 28.15 IN. (715 MM) WIDTH = 15.75 IN. (400 MM) HEIGHT = 25.98 IN. (660 MM) TANK VOLUME = 6.67 CF STORAGE VOLUME = 6.33 CF VOID INTERNAL VOLUME: 95% VOID SURFACE AREA: 90%	LOAD RATING: 33.4 PSI (MODULE ONLY) HS25, (WITH ACF COVER SYSTEM) MATERIAL: 100% RECYCLED POLYPROPYLENE SMALL PLATES PER SEGMENT/TOTAL: 5/10
--	---


R-TANK<sup>HD</sup> - SINGLE + MINI MODULES

NOT TO SCALE

TOTAL COVER: 20" MINIMUM AND 84" MAXIMUM. FIRST 12" MUST BE FREE DRAINING BACKFILL (SPEC SECTION 2.03B); STONE <1.5" OR SOIL (USCS CLASS GW, GP, SW OR SP). ADDITIONAL FILL MAY BE STRUCTURAL FILL (SPEC SECTION 2.03C); STONE OR SOIL (USCS CLASS SM, SP, SW, GM, GP OR GW) WITH MAX CLAY CONTENT <10%, MAX 25% PASSING NO. 200 SIEVE, AND MAX PLASTICITY INDEX OF 4. A MIN. 12" COVER MUST BE MAINTAINED BETWEEN BACKFILL EQUIPMENT AND THE TOP OF THE R-TANK<sup>HD</sup> SYSTEM AT ALL TIMES. TOTAL HEIGHT OF TOP BACKFILL SHOULD NOT EXCEED 7'. CONTACT ACF ENVIRONMENTAL IF MORE THAN 7' OR LESS THAN 20" OF TOP BACKFILL IS REQUIRED (FROM TOP OF TANK TO TOP OF PAVEMENT).

NOTES



- FOR COMPLETE MODULE DATA, SEE APPROPRIATE R-TANK<sup>HD</sup> MODULE SHEET.
- INSTALLATIONS PER THIS DETAIL MEET GUIDELINES OF HL-93 LOADING PER THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, CUSTOMARY U.S. UNITS, 7TH EDITION, 2014 WITH 2015 AND 2016 INTERIM REVISIONS.
- PRE-TREATMENT STRUCTURES NOT SHOWN.
- FOR INFILTRATION APPLICATIONS, GEOTEXTILE ENVELOPING R-TANK SHALL BE ACF M200 (PER SPEC SECTION 2.02A) AND BASE SHALL BE 4" MIN. UNCOMPACTED FREE DRAINING BACKFILL (SPEC SECTION 2.03A) TO PROVIDE A LEVEL BASE. SURFACE MUST BE SMOOTH, FREE OF LUMPS OR DEBRIS, AND EXTEND 2' BEYOND R-TANK<sup>HD</sup> FOOTPRINT.

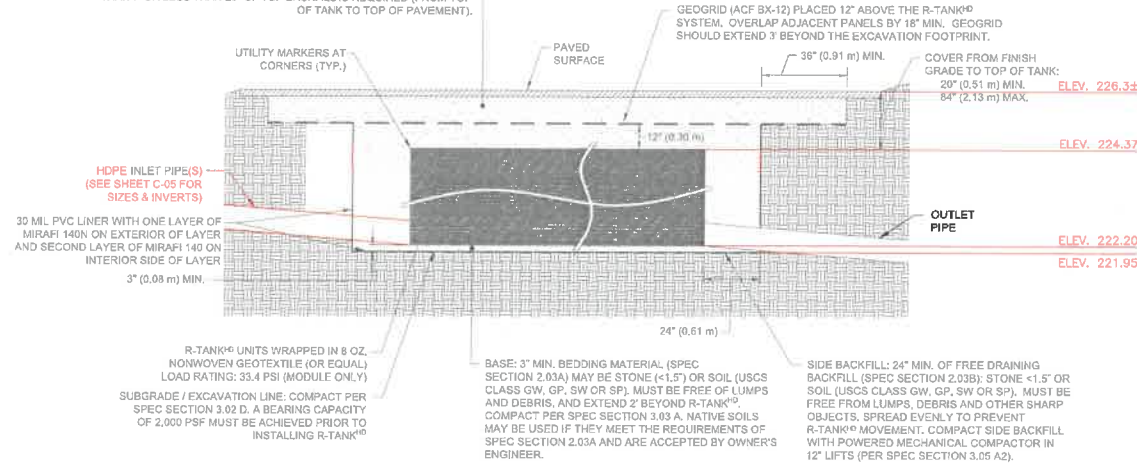

R-TANK & HS-20 LOADS - SECTION VIEW

NOT TO SCALE

CUT AN "X" IN THE FABRIC ENVELOPE THAT IS SLIGHTLY LARGER THAN THE PIPE, PULL THE FABRIC FLAPS AROUND THE PIPE, AND SEAL WITH A STAINLESS STEEL BAND.






INLET/OUTLET PIPE

"X" CUT IN THE FABRIC TO ALLOW PIPE/TANK INTERFACE

NOTE: PIPE MUST BUTT DIRECTLY AGAINST R-TANK, PIPE EFFLUENT SHALL NOT PASS THROUGH FABRIC ENVELOPE

STAINLESS STEEL BAND USED TO FASTEN FABRIC TO PIPES TO PREVENT BACKFILL FROM ENTERING STRUCTURE

AFTER TANK WRAP IS SECURED TO PIPE, SLIDE BOOT AGAINST R-TANK AND SECURE WITH SECOND STAINLESS STEEL BAND, THEN ATTACH BOOT FLAP TO TANK ENVELOPE FABRIC WITH DUCT TAPE OR OTHER ADHESIVE.

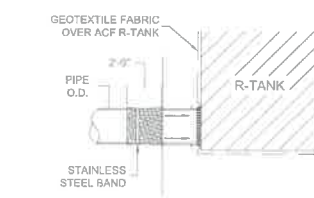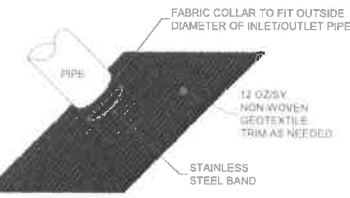

R-TANK TYPICAL INLET/OUTLET W/ GEOTEXTILE BOOT

NOT TO SCALE

SITE DEVELOPMENT PLANS

TAX MAP 114 LOT 7

DETAILS

PROPOSED AUTO DEALERSHIP  
0 NORTH MAIN STREET, ROCHESTER, NH

OWNED BY & PREPARED FOR  
401 NORTH MAIN STREET LLC

SCALE: NTS

JUNE 1, 2021

Copyright 2020 © Thomas F. Moran, Inc.  
48 Constitution Drive, Bedford, N.H. 03110

All rights reserved. These plans and materials may not be copied, duplicated, replicated or otherwise reproduced in any form whatsoever without the prior written permission of Thomas F. Moran, Inc.

This plan is not effective unless signed by a duly authorized officer of Thomas F. Moran, Inc.



Seacoast Division



Civil Engineers  
Structural Engineers  
Traffic Engineers  
Land Surveyors  
Landscape Architects  
Scientists


170 Commerce Way, Suite 102  
Portsmouth, NH 03801  
Phone (603) 431-2222  
Fax (603) 431-0910  
www.tfmoran.com

REV	DATE	DESCRIPTION	DR	CK
1	7/9/2021	REVISED PER TRC COMMENTS	HEG	CKR

47159.02	DR	HEG	FB	-
	CK	CRR	CADFILE	47159-02_DETAILS

C-21



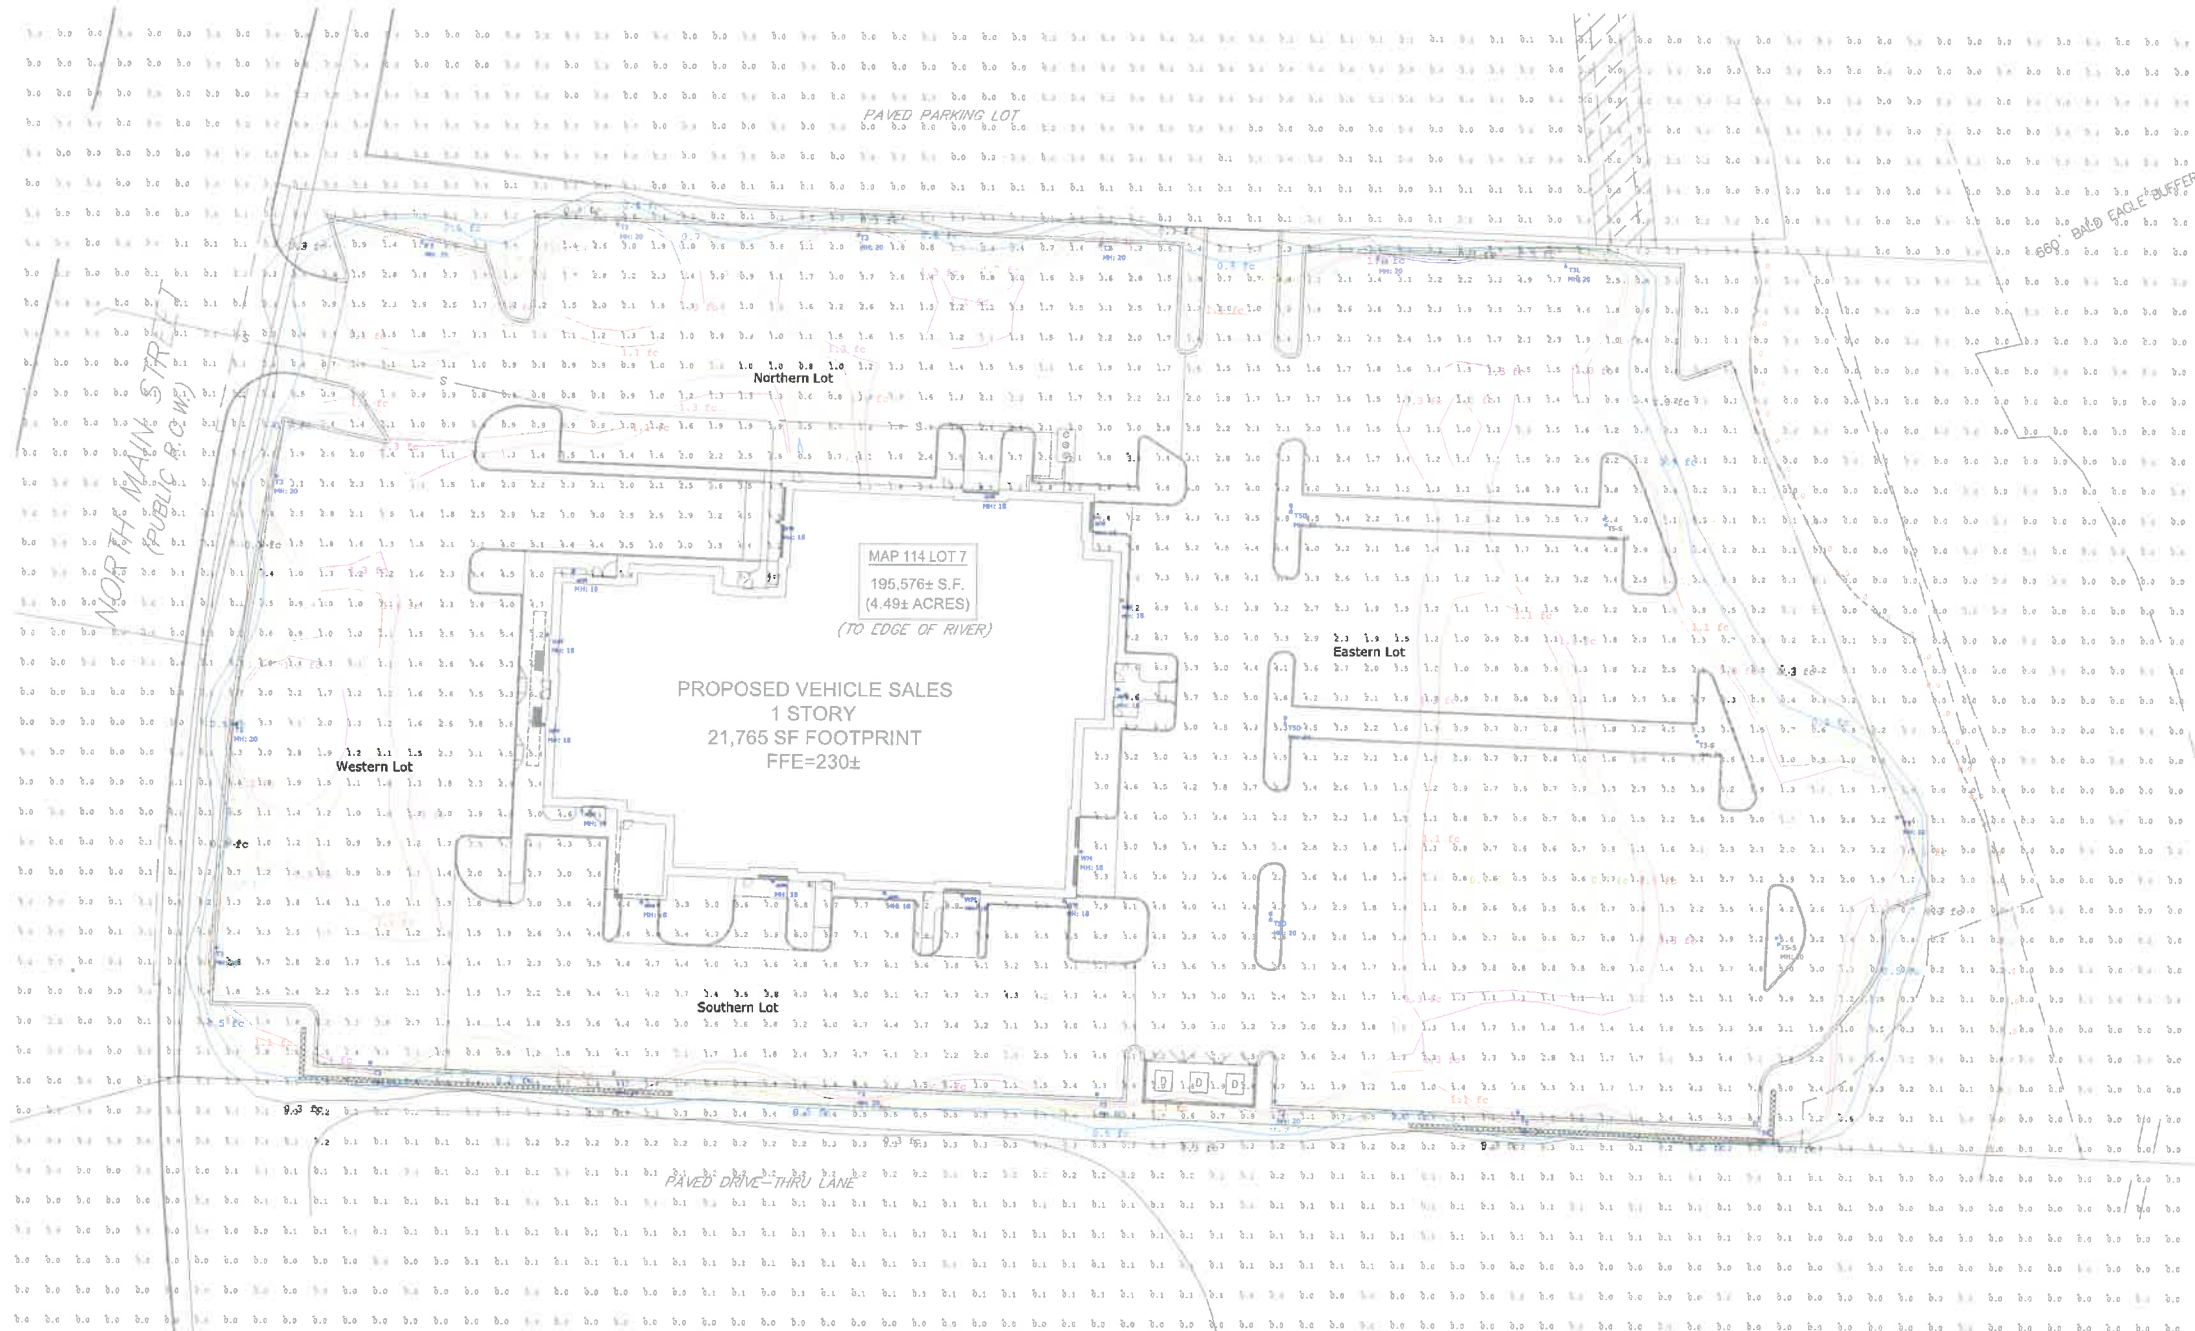

1 Photometric Layout and Calculations




Luminaire Schedule

Symbol	Label	Qty	Description	LLF	Arrangement	Lum. Watts	Lum. Lumens	BUG Rating	NOTE
	T3	15	Visionaire # VSX-II-T3L-25L-4K-UNV-AM-TBD-HS / SNTS-4S-11-20'-9BC-343-S1-TBD	0.900	SINGLE	167	7381	B4-U0-G4	SEE NOTE E
	T3L	1	Visionaire # VSX-II-T3L-25L-4K-UNV-AM-TBD-BN / SNTS-4S-11-20'-9BC-343-S1-TBD	0.900	SINGLE	167.1	17337	B4-U0-G4	SEE NOTE E
	T3R	1	Visionaire # VSX-II-T3L-25L-4K-UNV-AM-TBD-BN / SNTS-4S-11-20'-9BC-343-S1-TBD	0.900	SINGLE	167.1	17337	B4-U0-G4	SEE NOTE E
	T5-S	3	Visionaire # VSX-II-T5LR-10L-4K-UNV-AM-TBD-RCLS/LCLS / SNTS-4S-11-20'-9BC-343-D1-TBD	0.900	GROUP	140	13900	B3-U0-G3	SEE NOTE E
	TSD	3	Visionaire # VSX-II-T5LR-10L-4K-UNV-AM-TBD / SNTS-4S-11-20'-9BC-343-D1-TBD	0.900	BACK-BACK	140	18712	B3-U0-G3	
	WM	15	Visionaire # VSX-II-T4L-15L-4K-UNV-WM-TBD	0.900	SINGLE	101.7	13949	B3-U0-G3	

Calculation Summary

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
Site Calc Pts	Illuminance	Fc	0.91	9.4	0.0	N.A.	N.A.
Wetland Buffer	Illuminance	Fc	0.00	0.0	0.0	N.A.	N.A.
Eastern Lot	Illuminance	Fc	2.24	8.5	0.1	22.40	85.00
Northern Lot	Illuminance	Fc	1.61	5.6	0.4	4.03	14.00
Southern Lot	Illuminance	Fc	3.74	9.4	0.8	4.68	11.75
Western Lot	Illuminance	Fc	2.07	5.6	0.4	5.18	14.00

## VSX-II Array LED Specifications

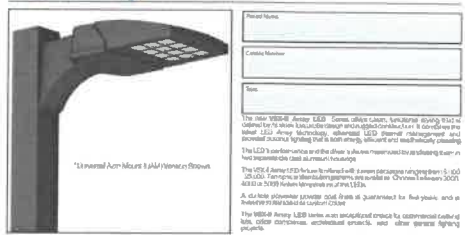


MODEL	OPTICS	LUMENS	BELIEF	VOLTAGE	MOUNTING	FINISH	OPTIONS	OTHERS
VSX-II	T3	6L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T3L	10L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T3R	10L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5	20L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5S	20L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5D	20L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5S	20L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5D	20L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5S	20L	100	120V	ARM	BLACK	PCB-100	UPH-100
	T5D	20L	100	120V	ARM	BLACK	PCB-100	UPH-100

## VISIONAIRE LIGHTING

### 2 Visionaire Type VSX-II Array Specification

## SNTS Specifications

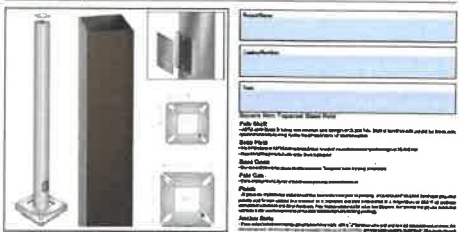

MODEL	SHAFT DIA.	GAUGE	HEIGHT	BASE	ANCHORAGE	ANCHITING	FINISH	OPTIONS
SNTS	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"
	43	11	10"	10"	10"	10"	10"	10"

## VISIONAIRE LIGHTING

### 3 Visionaire Type SNTS Specification

#### NOTES:

- A LIGHT LOSS FACTOR OF 0.900 HAS BEEN APPLIED TO FIXTURES UNLESS OTHERWISE NOTED. REFER TO LUMINAIRE SCHEDULE FOR LIGHT LOSS FACTOR AND LUMEN INFORMATION.
- SEE "MH" ON LIGHTING FIXTURE TAG LOCATED ON PLAN FOR MOUNTING HEIGHT INFORMATION.
- CALCULATION POINTS ARE TAKEN AT GRADE.
- CALCULATION RESULTS ARE BASED ON IES STANDARDS UNLESS OTHERWISE REQUESTED.
- BUG RATING LISTED IS FOR STANDARD FIXTURE. ADJUSTABLE BARN DOOR TYPE SHIELD IS INCLUDED WITH EACH FIXTURE TO REDUCE BACKLIGHT (TYPE T3) OR SIDELIGHT (TYPE T3L,T3R,T5S) TO 0.

DATE:	7/8/2021	REVISIONS	DESCRIPTION	DATE
PROJECT NUMBER:	21059	1	Adjust plan/ account for wetlands	7/8/2021
DRAWN BY:	AM	2		
CHECKED BY:	AD	3		
APPROVED BY:	AD	4		
SCALE:	AS NOTED	5		
		6		
		7		